

Ooutsultation[®] RMD System[™]



An Exterior Wall Insulation and Finish System with Built In Moisture Drainage and an Air/Water-Resistive Barrier Designed Specifically for Residential Construction

DS106

Ooutsultation[®] RMD System[™] Installation Details

Table of Contents

Detail

SYSTEM 1 CUTAWAY	O-RMD 1
SYSTEM 1 CUTAWAY WITH STARTER BOARD	O-RMD 1a
SYSTEM 2 CUTAWAY	O-RMD 2
SYSTEM 2 CUTAWAY WITH STARTER BOARD	O-RMD 2a
SYSTEM 3 CUTAWAY	O-RMD 3
SYSTEM 4 CUTAWAY	O-RMD 4
SYSTEM 4 CUTAWAY WITH STARTER BOARD	O-RMD 4a
SYSTEM 5 CUTAWAY	O-RMD 5
SYSTEM 5 CUTAWAY WITH STARTER BOARD	O-RMD 5a
FASTENING PATTERNS	O-RMD 6
OPENING PREPARATION - SHEET TYPE WATER-RESISTIVE BARRIER	O-RMD 7
OPENING PREPARATION - SYSTEM 4 AQUAFASH® SYSTEM OPTION	O-RMD 8
OPENING PREPARATION - SYSTEM 4 BACKSTOP® NTX™ OR TREMCO EXOAIR 230 OPTION	O-RMD 9
INSIDE/OUTSIDE CORNERS	O-RMD 10
OUTSIDE CORNER - HIGH IMPACT	O-RMD 11
GRADE TERMINATION	O-RMD 12
TERMINATION AT CONCRETE CURB	O-RMD 13
EPS PREPARATION AT WALL PENETRATIONS	O-RMD 14
WINDOW ELEVATION	O-RMD 15
FLANGED AND STOREFRONT WINDOW/DOOR HEAD	O-RMD 16
WINDOW/DOOR HEAD WITH J-TRACK OPTION	O-RMD 17
DOOR HEAD WITH BRICK MOLD	O-RMD 18
SELF FLASHING WINDOW SILL - JAMB	O-RMD 19
STOREFRONT WINDOW SILL - JAMB	O-RMD 20
TERMINATION AT WOOD FRAMED DECK	O-RMD 21
TERMINATION AT PARAPET - CAP FLASHING	O-RMD 22
TERMINATION AT PARAPET - SOLID SUBSTRATE	O-RMD 23
TERMINATION AT SLOPED ROOF	O-RMD 24
TERMINATION AT ROOF STOP FLASHING	O-RMD 25
CHIMNEY ENCLOSURE	O-RMD 26
SOFFIT TERMINATION	O-RMD 27
SOFFIT TERMINATION WITH FRIEZE BOARD	O-RMD 28
VERTICAL WALL / SUSPENDED SOFFIT TRANSITION	O-RMD 29
TRANSITION AT SOFFIT/ FASCIA INTERSECTION	O-RMD 30
FASCIA/ UNINSULATED SOFFIT TRANSITION	O-RMD 31
TERMINATION AT UNINSULATED SOFFIT VENT	O-RMD 32
GABLE END	O-RMD 33
GABLE END WITH WOOD TRIM	O-RMD 34

Detail

HORIZONTAL JOINT AT FLOOR LINE	O-RMD 35
CONCEALED FLOOR LINE EXPANSION JOINT	O-RMD 36
VERTICAL EXPANSION JOINT - EIFS	O-RMD 37
HORIZONTAL TERMINATION AT STONE VENEER	O-RMD 38
VERTICAL TERMINATION AT STONE VENEER	O-RMD 39
PENETRATIONS	O-RMD 40
SHUTTER & DOWNSPOUT ATTACHMENT	O-RMD 41
AESTHETIC REVEALS	O-RMD 42
EPS SHAPES	O-RMD 43
SEALANT CONFIGURATION OPTIONS	O-RMD 44

NOTE:

DRYVIT MAKES NO REPRESENTATION REGARDING CONFORMITY OF ITS SUGGESTIONS TO MODEL BUILDING CODES, ENGINEERING CRITERIA, SPECIFIC APPLICATIONS, OR PROJECT LOCATIONS. ALL COMPONENTS INDICATED IN ILLUSTRATIONS, AS WELL AS OTHERS THAT MAY BE REQUIRED FOR THE INTEGRITY OF THE SYSTEM SHALL BE DESIGNED, DETAILED, AND ENGINEERED BY REPRESENTATIVES OF THE ARCHITECT, OWNER, OR CONTRACTOR TO BE IN CONFORMANCE WITH MODEL CODES, ARCHITECTURAL, AND ENGINEERING REQUIREMENTS PERTAINING TO SPECIFIC BUILDING PROJECTS.

DRYVIT MAKES NO WARRANTY, EXPRESSED OR IMPLIED, AS TO THE ARCHITECTURAL DESIGN, ENGINEERING, OR WORKMANSHIP OF PROJECTS UTILIZING DRYVIT SYSTEMS OR PRODUCTS.

THE LIABILITIES OF DRYVIT SHALL BE AS STATED IN THE DRYVIT STANDARD WARRANTY. CONTACT DRYVIT FOR A FULL AND COMPLETE COPY OF THE WARRANTY.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™



Dryvit Technical Support: 800-556-7752

Detail: Table of Contents

Drawn by: HDE

Checked by: CS

Scale: NTS

Date: 5/25/2023

File Name:


Table of Contents




Construction Products Group

www.tremcocpg.com

**EIMA CLASS I
(STANDARD IMPACT)**

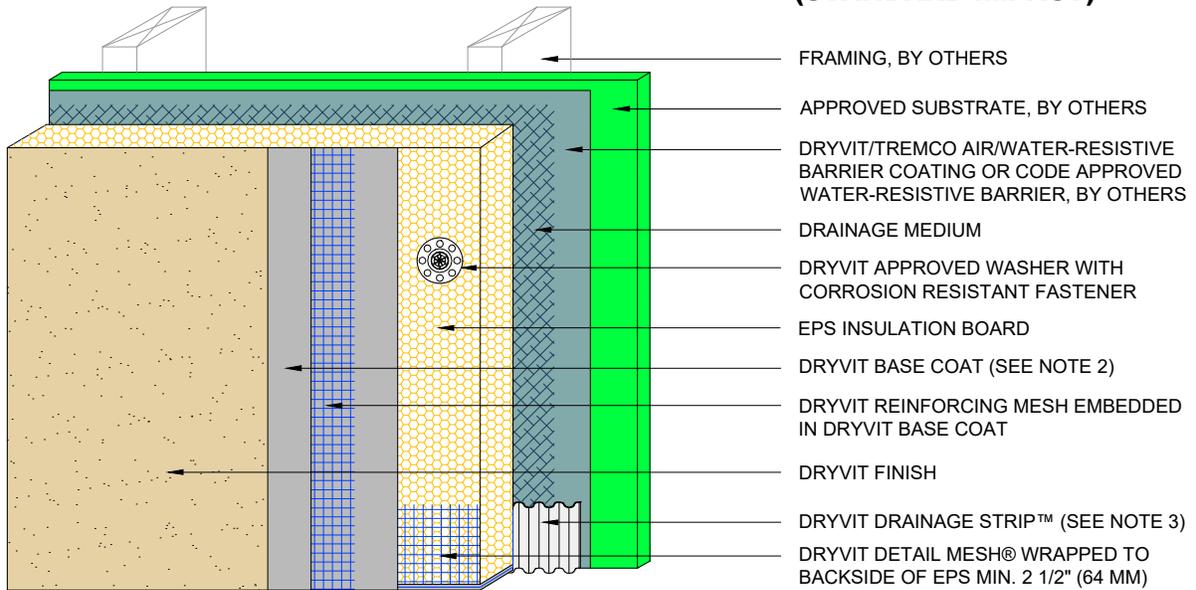

**EIMA CLASS IV
(ULTRA-HIGH IMPACT)**

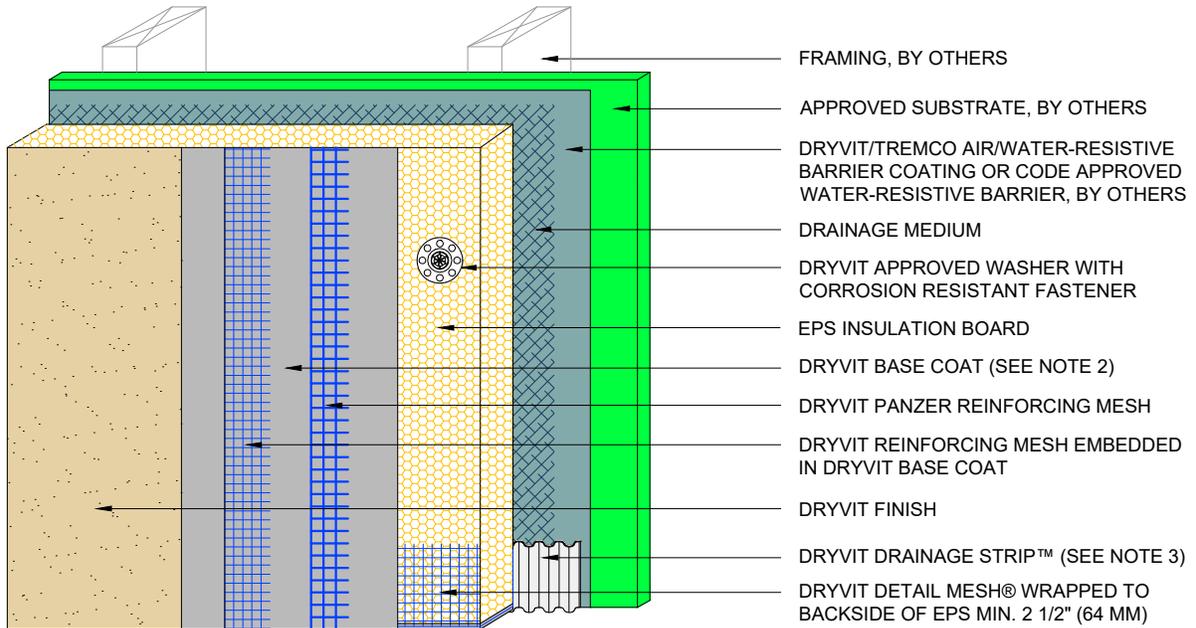

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
3. DRYVIT DRAINAGE TRACK IS AN ALTERNATE OPTION IN LIEU OF THE DRYVIT DRAINAGE STRIP. HOWEVER, IF PROJECT IS DEFINED AS NON-COMBUSTIBLE, DRAINAGE TRACK USAGE IS LIMITED TO THE BASE OF THE SYSTEM AT FINISHED GRADE LEVEL. WHEN USING DRAINAGE TRACK, BACK OF EPS WILL NEED TO BE NOTCHED TO ACCOMMODATE THE DRYVIT DRAINAGE MAT AND WATER-RESISTIVE BARRIER.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™



Dryvit Technical Support: 800-556-7752

Detail: System 1 Cutaway

Drawn by: HDE

Checked by: CS

Scale: NTS

Date: 5/19/2023

File Name:


O-RMD 1



Construction Products Group

www.tremcocpg.com

**EIMA CLASS I
(STANDARD IMPACT)**

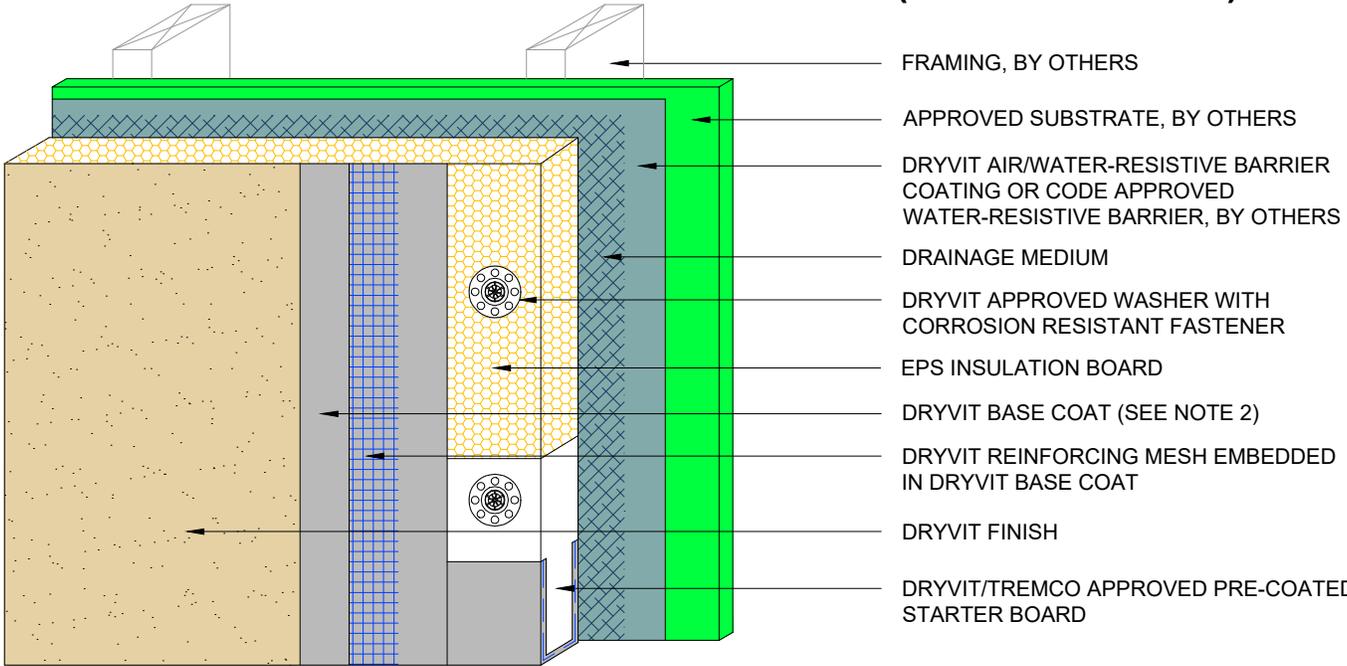


- FRAMING, BY OTHERS
- APPROVED SUBSTRATE, BY OTHERS
- DRYVIT AIR/WATER-RESISTIVE BARRIER COATING OR CODE APPROVED WATER-RESISTIVE BARRIER, BY OTHERS
- DRAINAGE MEDIUM
- DRYVIT APPROVED WASHER WITH CORROSION RESISTANT FASTENER
- EPS INSULATION BOARD
- DRYVIT BASE COAT (SEE NOTE 2)
- DRYVIT REINFORCING MESH EMBEDDED IN DRYVIT BASE COAT
- DRYVIT FINISH
- DRYVIT/TREMCO APPROVED PRE-COATED STARTER BOARD

- NOTE:
1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
 2. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.


Outsulation® RMD System™

 Dryvit Technical Support: 800-556-7752	Detail: System 1 Cutaway with Starter Board				File Name:		 Construction Products Group
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 1a		
www.tremcocpg.com							

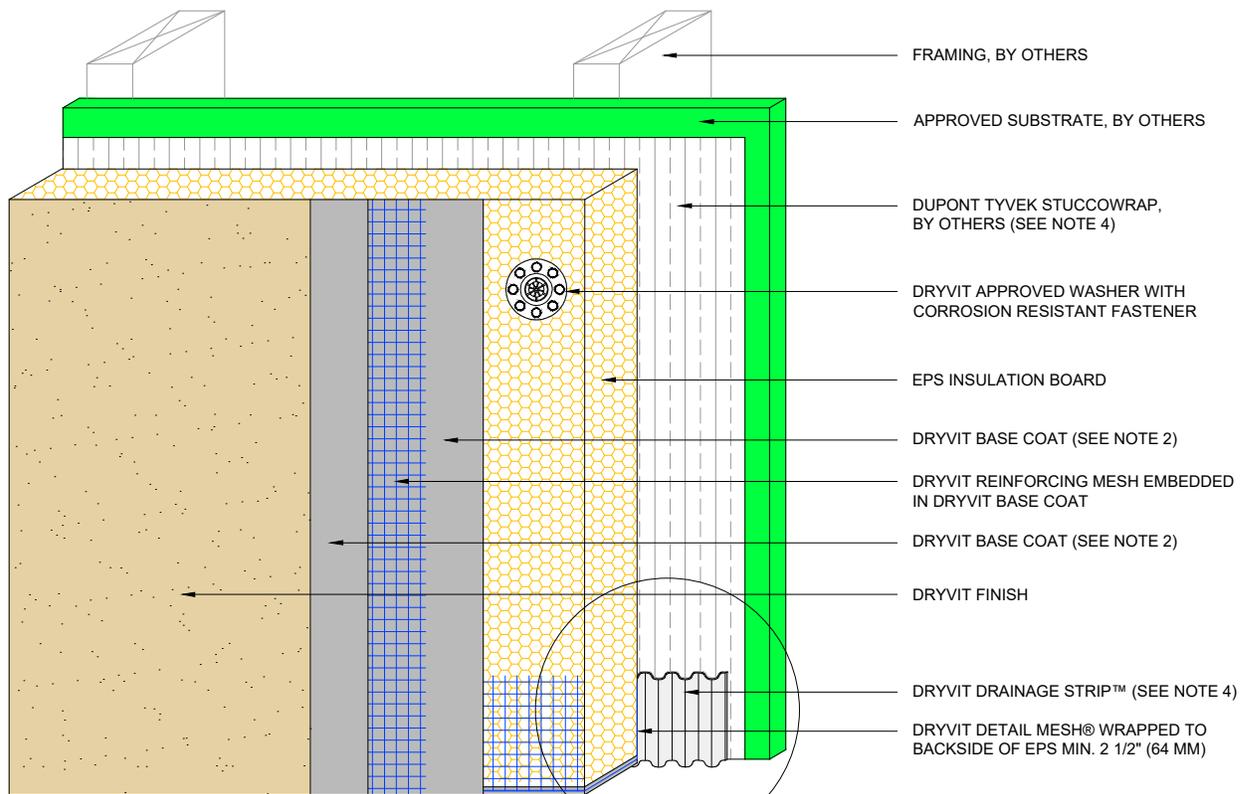

**DUPONT® TYVEK®
STUCCOWRAP™ OPTION
(SYSTEM 2)**

**DRAINAGE TRACK
OPTION (SEE NOTE 3)**

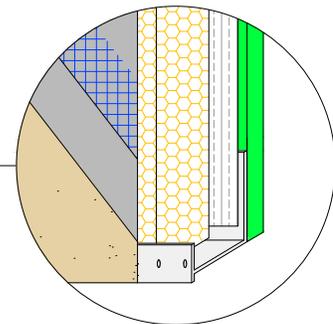

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. THE BASE COAT SHALL BE GENESIS® OR GENESIS DM FOR MECHANICALLY FASTENED SYSTEMS 1, 2, 3.
3. IF PROJECT IS DEFINED AS NON-COMBUSTIBLE, DRAINAGE TRACK USAGE IS LIMITED TO THE BASE OF THE SYSTEM AT FINISHED GRADE LEVEL.
4. DRYVIT DRAINAGE STRIP IS REQUIRED WHEN USING STUCCOWRAP WITHOUT A DRAINAGE TRACK.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™



Dryvit Technical Support: 800-556-7752

Detail: System 2 Cutaway

Drawn by: HDE

Checked by: CS

Scale: NTS

Date: 5/19/2023


File Name:

O-RMD 2



Construction Products Group

www.tremcocpg.com

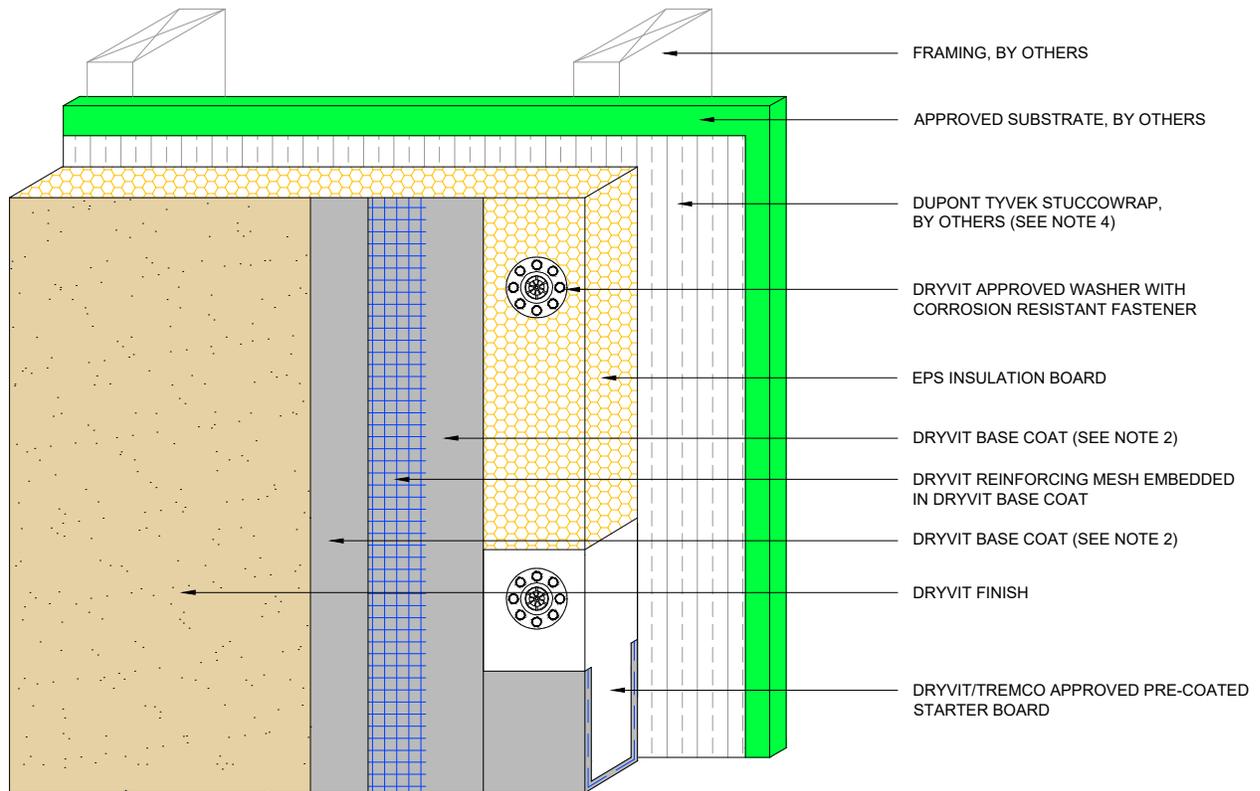

**DUPONT® TYVEK®
STUCCOWRAP™ OPTION
(SYSTEM 2)**

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. THE BASE COAT SHALL BE GENESIS® OR GENESIS DM FOR MECHANICALLY FASTENED SYSTEMS 1, 2, 3.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™



Dryvit Technical Support: 800-556-7752

Detail: System 2 Cutaway with Starter Board

Drawn by: HDE

Checked by: CS

Scale: NTS

Date: 5/19/2023


File Name:

O-RMD 2a





Construction Products Group

www.tremcocpg.com

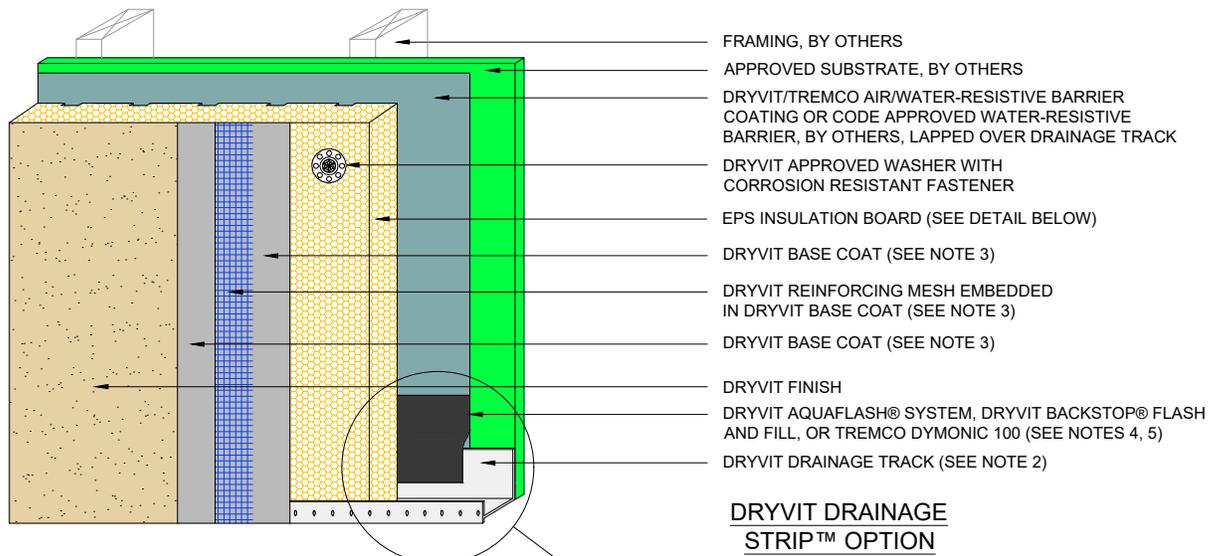

GROOVED INSULATION BOARD OPTION (SYSTEM 3)

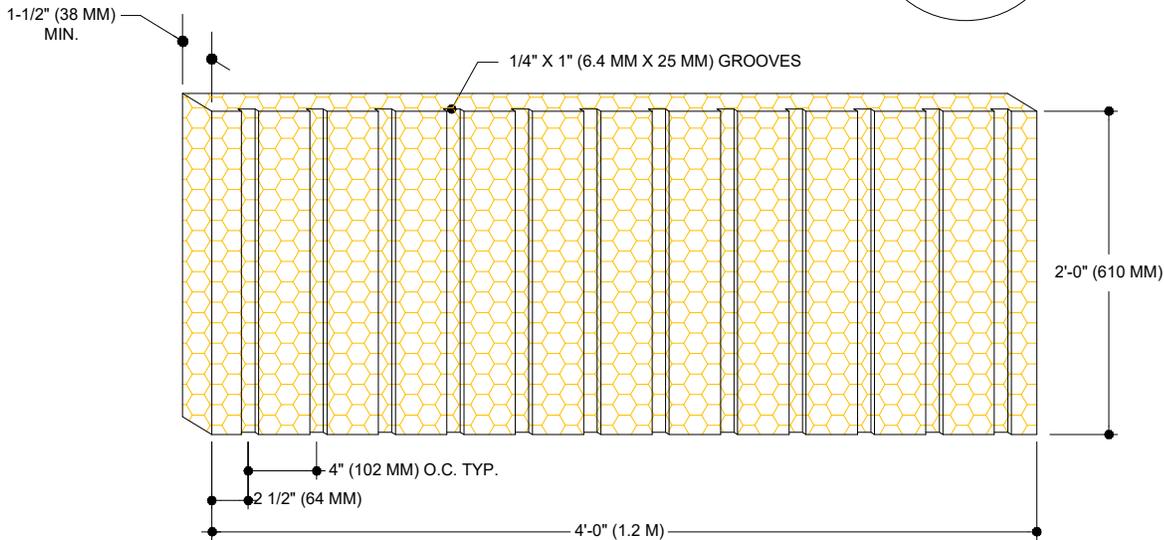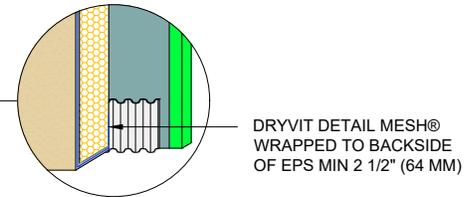

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. IF PROJECT IS DEFINED AS NON-COMBUSTIBLE, DRAINAGE TRACK USAGE IS LIMITED TO THE BASE OF THE SYSTEM AT FINISHED GRADE LEVEL.
3. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
4. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
5. BAKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™



Dryvit Technical Support: 800-556-7752

Detail: System 3 Cutaway

Drawn by: HDE

Checked by: CS

Scale: NTS

Date: 5/19/2023


File Name:

O-RMD 3



Construction Products Group

www.tremcocpg.com

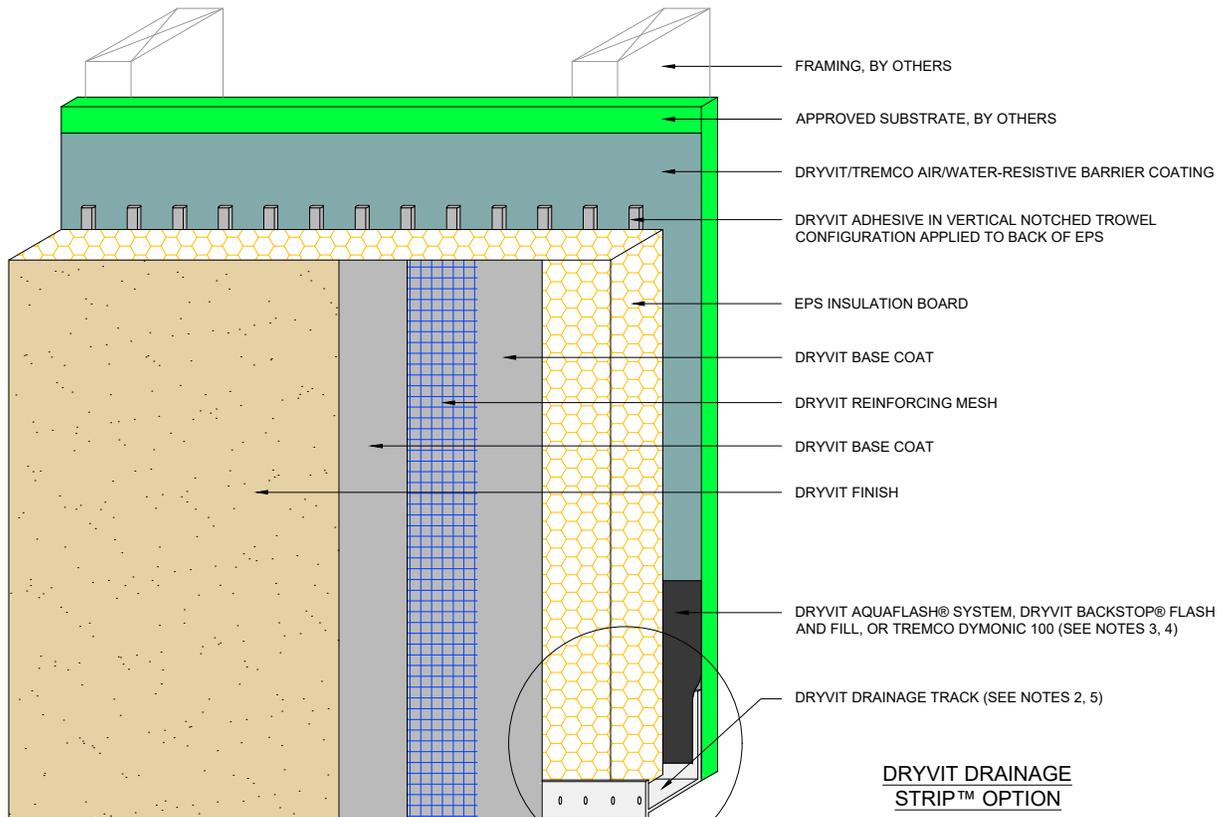

**NOTCHED TROWEL ADHESIVE OPTION
(SYSTEM 4)**

**DRYVIT DRAINAGE
STRIP™ OPTION**

DRYVIT DETAIL MESH® WRAPPED TO BACKSIDE OF EPS MIN 2 1/2" (64 MM)

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. IF PROJECT IS DEFINED AS NON-COMBUSTIBLE, DRAINAGE TRACK USAGE IS LIMITED TO THE BASE OF THE SYSTEM AT FINISHED GRADE LEVEL.
3. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
4. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.
5. LIGHTLY SAND SURFACE OF DRAINAGE TRACK TO MAXIMIZE ADHESION.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™



Dryvit Technical Support: 800-556-7752

Detail: System 4 Cutaway

Drawn by: HDE

Checked by: CS

Scale: NTS

Date: 5/19/2023


File Name:

O-RMD 4



Construction Products Group

www.tremcocpg.com

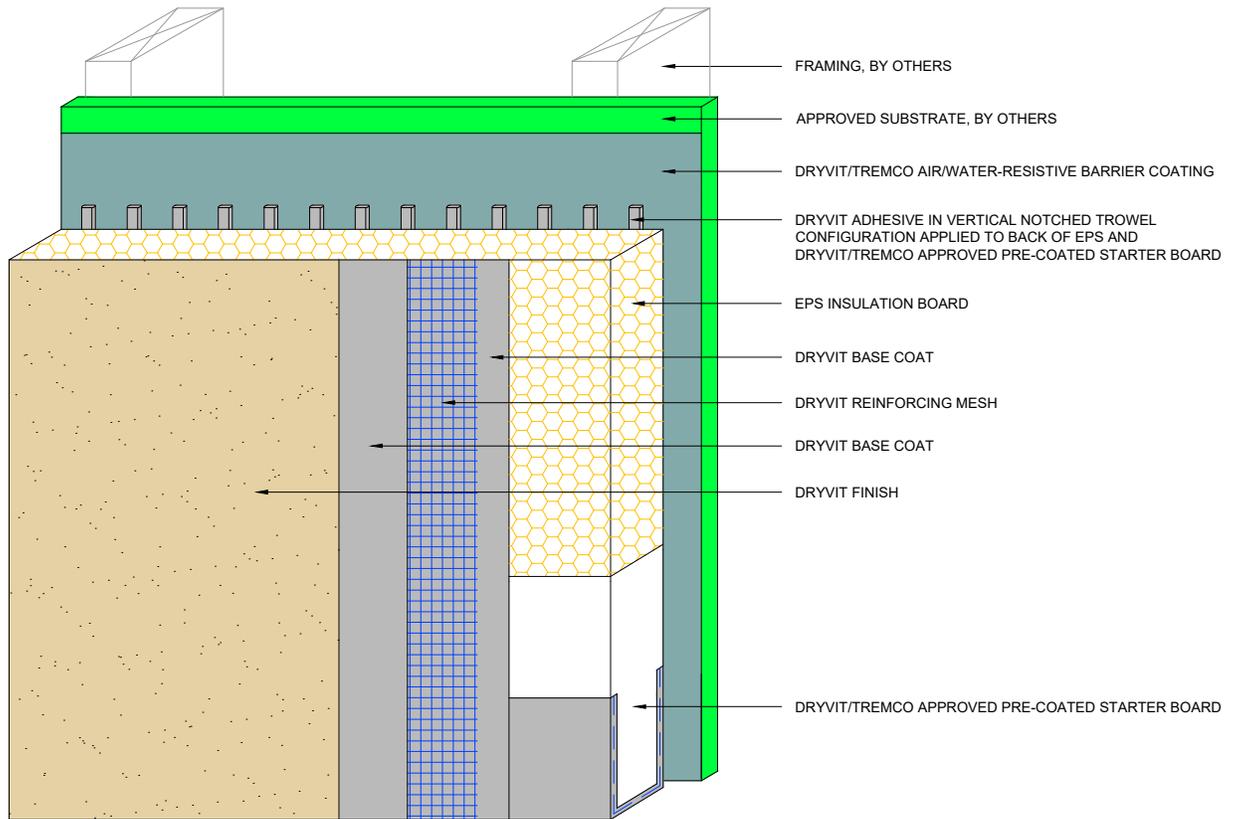

**NOTCHED TROWEL ADHESIVE OPTION
(SYSTEM 4)**


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. IF PROJECT IS DEFINED AS NON-COMBUSTIBLE, DRAINAGE TRACK USAGE IS LIMITED TO THE BASE OF THE SYSTEM AT FINISHED GRADE LEVEL.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.


Outsulation® RMD System™

 Dryvit Technical Support: 800-556-7752	Detail: System 4 Cutaway with Starter Board				File Name:		 Construction Products Group
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 4a		
www.tremcocpg.com							

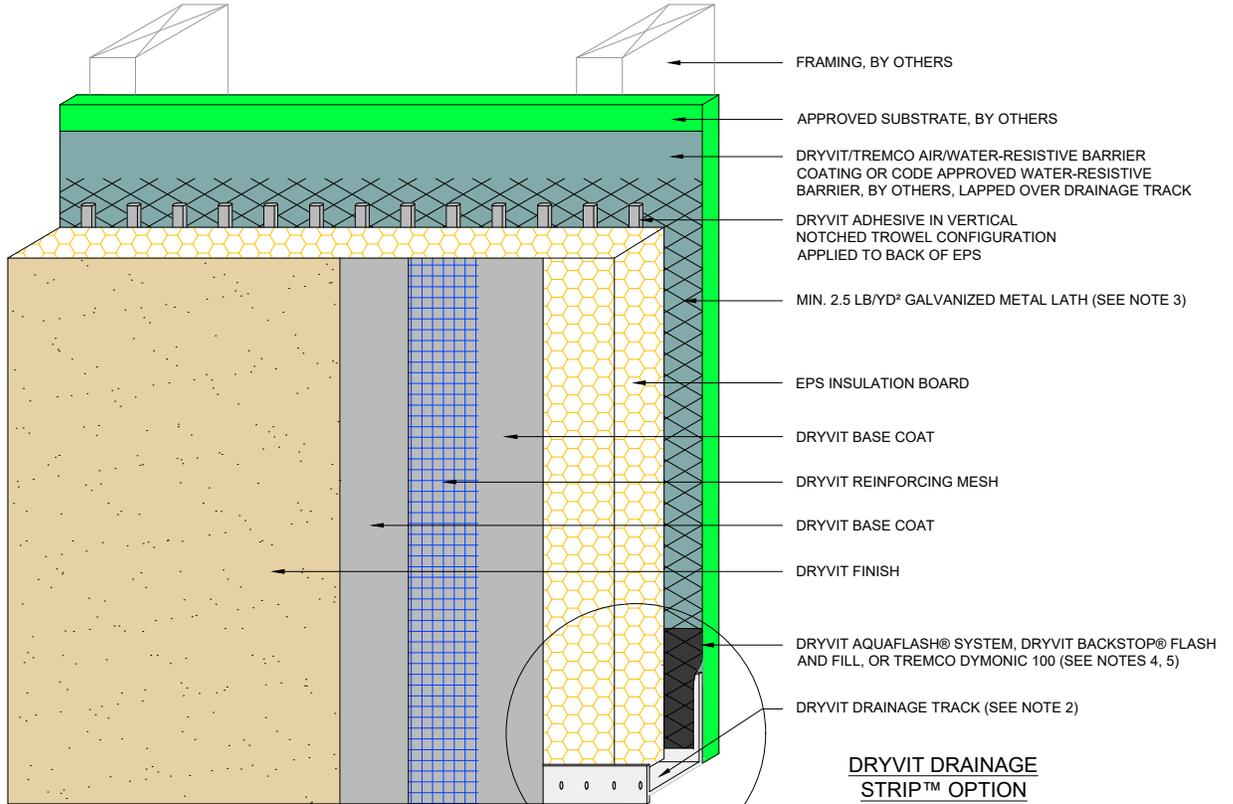

**EXPANDED METAL LATH OPTION
(SYSTEM 5)**

**DRYVIT DRAINAGE
STRIP™ OPTION**



DRYVIT DETAIL MESH® WRAPPED TO BACKSIDE OF EPS MIN 2 1/2" (64 MM)


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. IF PROJECT IS DEFINED AS NON-COMBUSTIBLE, DRAINAGE TRACK USAGE IS LIMITED TO THE BASE OF THE SYSTEM AT FINISHED GRADE LEVEL.
3. EXPANDED METAL LATH IS NOT RECOMMENDED FOR USE IN COASTAL AREAS AND OTHER CORROSIVE ENVIRONMENTS.
4. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
5. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

 Dryvit Technical Support: 800-556-7752	Detail: System 5 Cutaway				File Name:		 Construction Products Group
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 5		
www.tremcocpg.com							

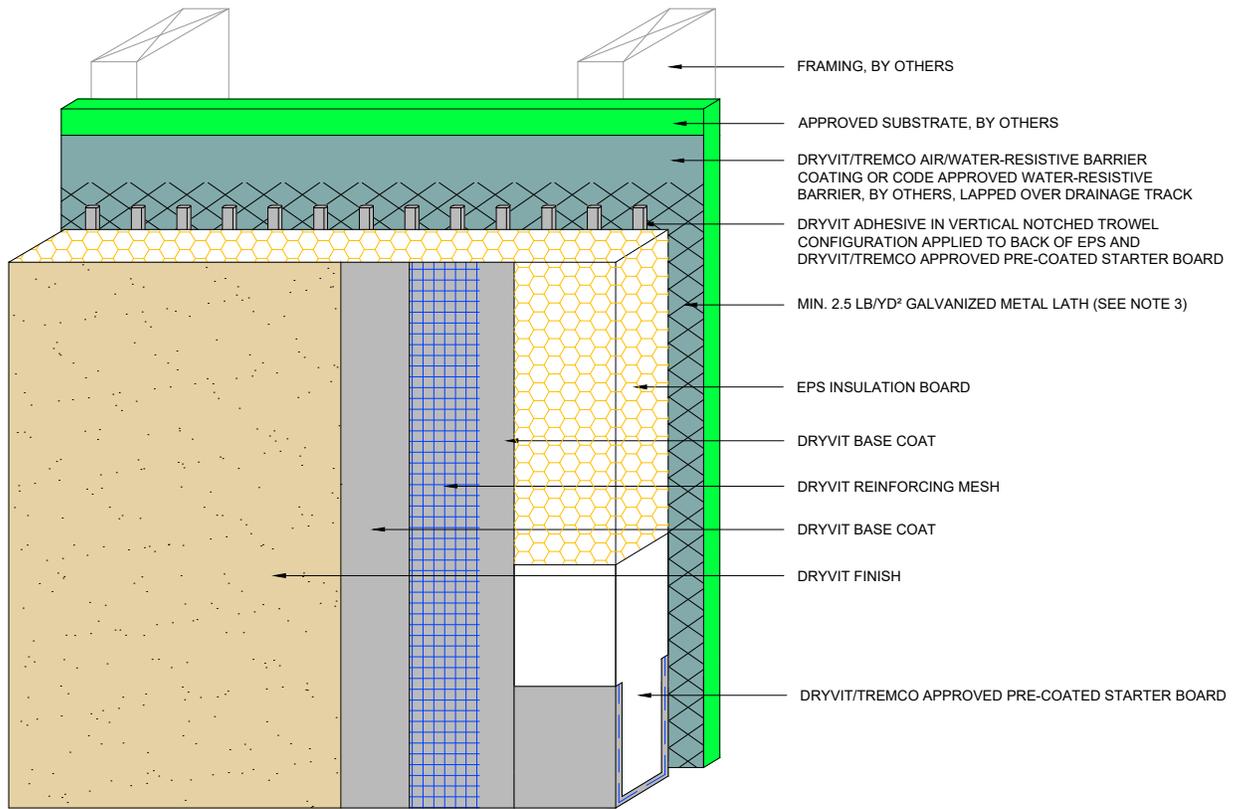

**EXPANDED METAL LATH OPTION
(SYSTEM 5)**


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. IF PROJECT IS DEFINED AS NON-COMBUSTIBLE, DRAINAGE TRACK USAGE IS LIMITED TO THE BASE OF THE SYSTEM AT FINISHED GRADE LEVEL.
3. EXPANDED METAL LATH IS NOT RECOMMENDED FOR USE IN COASTAL AREAS AND OTHER CORROSIVE ENVIRONMENTS.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

 Dryvit Technical Support: 800-556-7752	Detail: System 5 Cutaway with Starter Board				File Name:		 Construction Products Group
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 5a		
www.tremcocpg.com							

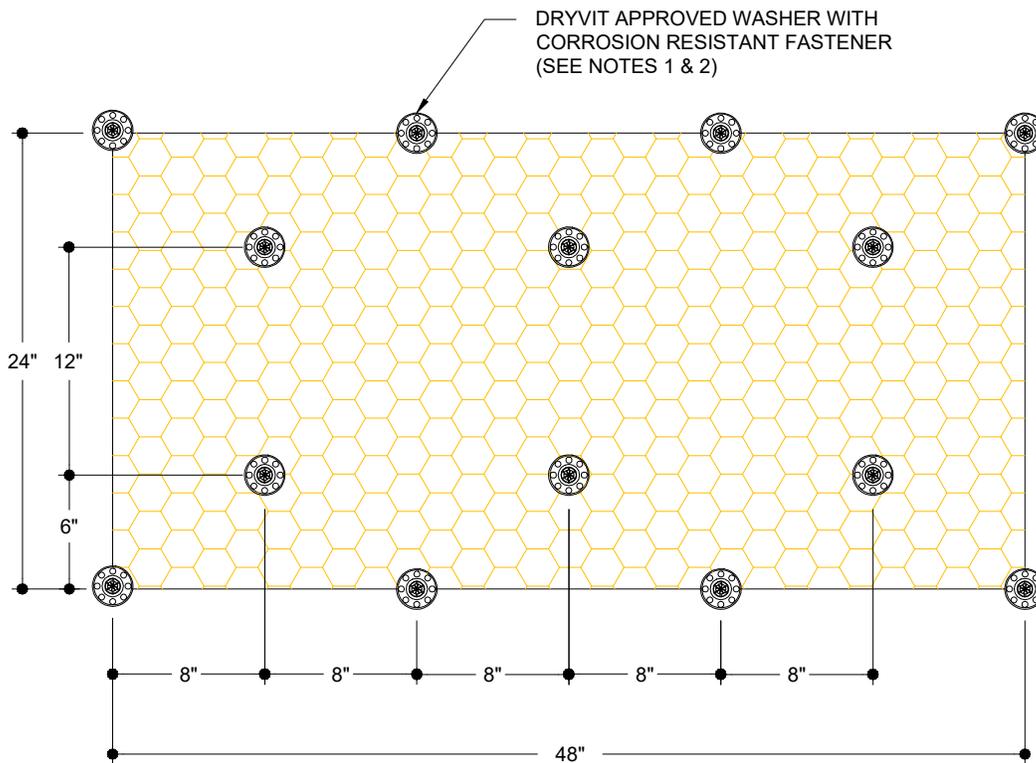

NOTE:

1. MAXIMUM WIND LOAD PRESSURE IS DEPENDENT ON WASHER/FASTENER TYPE, PATTERN AND INSULATION BOARD THICKNESS. REFER TO WASHER/FASTENER MANUFACTURER FOR ALTERNATE PATTERNS. REFER TO DRYVIT PUBLICATION DS135 FOR WIND LOAD DATA.
2. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™



Dryvit Technical Support: 800-556-7752

Detail: Fastening Pattern for System 1-3

Drawn by: HDE

Checked by: CS

Scale: NTS

Date: 5/19/2023


File Name:

O-RMD 6




Construction Products Group


www.tremcocpg.com

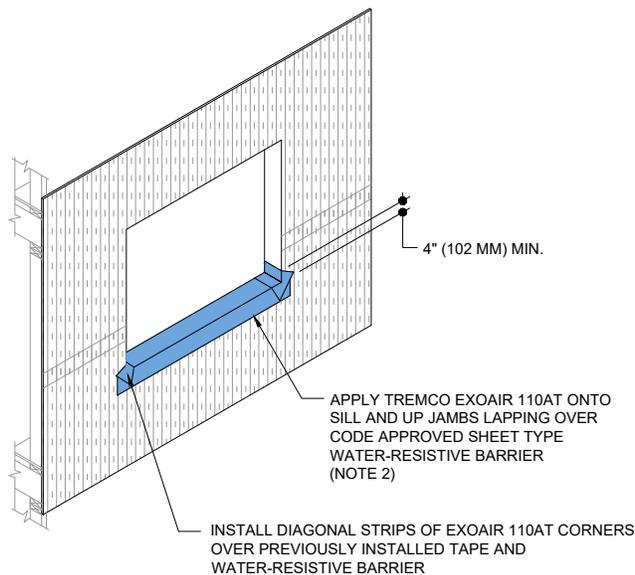

STEP #1

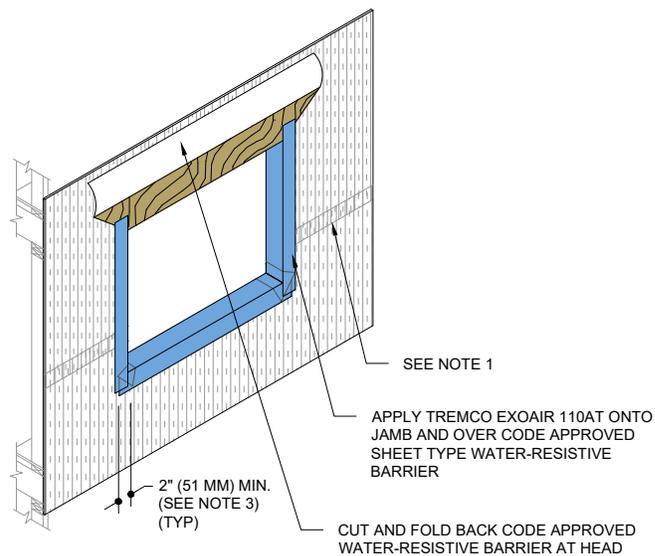

STEP #2

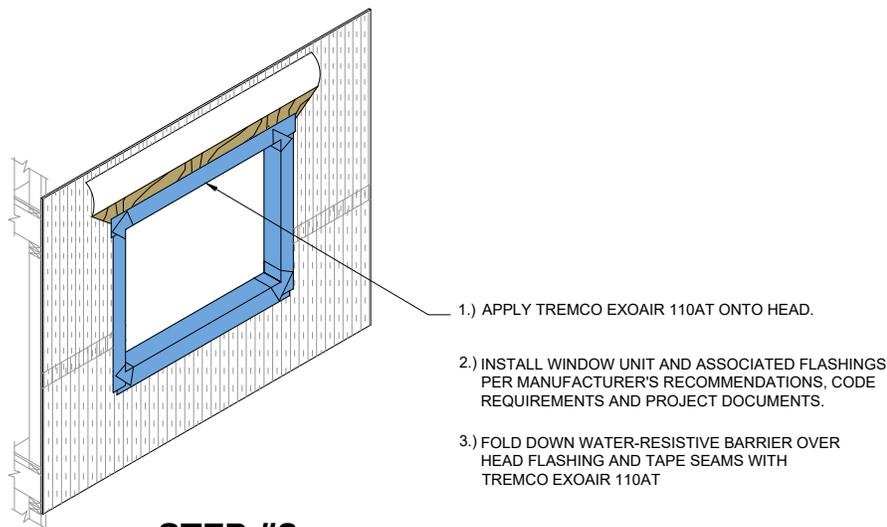

STEP #3

NOTE:

1. SHEET TYPE CODE APPROVED WATER-RESISTIVE BARRIER SHALL BE INSTALLED IN A WEATHER BOARD FASHION IN ACCORDANCE WITH CODE AND MANUFACTURER'S REQUIREMENTS.
2. OPENING WRAP SHALL EXTEND TO INTERIOR FACE OF OPENING.
3. LAP TREMCO EXOAIR 110AT MINIMUM 2" (51 MM) OVER CURB.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™



Dryvit Technical Support: 800-556-7752

Detail: Opening Preparation - Sheet-Type Water-Resistive Barrier

Drawn by: HDE

Checked by: CS

Scale: NTS

Date: 5/19/2023


File Name:

O-RMD 7




Construction Products Group


www.tremcocpg.com

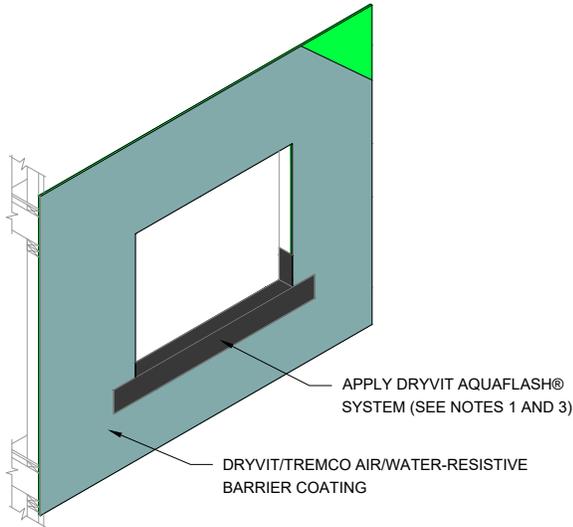


STEP #1

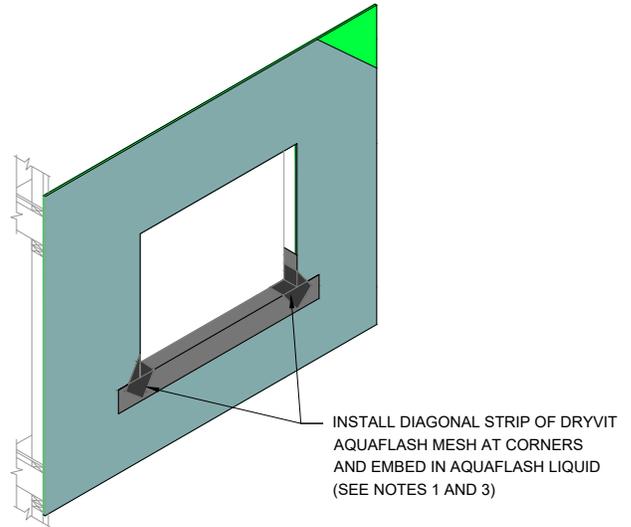

STEP #2

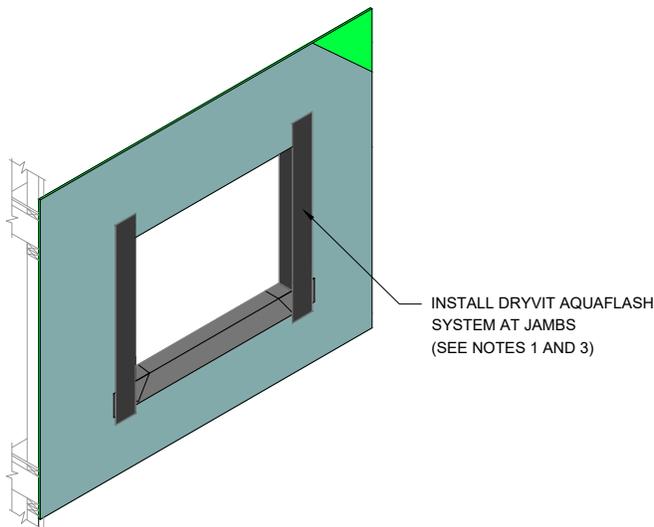

STEP #3

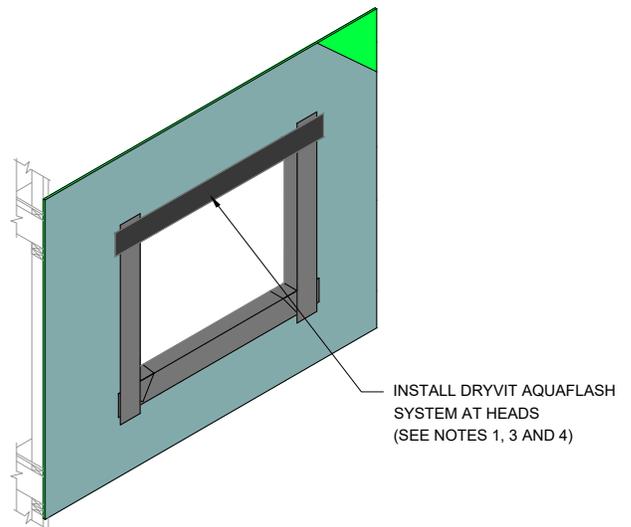

STEP #4

NOTE:

1. DRYVIT AQUAFLASH® SHALL EXTEND TO INTERIOR FACE OF OPENING.
2. REFER TO HEAD, SILL AND JAMB DETAILS FOR FLASHING INTEGRATION.
3. DRYVIT TREMCO EXOAIR 110AT MAY BE USED IN LIEU OF DRYVIT AQUAFLASH® SYSTEM. TREAT SURFACE WITH TREMCO DYMONIC 100 AT 40 MILS OVER EXOAIR 110AT AT FACE OF WALL WHERE IN CONTACT WITH ADHESIVE.
4. INSTALL WINDOW UNIT AND ASSOCIATED FLASHINGS PER MANUFACTURER'S RECOMMENDATIONS, CODE REQUIREMENTS AND PROJECT DOCUMENTS.
5. AQUAFLASH® SYSTEM CONSISTS OF AQUAFLASH MESH AND AQUAFLASH LIQUID.
6. FOR ADDITIONAL AIR/WATER-RESISTIVE BARRIER DETAILS, REFER TO DRYVIT PUBLICATION DS840.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™



Dryvit Technical Support: 800-556-7752

Detail: Opening Preparation - System 4 AquaFlash® System^s Option

Drawn by: HDE

Checked by: CS

Scale: NTS

Date: 5/19/2023


File Name:

O-RMD 8




Construction Products Group

www.tremcocpg.com

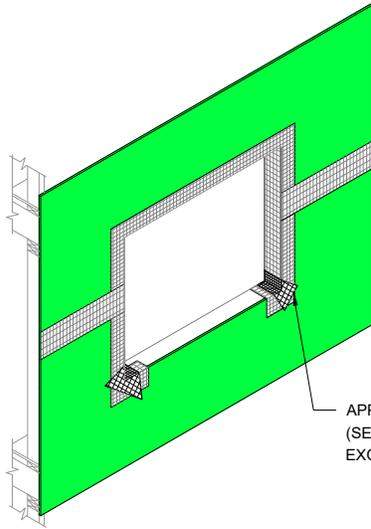

APPLY DRYVIT GRID TAPE™
(SEE NOTES 1, 2) OR TREMCO
EXOAIR 230 WITH TREMCO 2011 MESH


STEP #1

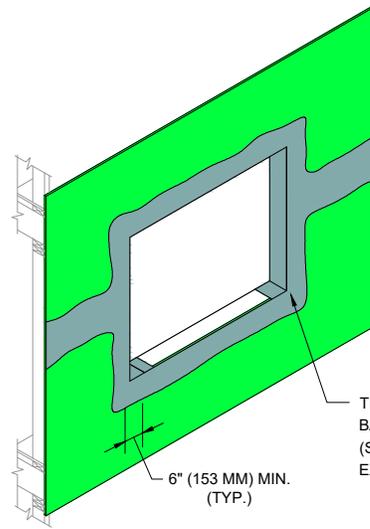

TROWEL APPLY DRYVIT
BACKSTOP NTX-TEXTURE
(SEE NOTE 2) OR TREMCO
EXOAIR 230

6" (153 MM) MIN.
(TYP.)


STEP #2

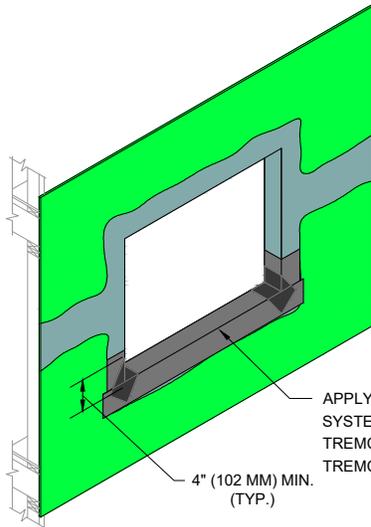

APPLY DRYVIT AQUAFLASH®
SYSTEM (SEE NOTES 2, 3, 5) OR
TREMCO EXOAIR 230 WITH
TREMCO 2011 MESH

4" (102 MM) MIN.
(TYP.)

STEP #3

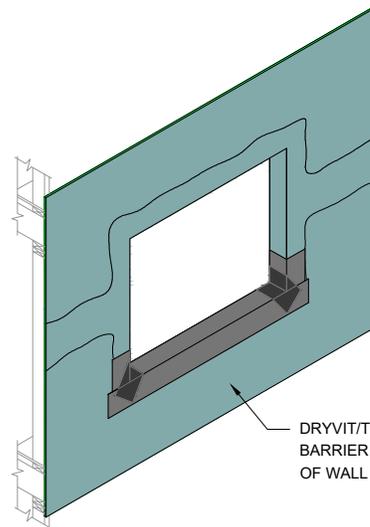

DRYVIT/TREMCO AIR/WATER-RESISTIVE
BARRIER COATING APPLIED TO FACE
OF WALL (SEE NOTE 5)

STEP #4

NOTE:

1. APPLY DRYVIT GRID TAPE OR TREMCO EXOAIR 230 WITH TREMCO 2011 MESH ON HEAD, JAMB, AND CORNERS OF OPENINGS AND SHEATHING JOINTS.
2. TROWEL APPLY DRYVIT BACKSTOP NTX-TEXTURE OVER THE DRYVIT GRID TAPE OR TREMCO EXOAIR 230 WITH TREMCO 2011 MESH ALL THE WAY TO INSIDE FACE OF OPENING. ALL VOIDS MUST BE FILLED; MULTIPLE PASSES MAY BE REQUIRED. AS AN OPTION, DRYVIT GRID TAPE AND DRYVIT BACKSTOP NTX-TEXTURE MAY ALSO BE APPLIED AT THE SILL PRIOR TO DRYVIT AQUAFLASH SYSTEM OR TREMCO EXOAIR 110AT APPLICATION.
3. TREMCO EXOAIR 110AT MAY BE USED IN LIEU OF DRYVIT AQUAFLASH SYSTEM AT SILL, INCLUDING CORNER SPLICES. TREAT SURFACE WITH TREMCO DYMONIC 100 AT 40 MILS OVER EXOAIR 110AT AT FACE OF WALL WHERE IN CONTACT WITH ADHESIVE.
4. INSTALL WINDOW UNIT AND ASSOCIATED FLASHINGS PER MANUFACTURER'S RECOMMENDATIONS, CODE REQUIREMENTS AND PROJECT DOCUMENTS.
5. REFER TO HEAD, SILL, AND JAMB DETAILS FOR FLASHING INTEGRATION.
6. FOR ADDITIONAL AIR/WATER-RESISTIVE BARRIER DETAILS, REFER TO DRYVIT PUBLICATION DS840.
7. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™



Dryvit Technical Support: 800-556-7752

Detail: Opening Preparation - System 4 Backstop® NTX™ or Tremco ExoAir 230 Option

Drawn by: HDE

Checked by: CS

Scale: NTS

Date: 5/19/2023



File Name:

O-RMD 9



Construction Products Group

www.tremcocpg.com

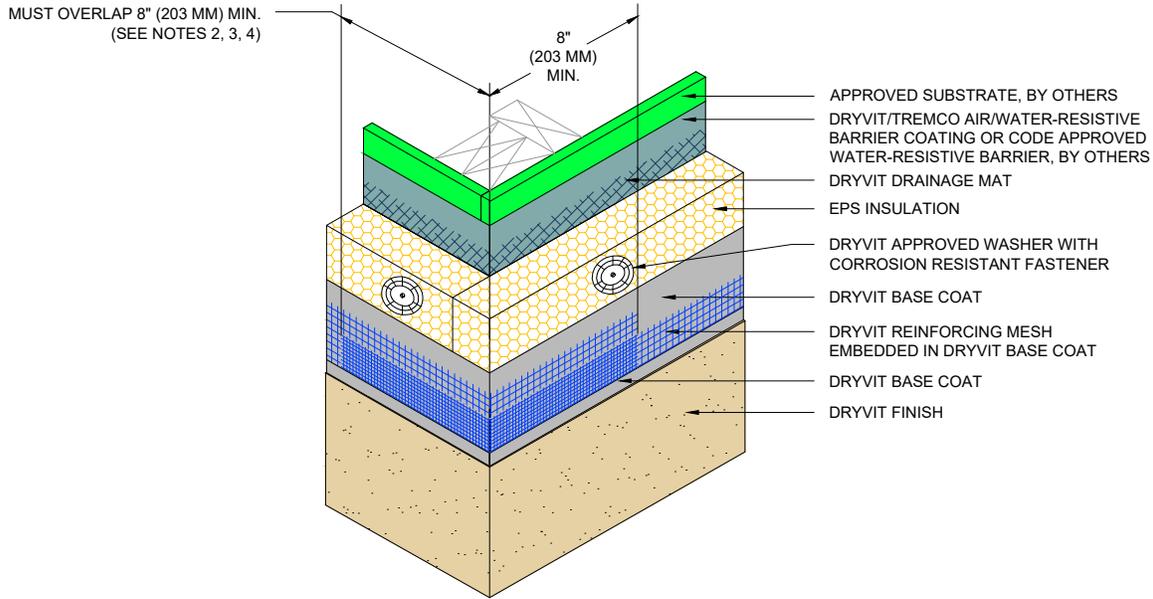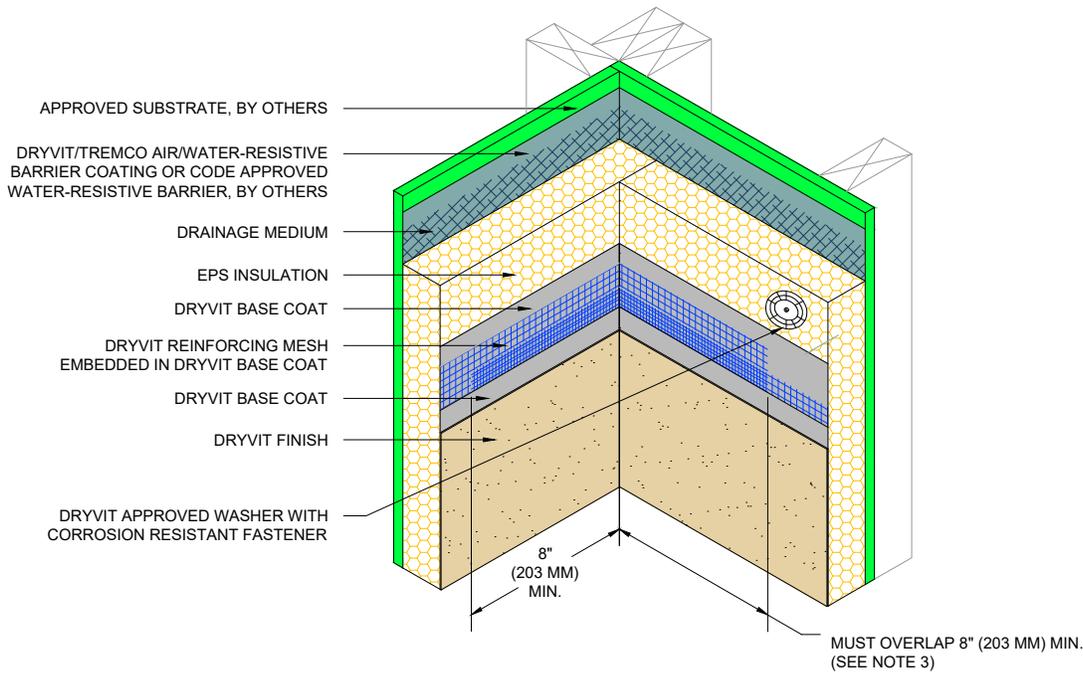


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. DOUBLE WRAP OUTSIDE CORNERS WITH REINFORCING MESH OR USE CORNER MESH.
3. DO NOT LAP REINFORCING MESH WITHIN 8" (203 MM) OF A CORNER.
4. OUTSIDE INSULATION BOARD EDGES SHALL BE OFFSET.
5. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
6. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

 Dryvit Technical Support: 800-556-7752	Detail: Inside/Outside Corners				File Name:		 Construction Products Group
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 10		
www.tremcocpg.com							

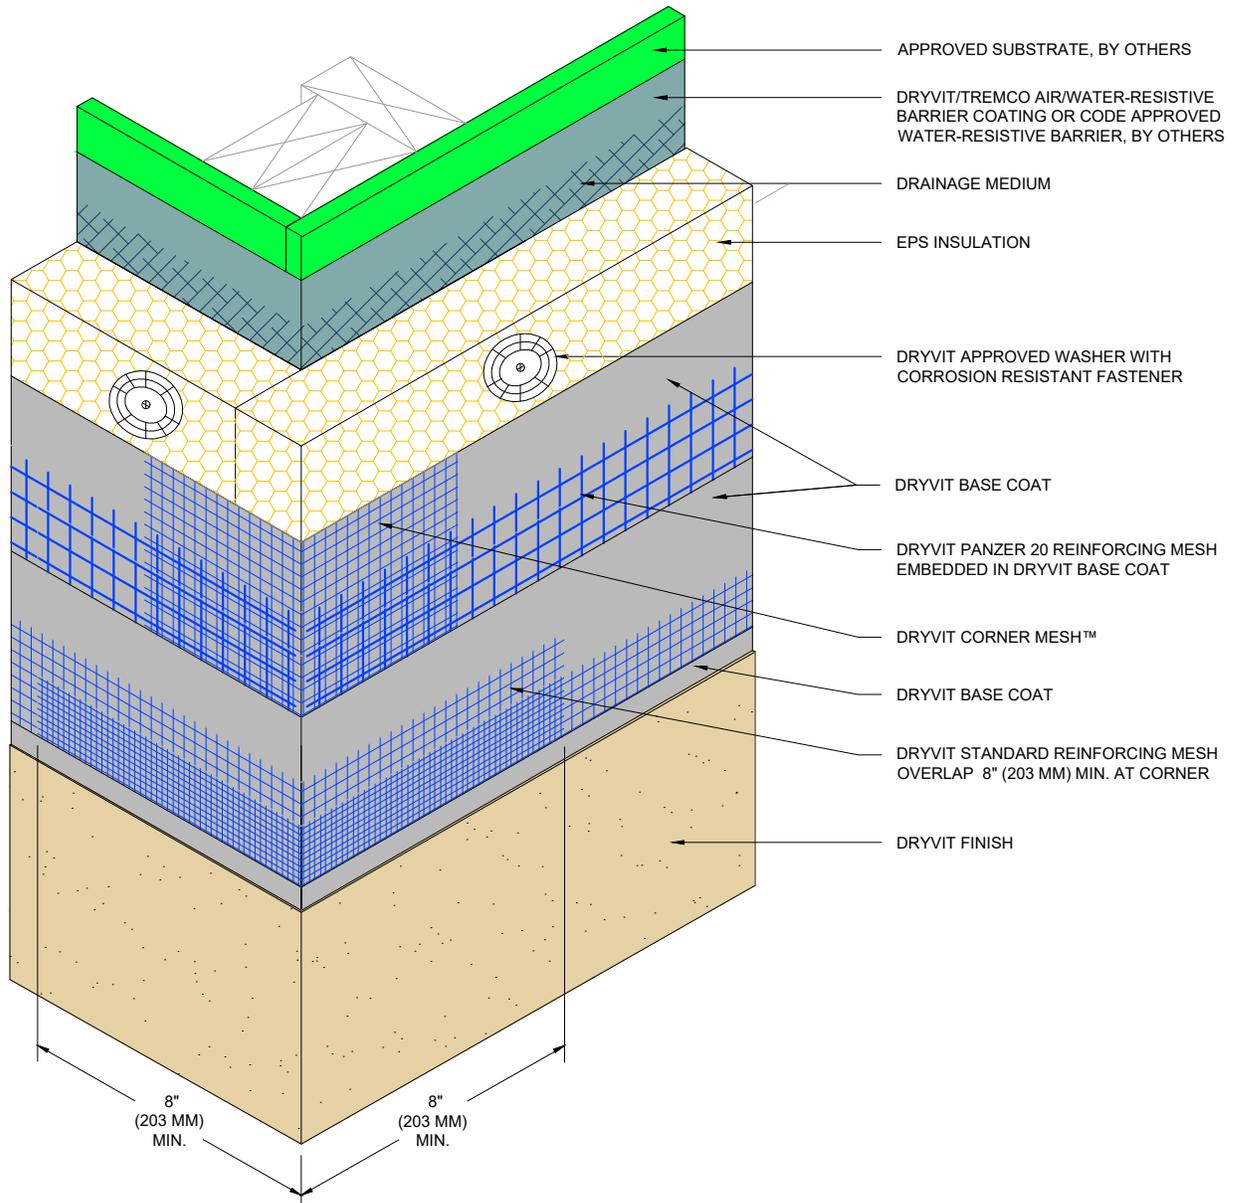

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. OUTSIDE INSULATION BOARD EDGES SHALL BE OFFSET.
3. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
4. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™



Dryvit Technical Support: 800-556-7752

Detail: Outside Corner - High Impact

Drawn by: HDE

Checked by: CS

Scale: NTS

Date: 5/19/2023


File Name:

O-RMD 11




Construction Products Group

www.tremcocpg.com

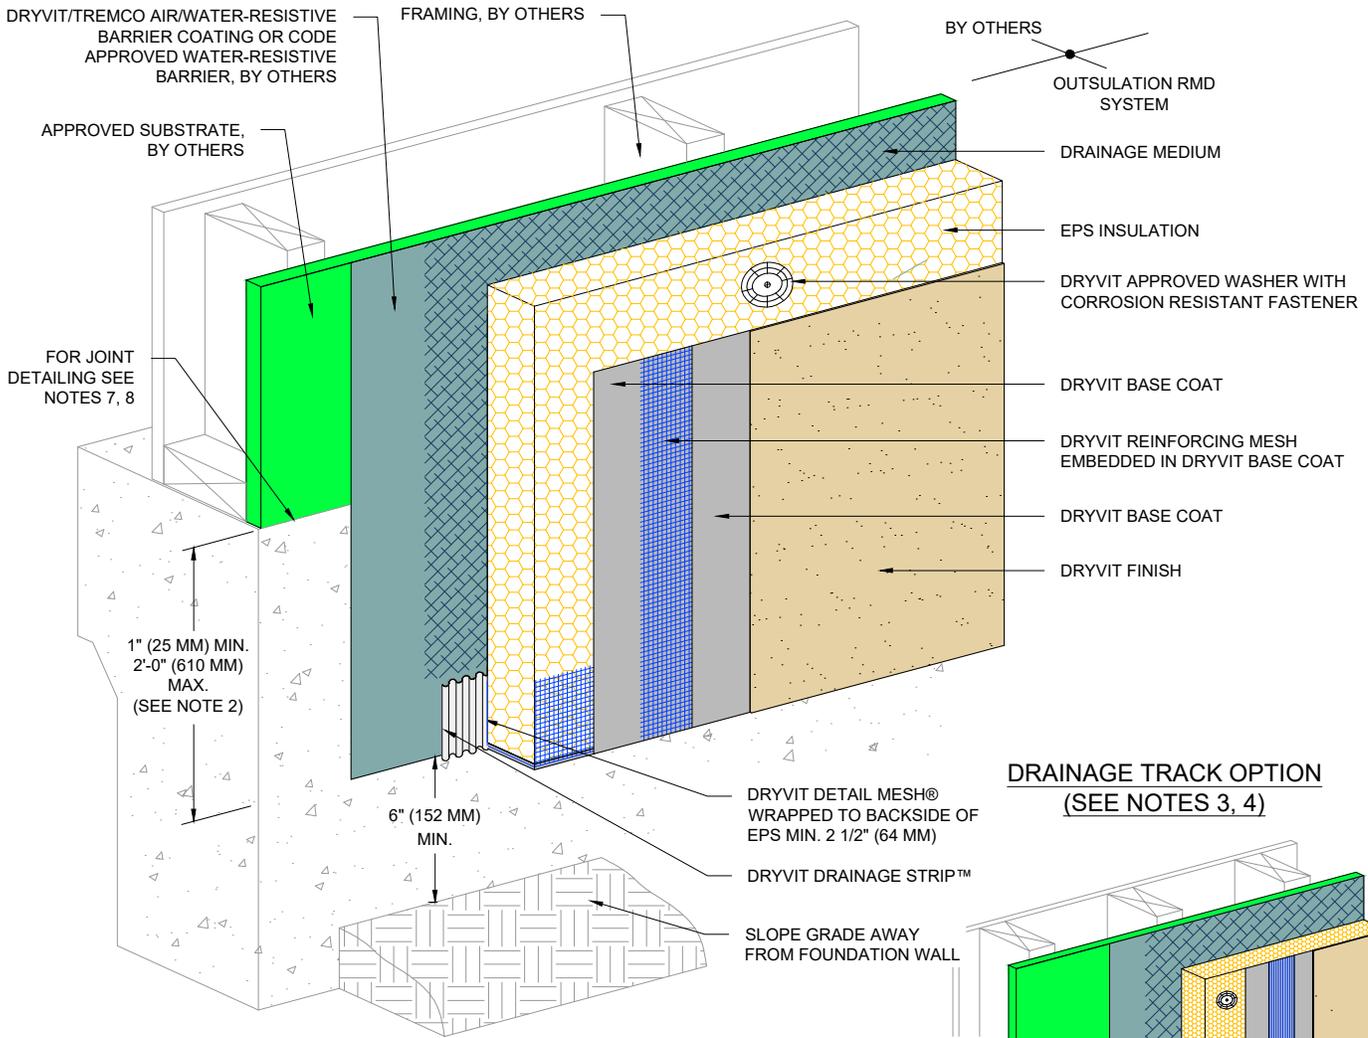

DRAINAGE TRACK OPTION
(SEE NOTES 3, 4)

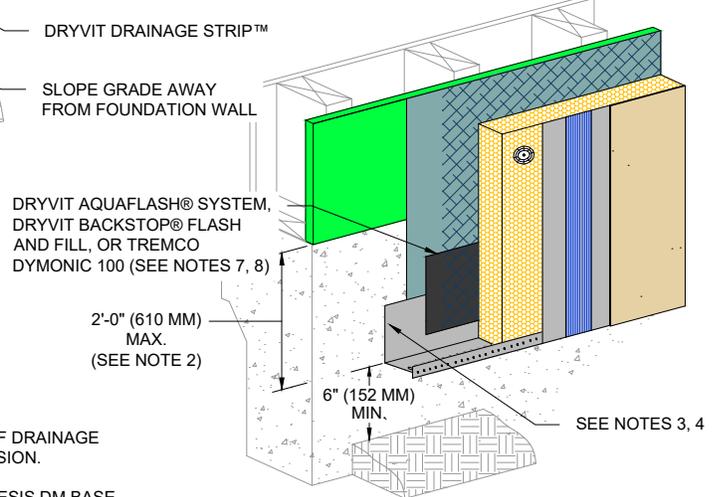

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS® MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. EXPANSION JOINT IS REQUIRED ALONG TOP OF FOUNDATION IF 2'-0" (610 MM) DIMENSION IS EXCEEDED.
3. IF PROJECT IS DEFINED AS NON-COMBUSTIBLE, DRAINAGE TRACK USAGE IS LIMITED TO THE BASE OF THE SYSTEM AT FINISHED GRADE LEVEL.
4. LIGHTLY SAND SURFACE OF DRAINAGE TRACK TO MAXIMIZE ADHESION.
5. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
6. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
7. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
8. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™



Dryvit Technical Support: 800-556-7752

Detail: Grade Termination

Drawn by: HDE

Checked by: CS

Scale: NTS

Date: 5/19/2023


File Name:

O-RMD 12



Construction Products Group

www.tremcocpg.com

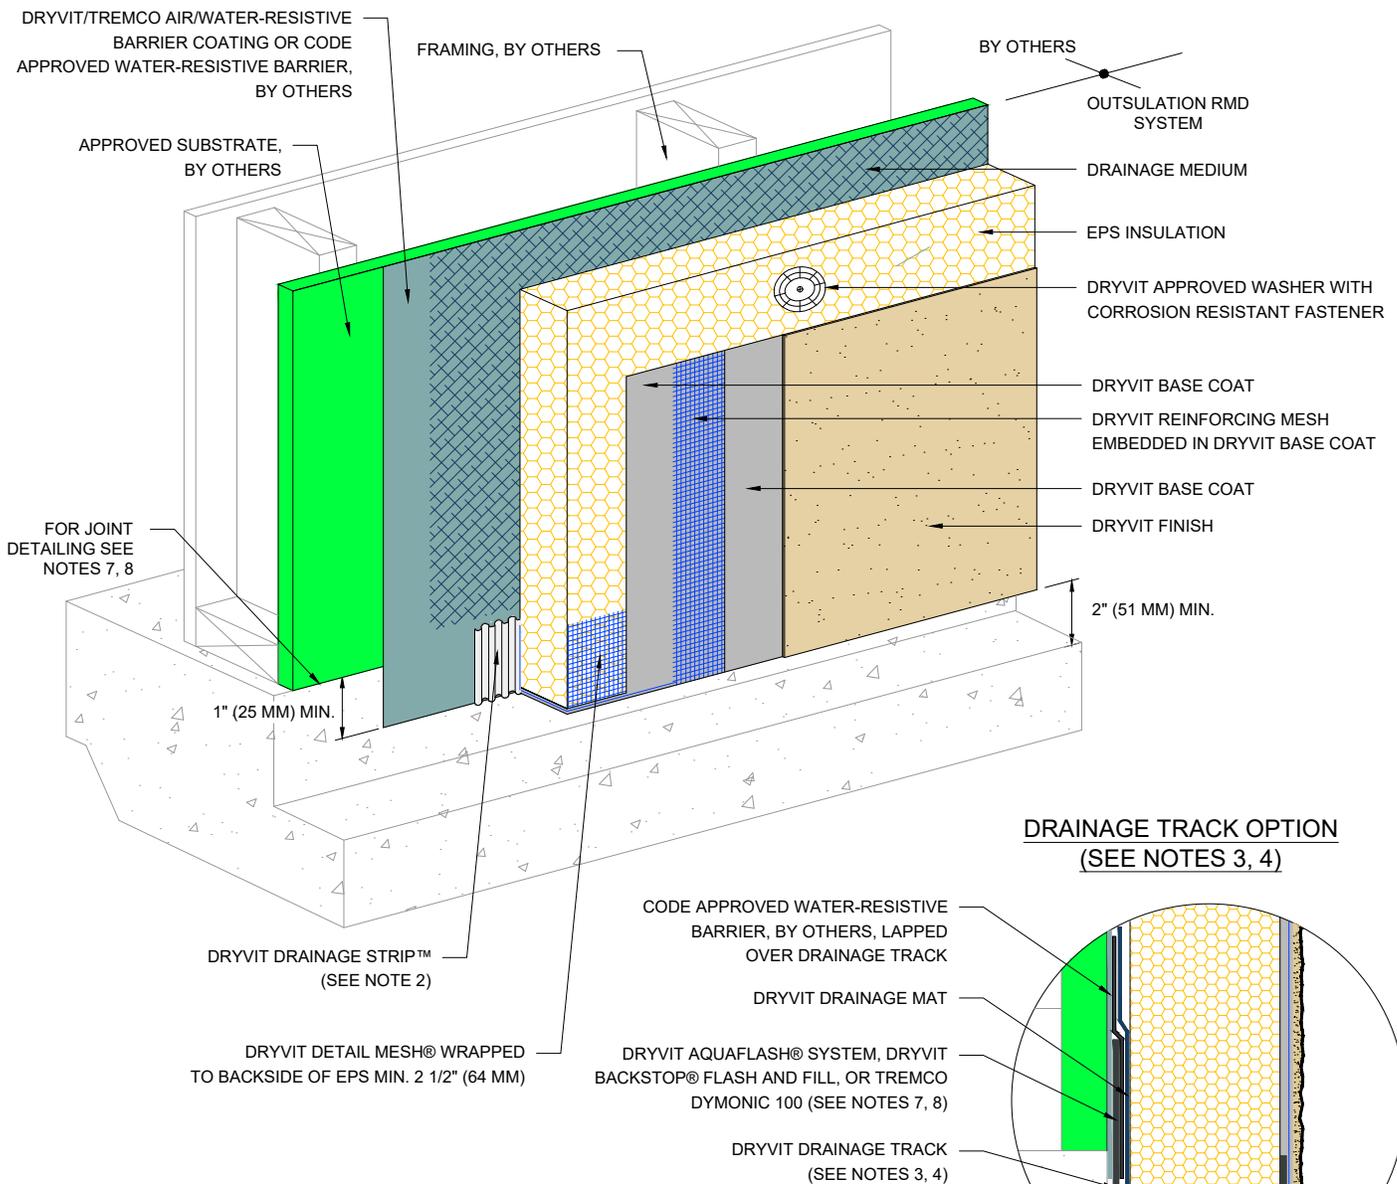


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. ENSURE BOTTOM EDGE OF DRAINAGE STRIP IS LEFT FREE TO DRAIN.
3. LIGHTLY SAND SURFACE OF DRAINAGE TRACK TO MAXIMIZE ADHESION.
4. IF PROJECT IS DEFINED AS NON-COMBUSTIBLE, DRAINAGE TRACK USAGE IS LIMITED TO THE BASE OF THE SYSTEM AT FINISHED GRADE LEVEL.
5. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
6. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
7. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
8. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.


The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

 Dryvit Technical Support: 800-556-7752	Detail: Termination at Concrete Curb				File Name:		 Construction Products Group
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 13		
www.tremcocpg.com							

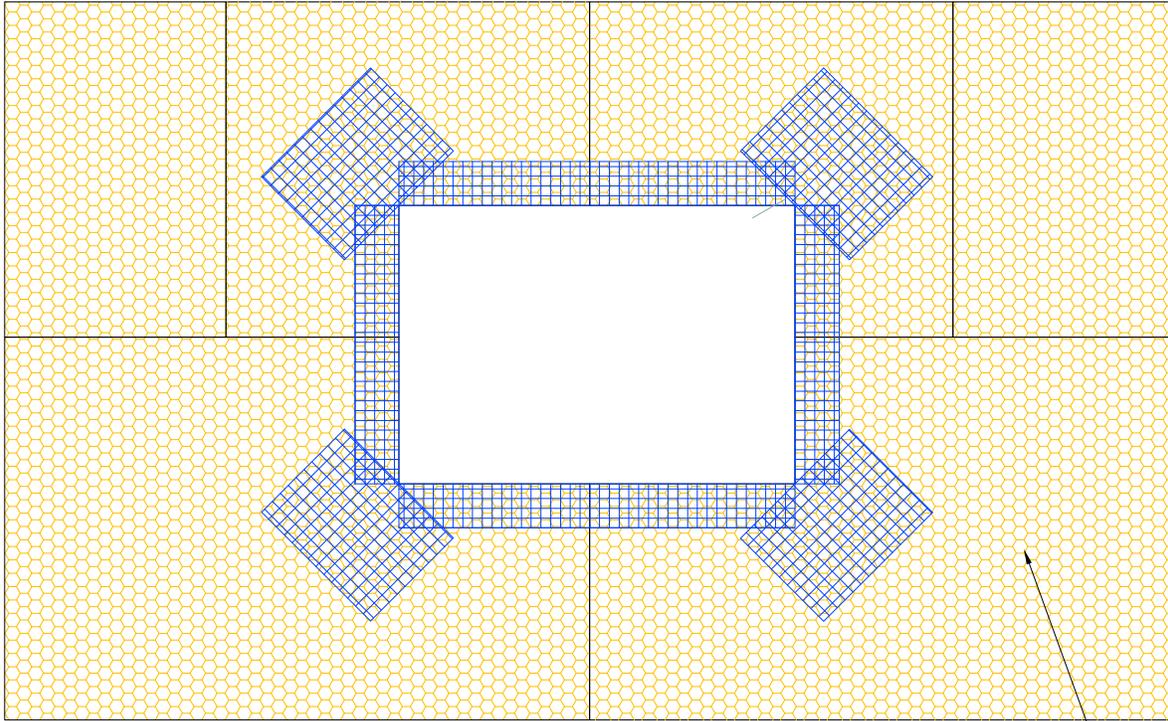

EPS INSULATION
(SEE NOTE 2)

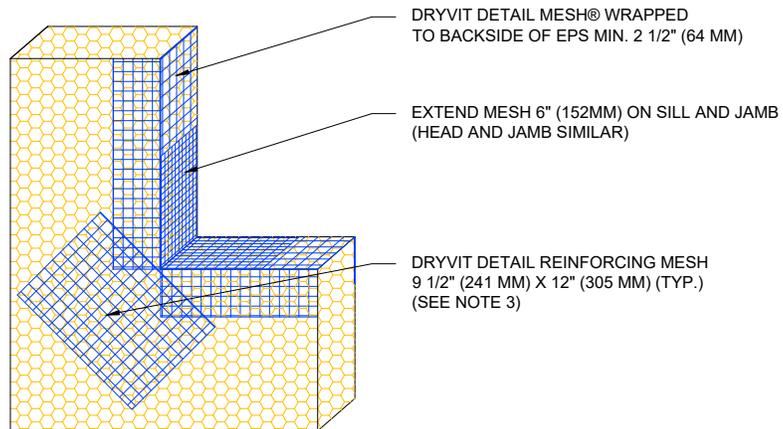

DRYVIT DETAIL MESH® WRAPPED
TO BACKSIDE OF EPS MIN. 2 1/2" (64 MM)

EXTEND MESH 6" (152MM) ON SILL AND JAMB
(HEAD AND JAMB SIMILAR)

DRYVIT DETAIL REINFORCING MESH
9 1/2" (241 MM) X 12" (305 MM) (TYP.)
(SEE NOTE 3)

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. LOCATE INSULATION BOARDS SUCH THAT BOARD EDGES DO NOT ALIGN WITH CORNERS OF PENETRATION.
3. APPLY A PIECE OF 9 1/2" (241 MM) X 12" (305 MM) DETAIL REINFORCING MESH DIAGONALLY AT EACH CORNER.
4. FASTENERS ARE REQUIRED FOR SYSTEMS 1-3.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™



 Dryvit Technical Support: 800-556-7752	Detail: EPS Penetration at Wall Penetrations				File Name:	
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 14	
 Construction Products Group						

SECTION A-A: REFER TO ORMD 16 AND ORMD 17. WEEPS IN SEALANT JOINT ARE OPTIONAL AT ARCHED WINDOW HEAD LOCATION.

SECTION B-B: REFER TO ORMD 16 AND ORMD 17.

SECTION C-C: REFER TO ORMD 19 AND ORMD 20.

SECTION D-D: REFER TO ORMD 19 AND ORMD 20.

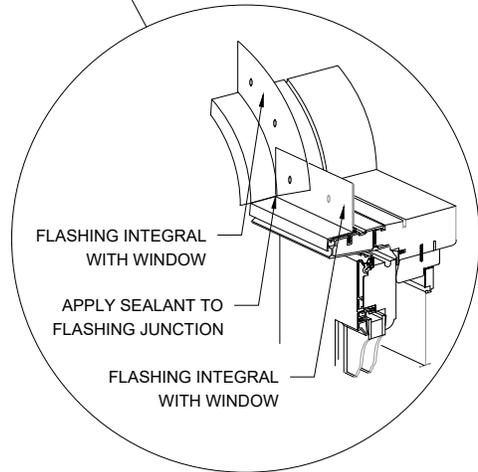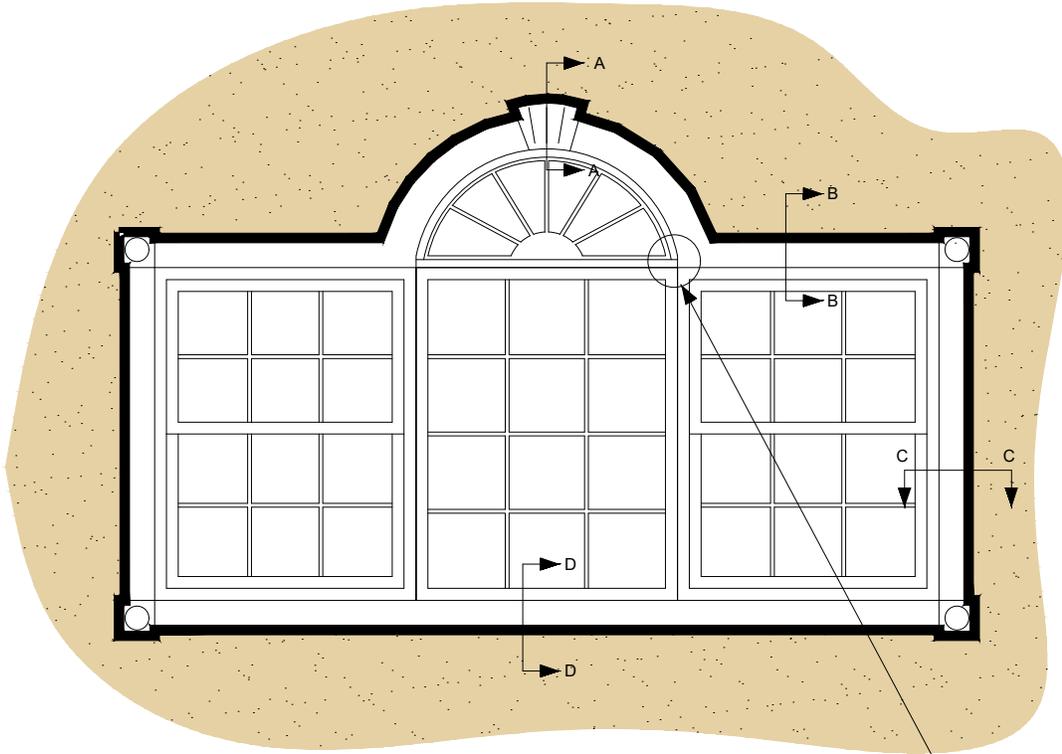


NOTE:
 1. FLASHING TRANSITION BETWEEN CURVED AND HORIZONTAL ASSEMBLIES MUST BE PROPERLY LAPPED AND SEALED TO SHED WATER TO THE EXTERIOR.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

 Dryvit Technical Support: 800-556-7752	Detail: Window Elevation				File Name:		 Construction Products Group
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 15		
www.tremcocpg.com							

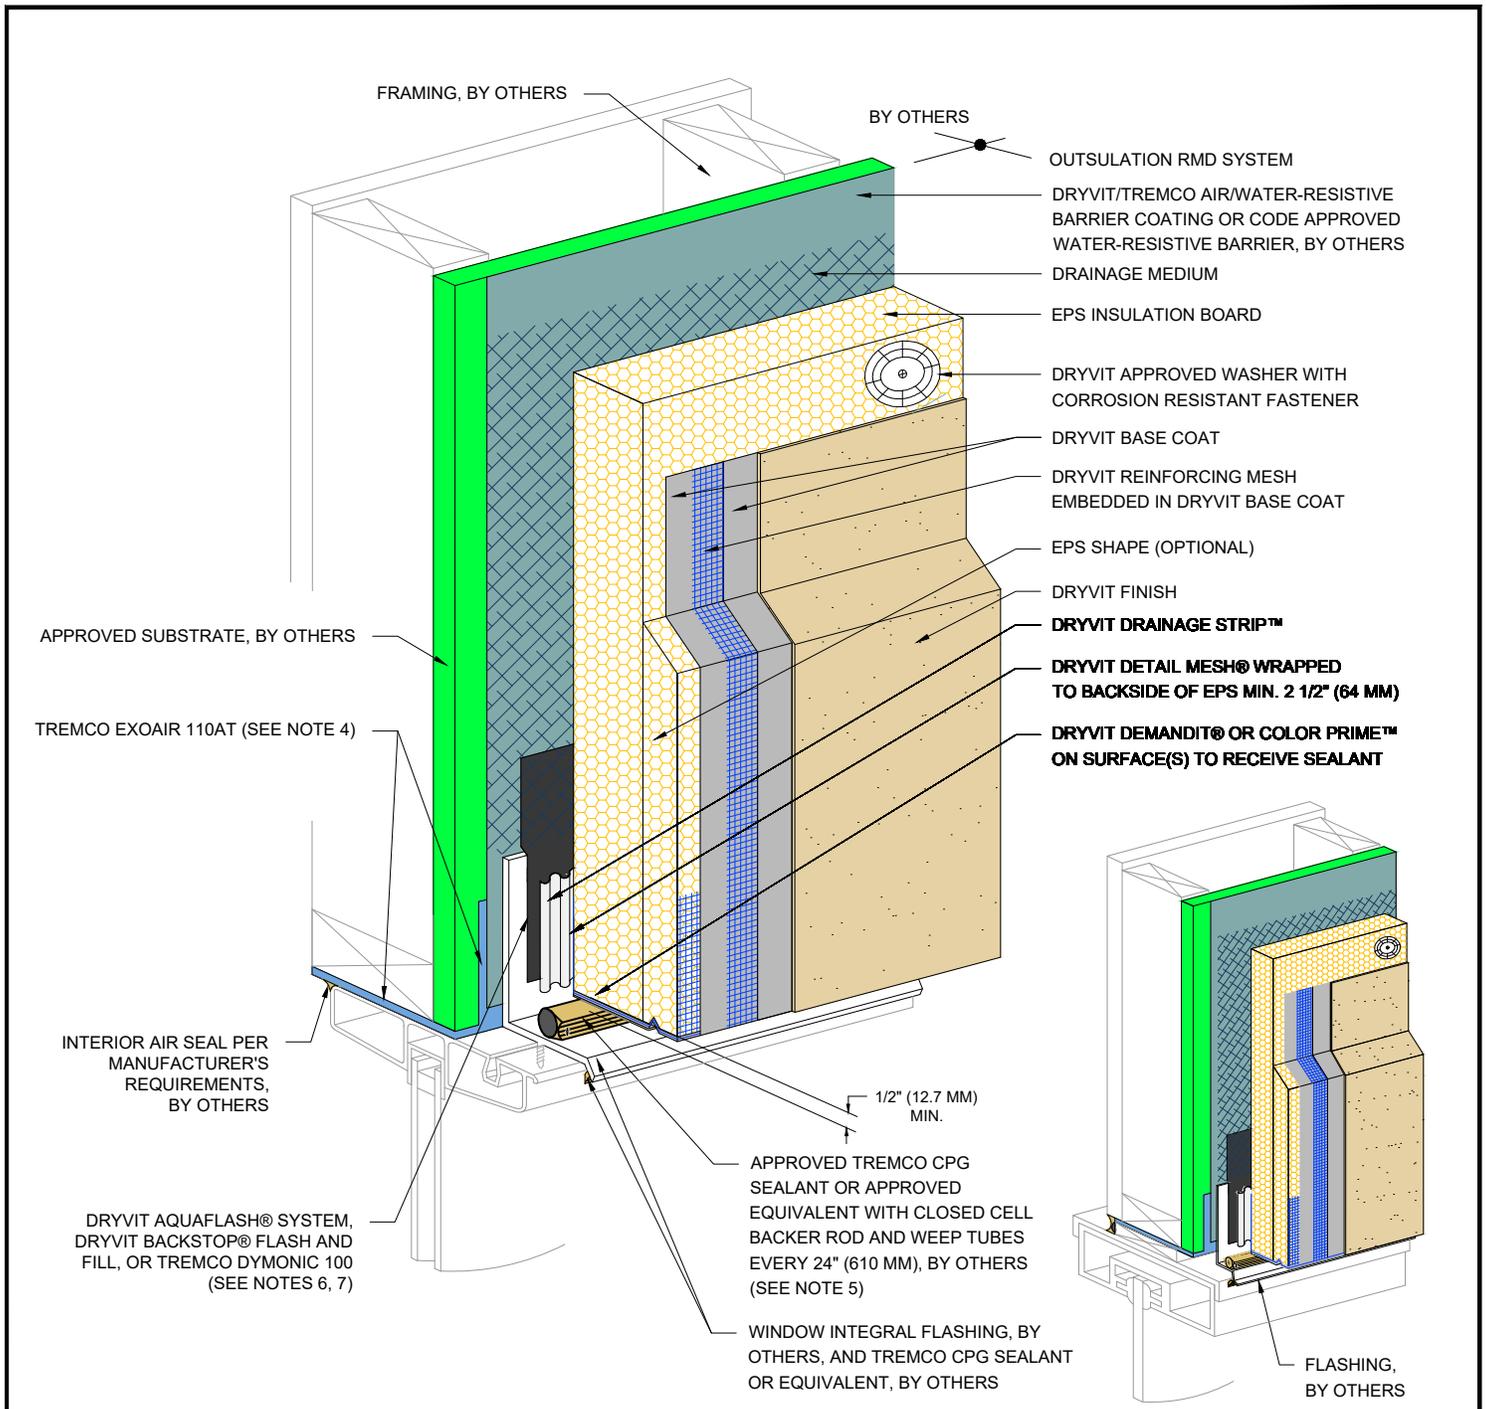

FLANGED WINDOW

STOREFRONT WINDOW


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
3. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
4. DRYVIT AQUAFLASH® SYSTEM MAY BE USED IN LIEU OF EXOAIR 110AT FOR SYSTEM 4.
5. WEEPS IN SEALANT ARE OPTIONAL AT ARCHED WINDOW HEAD LOCATIONS.
6. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
7. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

 <p>Dryvit Technical Support: 800-556-7752</p>	Detail: Flanged and Storefront Window/Door Head				File Name:		 <p>Construction Products Group</p>
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 16		
www.tremcocpg.com							

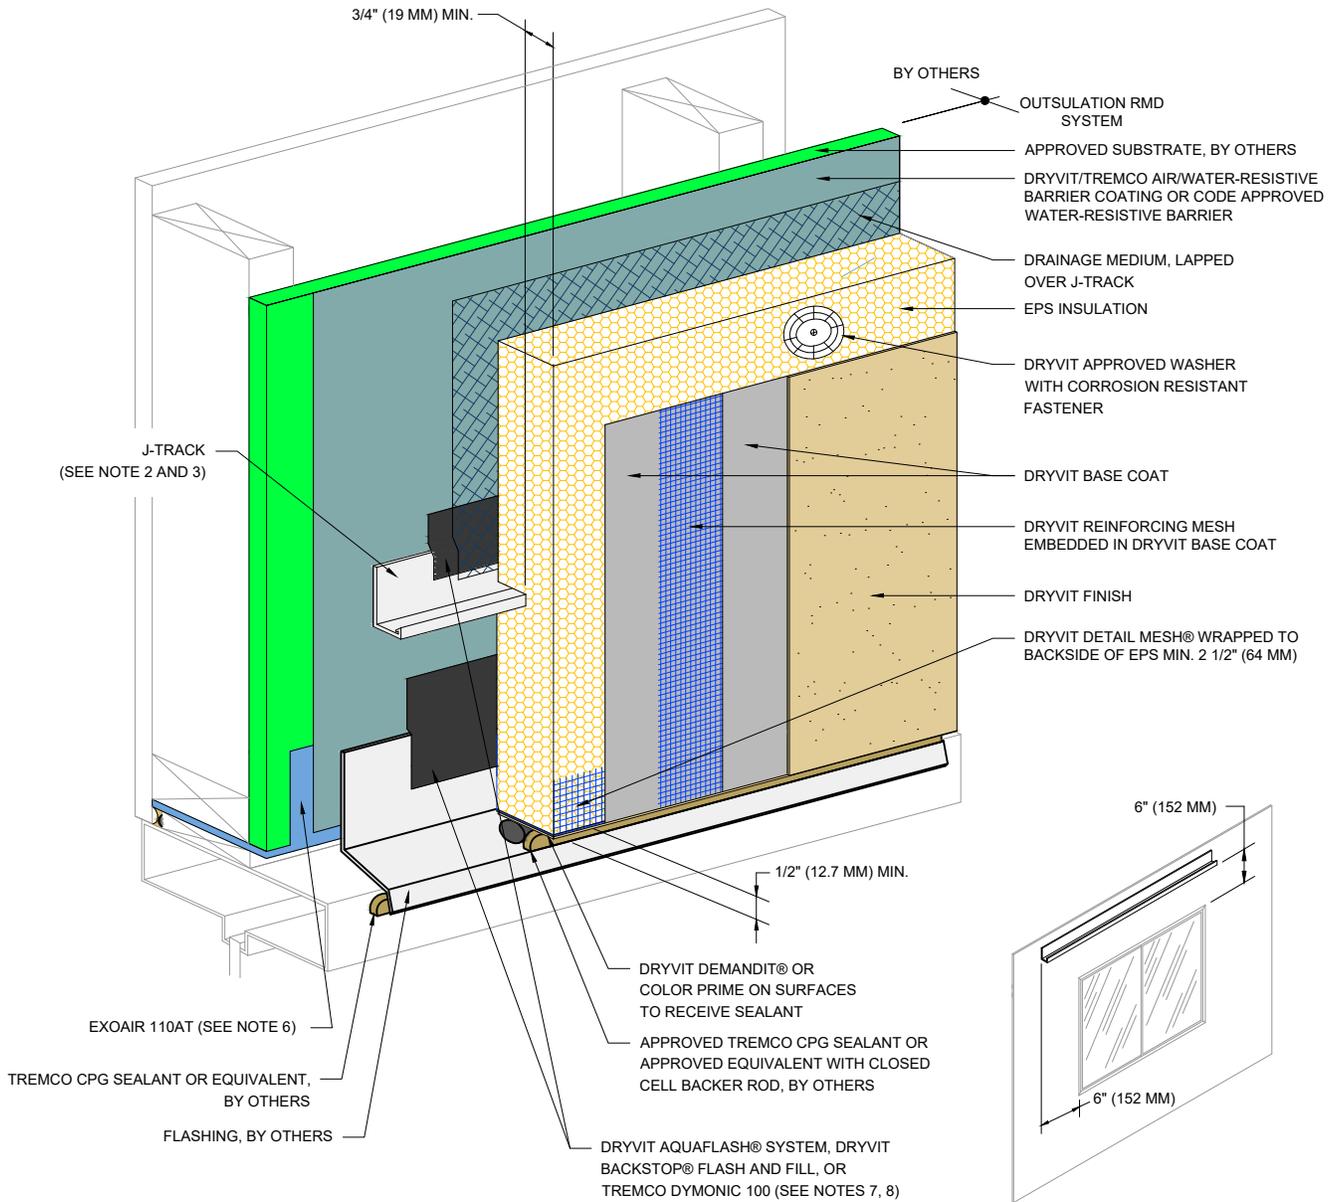


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. LIGHTLY SAND SURFACE OF J-TRACK TO MAXIMIZE ADHESION.
3. LENGTH OF TRACK NOT TO EXCEED 10 FT (3.0 M).
4. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
5. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
6. DRYVIT AQUAFLASH® SYSTEM MAY BE USED IN LIEU OF TREMCO EXOAIR 110AT FOR SYSTEM 4.
7. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
8. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.


The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

 Dryvit Technical Support: 800-556-7752	Detail: Window/Door Head with J-Track Option				File Name:	
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 17	
 Construction Products Group						

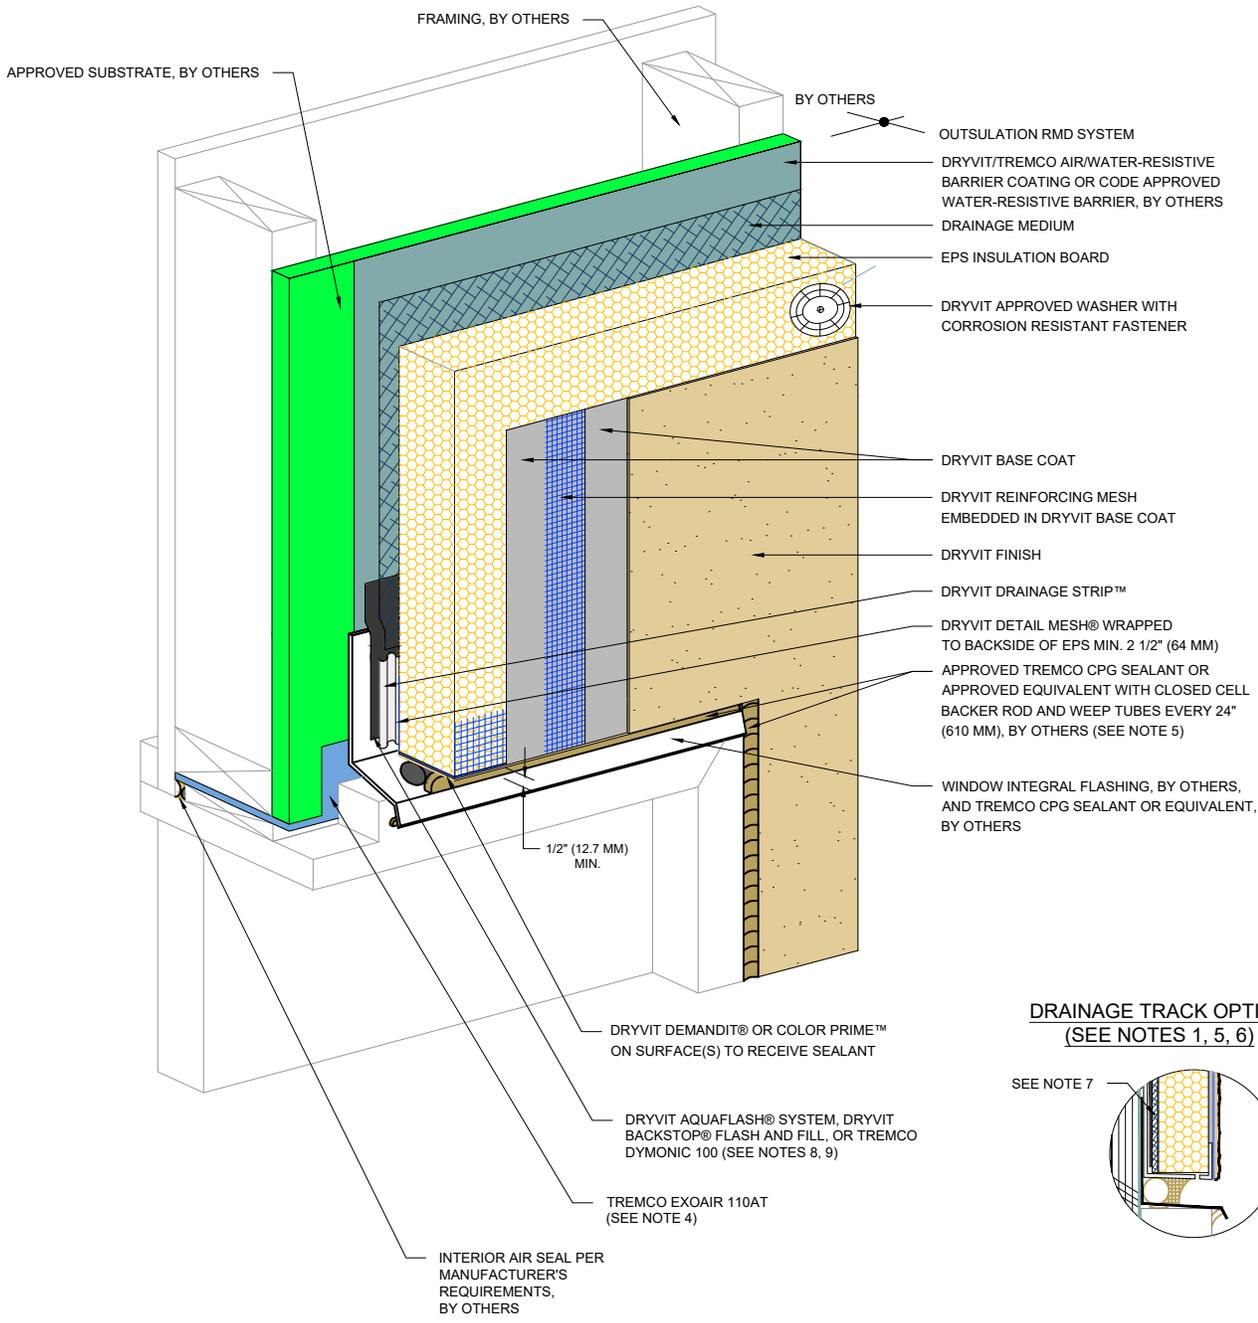

DRAINAGE TRACK OPTION
(SEE NOTES 1, 5, 6)





- NOTE:
- IF OPTIONAL VINYL TRACK IS USED, BACK OF EPS WILL NEED TO BE NOTCHED TO ACCOMMODATE THE DRAINAGE MEDIUM AND WATER-RESISTIVE BARRIER.
 - DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
 - FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
 - DRYVIT AQUAFLASH® SYSTEM MAY BE USED IN LIEU OF TREMCO EXOAIR 110AT FOR SYSTEM 4.
 - LIGHTLY SAND SURFACE OF DRAINAGE TRACK TO MAXIMIZE ADHESION.
 - IF PROJECT IS DEFINED AS NON-COMBUSTIBLE, DRAINAGE TRACK USAGE IS LIMITED TO THE BASE OF THE SYSTEM AT FINISHED GRADE LEVEL.
 - LAP DRAINAGE MAT OVER DRAINAGE TRACK.
 - REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
 - BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

 <p>Dryvit Technical Support: 800-556-7752</p>	Detail: Door Head with Brick Mold				File Name:		 <p>Construction Products Group</p>
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 18		
www.tremco-cpg.com							

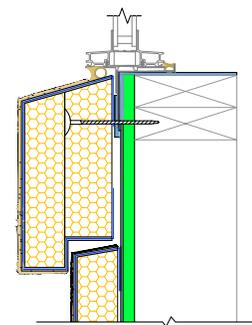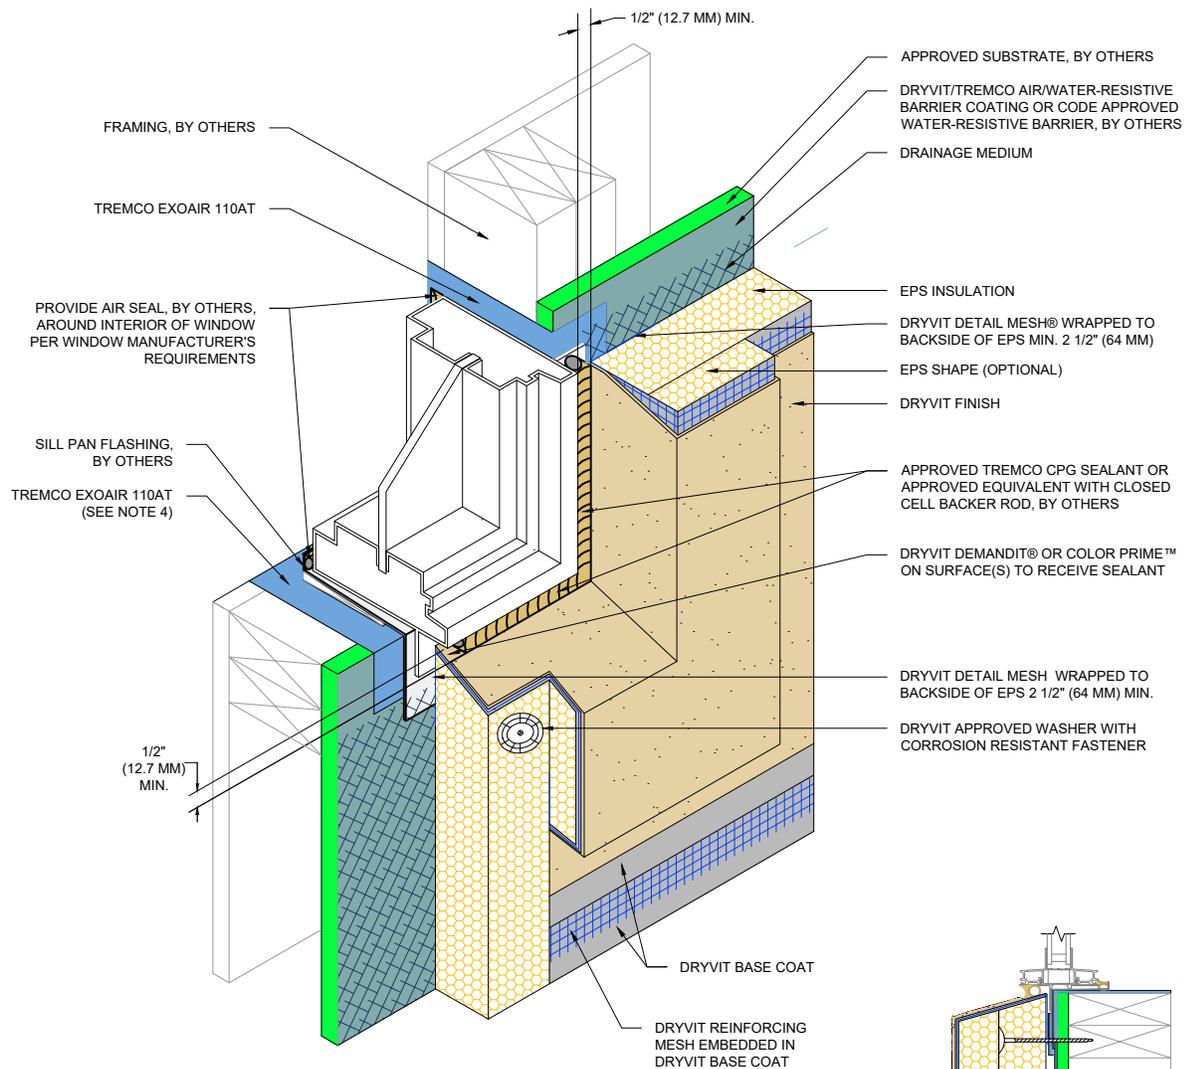

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
3. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
4. DRYVIT AQUAFLASH® SYSTEM MAY BE USED IN LIEU OF TREMCO EXOAIR 110AT FOR SYSTEM 4.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™



Dryvit Technical Support: 800-556-7752

Detail: Self Flashing Window Sill - Jamb

Drawn by: HDE

Checked by: CS

Scale: NTS

Date: 5/19/2023



File Name:

O-RMD 19



Construction Products Group

www.tremcocpg.com

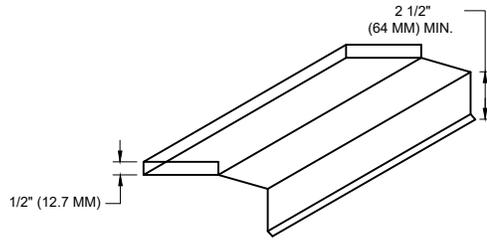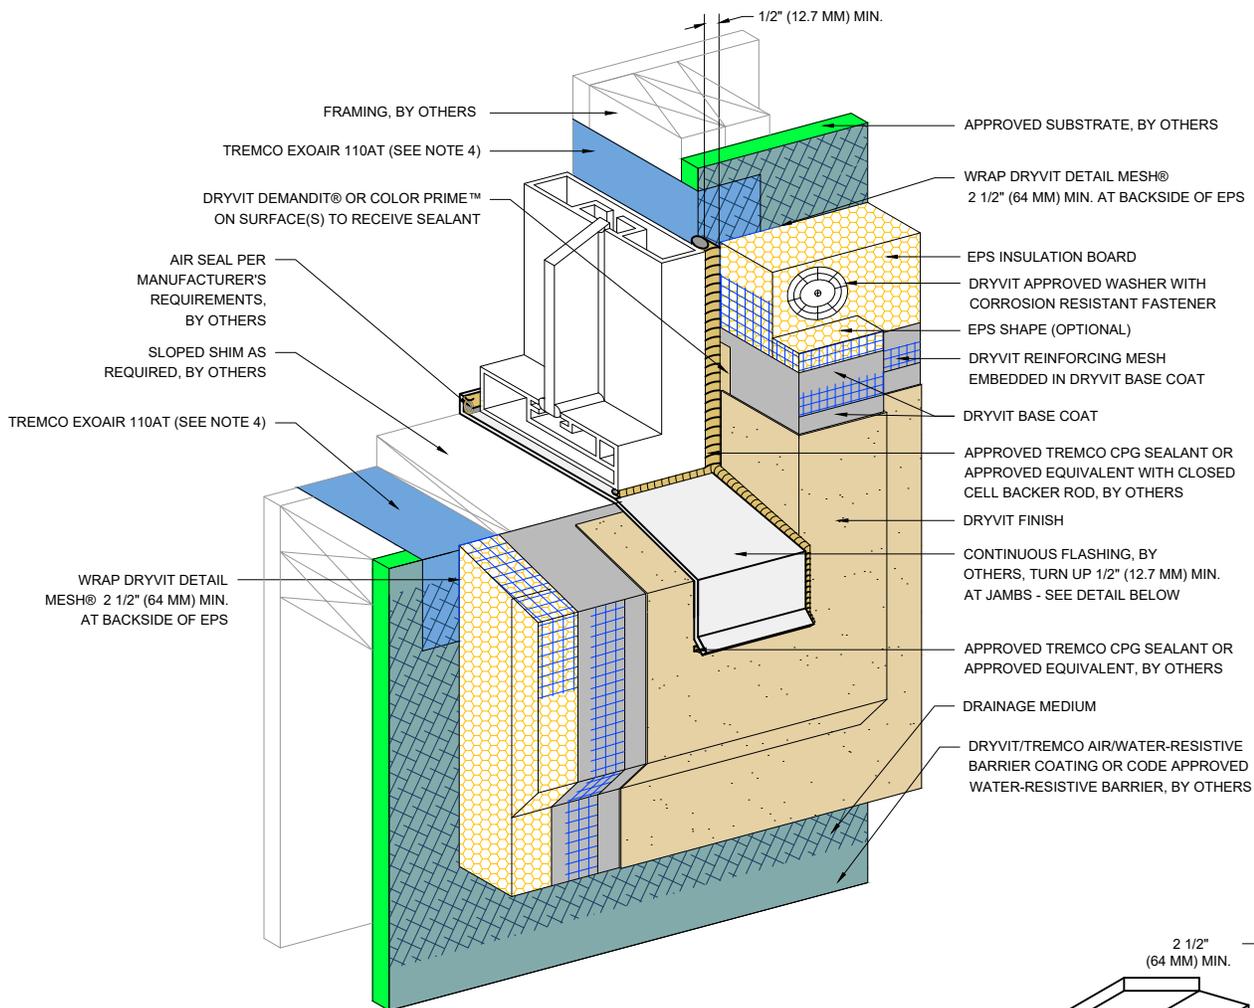

**SILL PAN FLASHING
DETAIL**

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
3. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
4. DRYVIT AQUAFASH® SYSTEM MAY BE USED IN LIEU OF TREMCO EXOAIR 110AT FOR SYSTEM 4.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™



Dryvit Technical Support: 800-556-7752

Detail: Storefront Window Sill - Jamb

Drawn by: HDE

Checked by: CS

Scale: NTS

Date: 5/19/2023


File Name:

O-RMD 20



Construction Products Group

www.tremcocpg.com

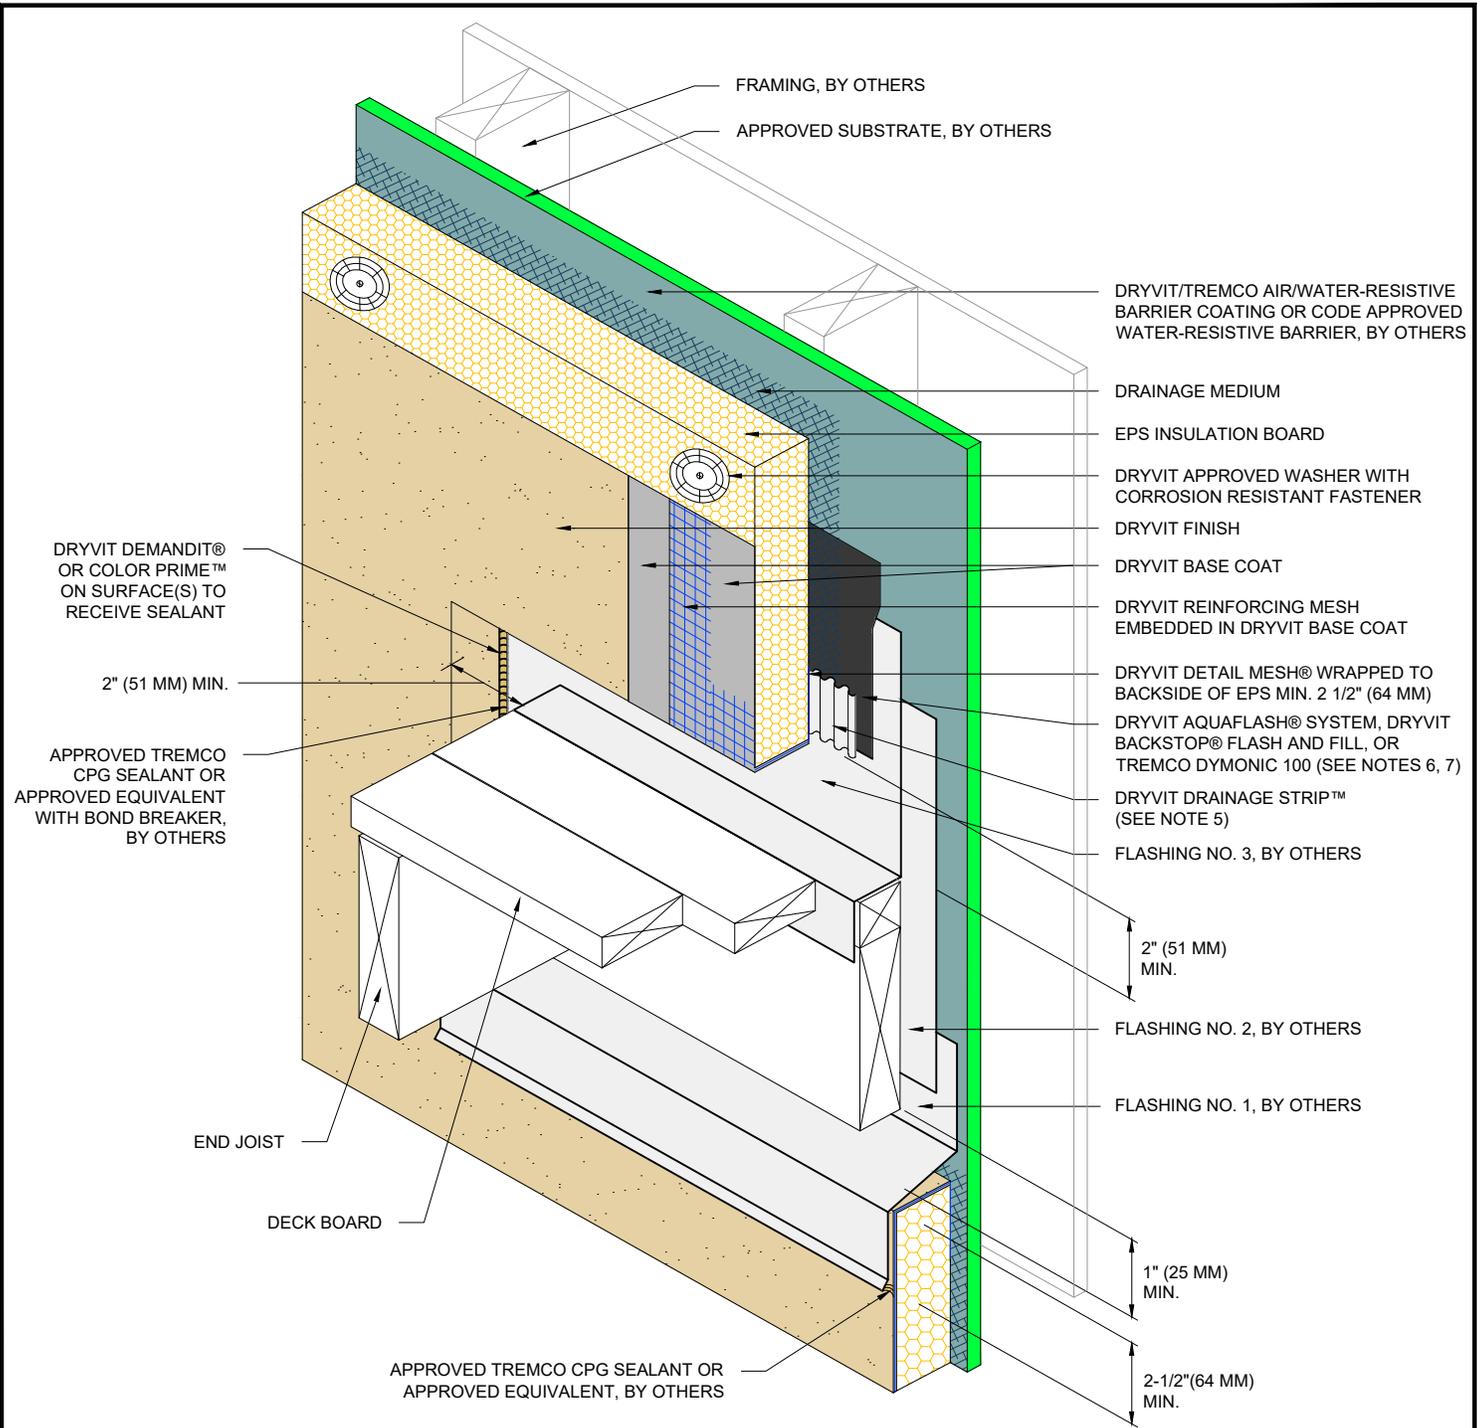


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. DETAIL DOES NOT APPLY TO CANTILEVERED DECKS. CANTILEVERED DECKS REQUIRE JOB SPECIFIC FLASHING DETAILS.
3. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
4. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
5. DRYVIT DRAINAGE TRACK IS AN ALTERNATE OPTION IN LIEU OF THE DRYVIT DRAINAGE STRIP. HOWEVER, IF PROJECT IS DEFINED AS NON-COMBUSTIBLE, DRAINAGE TRACK USAGE IS LIMITED TO THE BASE OF THE SYSTEM AT FINISHED GRADE LEVEL. WHEN USING DRAINAGE TRACK, BACK OF EPS WILL NEED TO BE NOTCHED TO ACCOMODATE THE DRYVIT DRAINAGE MAT AND WATER-RESISTIVE BARRIER.
6. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
7. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.


The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

<p style="font-size: 8px; margin-top: 5px;">Dryvit Technical Support: 800-556-7752</p>	Detail: Termination at Wood Framed Deck				File Name:		<p style="font-size: 8px; margin-top: 5px;">Construction Products Group</p>
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 21		
www.tremcocpg.com							

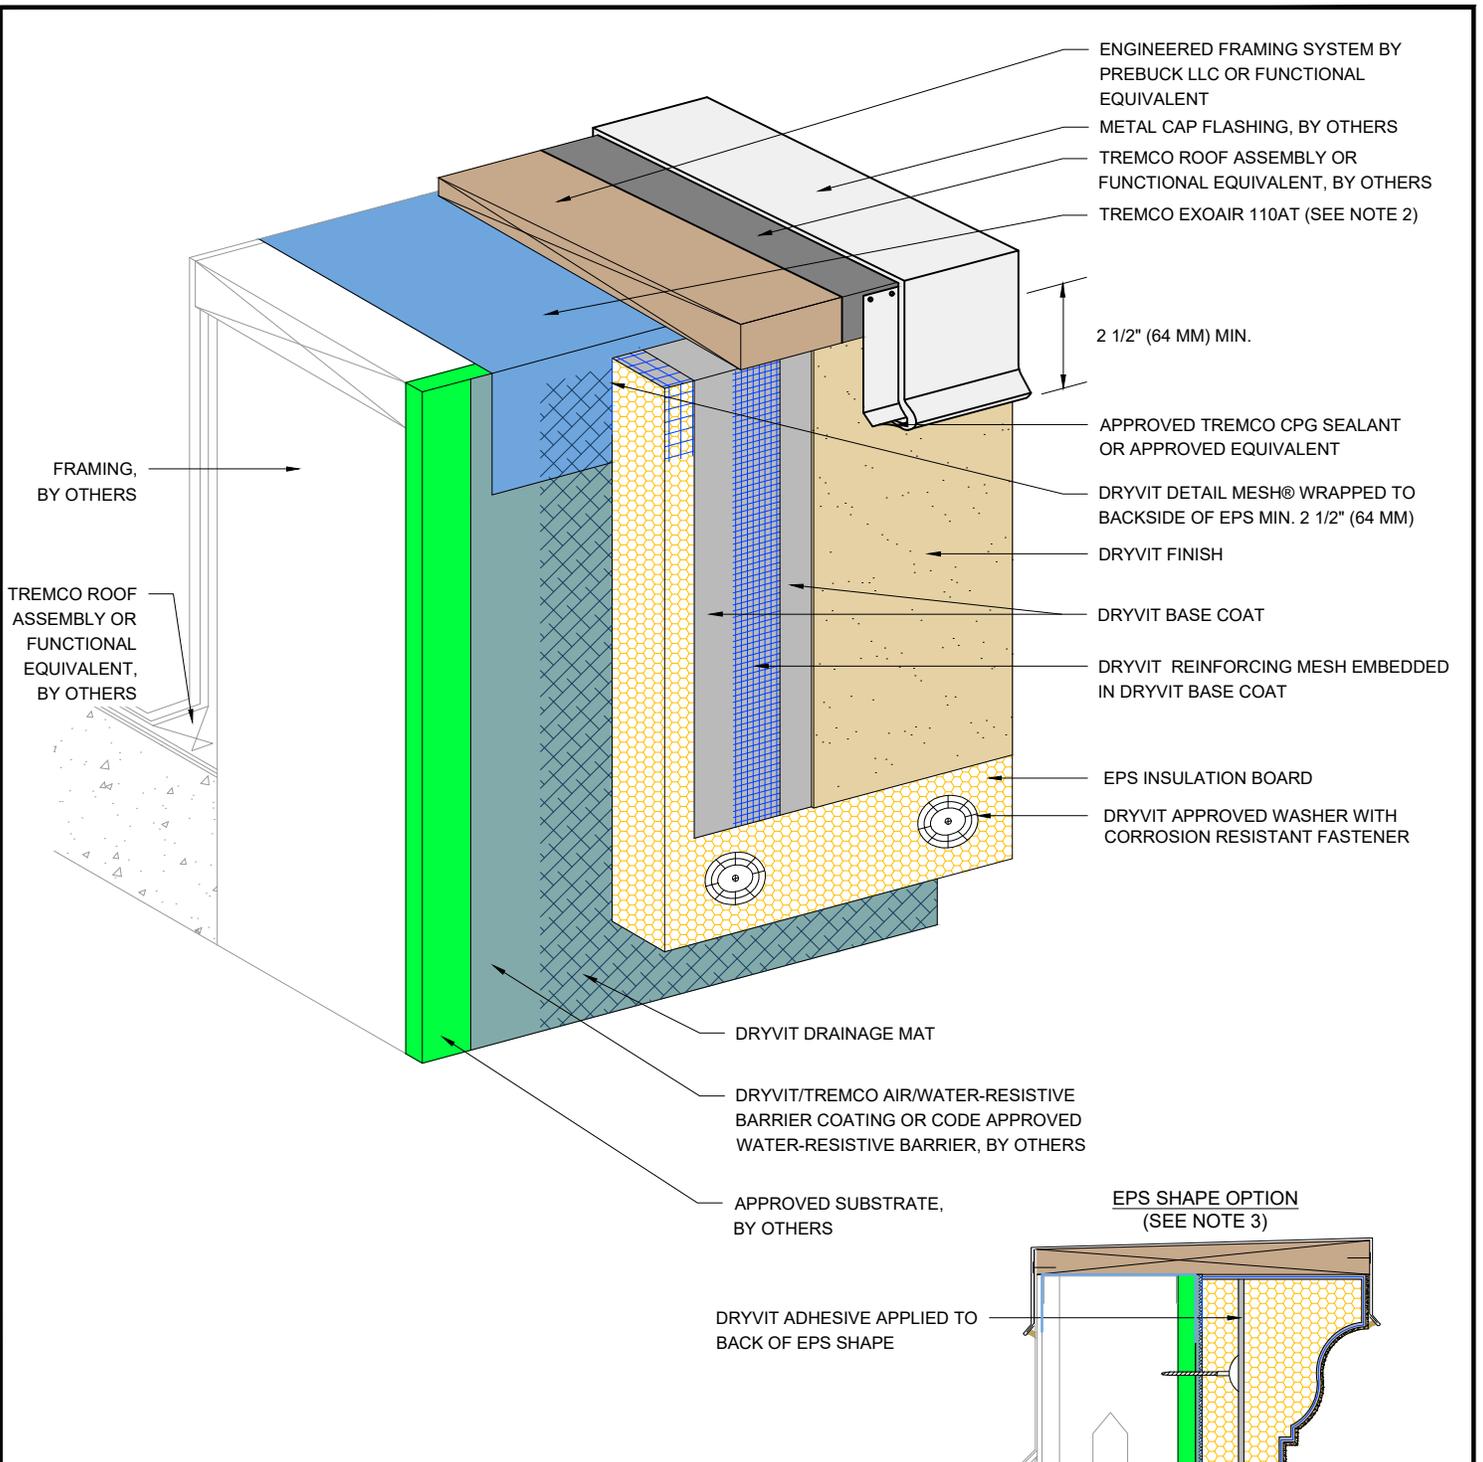

EPS SHAPE OPTION
(SEE NOTE 3)

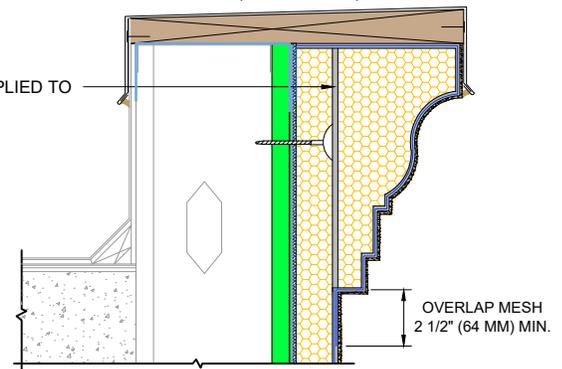


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. DRYVIT AQUAFASH® SYSTEM MAY BE USED IN LIEU OF TREMCO EXOAIR 110AT FOR SYSTEM 4.
3. MAXIMUM EPS INSULATION THICKNESS IS DICTATED BY LOCAL CODE AUTHORITY AND APPLICABLE TESTING. REFER TO EVALUATION REPORTS FOR ANY LIMITATIONS TO EPS THICKNESS.
4. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
5. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

 Dryvit Technical Support: 800-556-7752	Detail: Termination at Parapet - Cap Flashing				File Name:		 Construction Products Group
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 22		
www.tremcocpg.com							

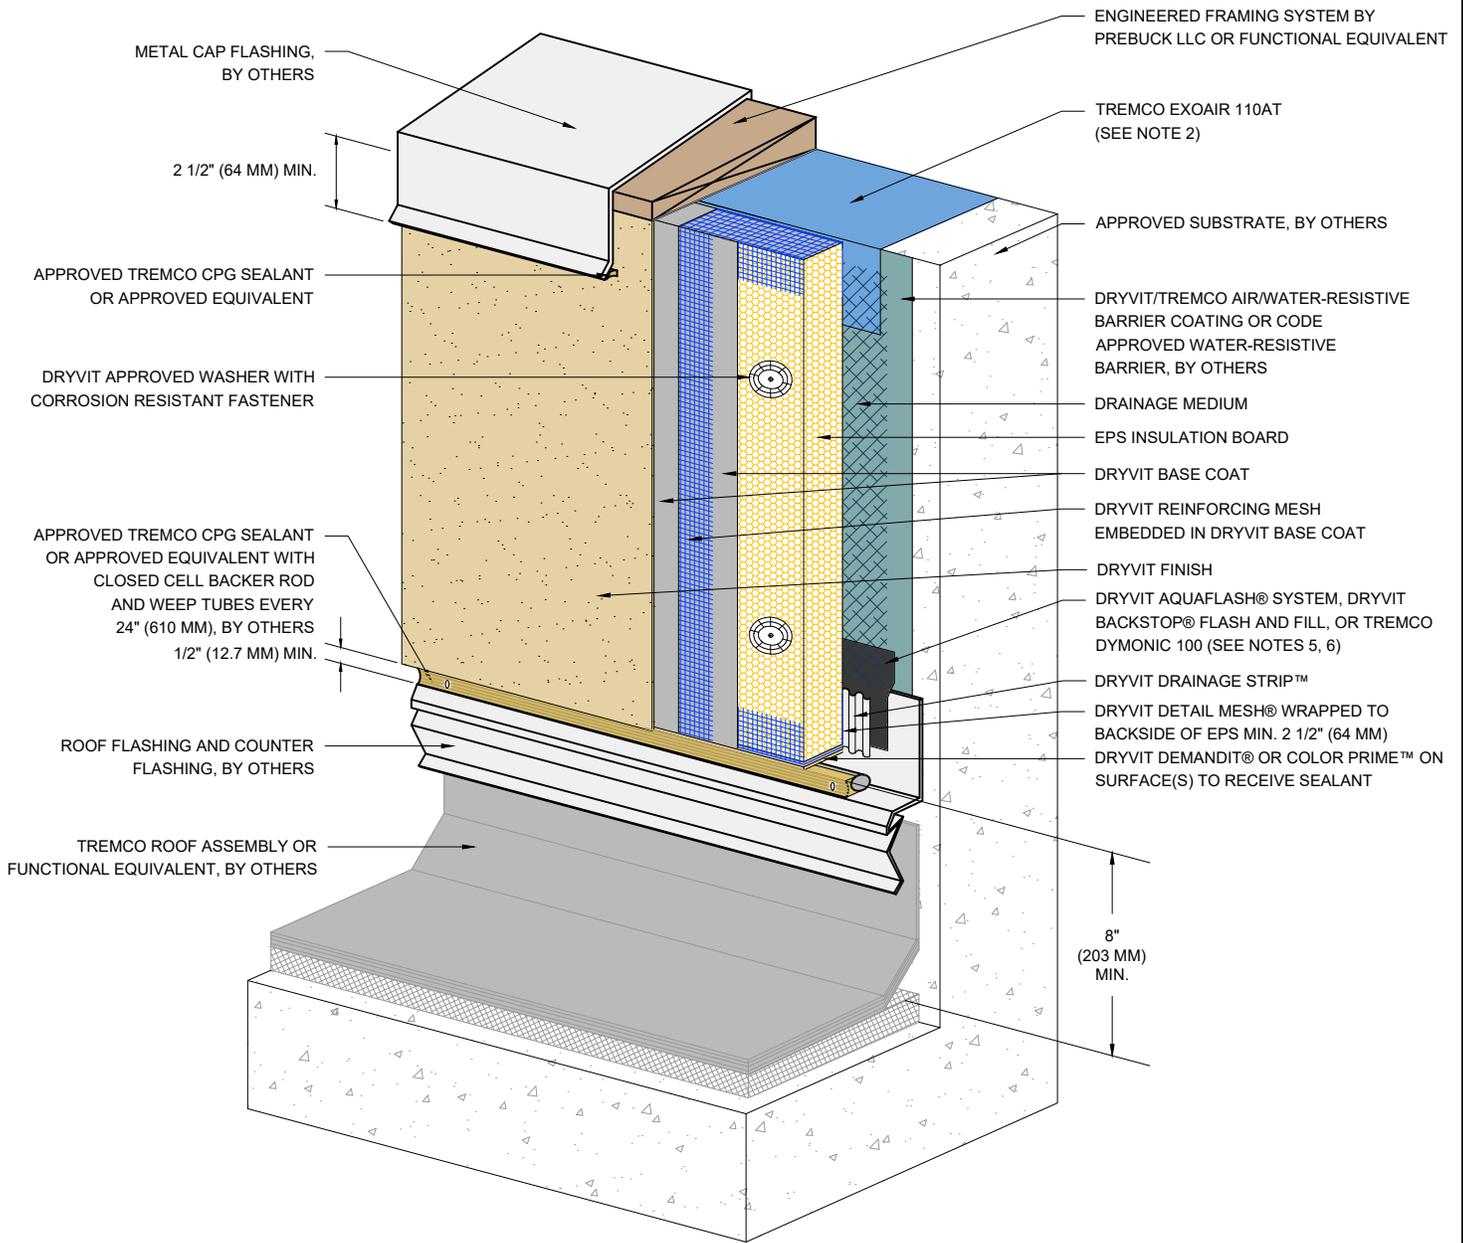



NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. DRYVIT AQUAFLASH® SYSTEM MAY BE USED IN LIEU OF TREMCO EXOAIR 110AT FOR SYSTEM 4.
3. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
4. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
5. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
6. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

 Dryvit Technical Support: 800-556-7752	Detail: Termination at Parapet - Solid Substrate				File Name:		 Construction Products Group
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 23		
www.tremcocpg.com							

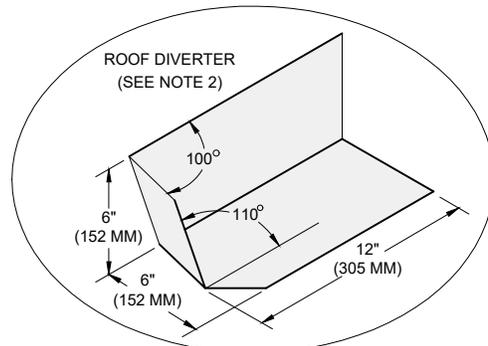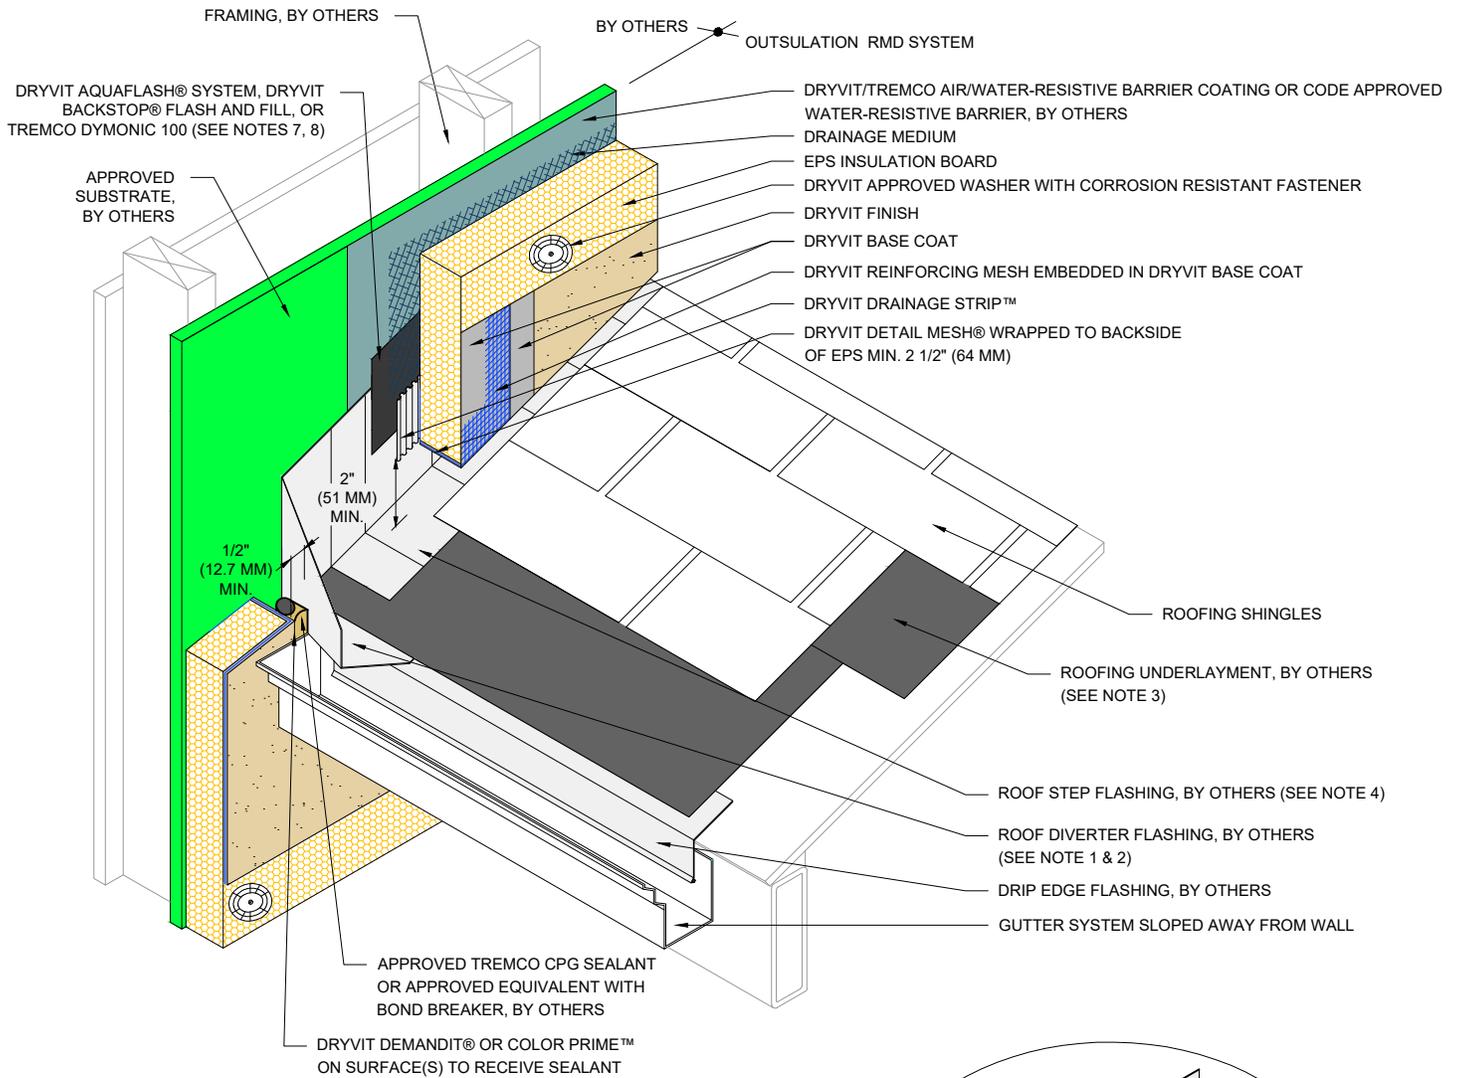


NOTE:

1. EXTEND DIVERTER FLASHING (KICKOUT) A MINIMUM OF 1" (25 MM) BEYOND FACE OF THE SYSTEM.
2. ROOF DIVERTER TO BE MADE FROM CORROSION RESISTANT MATERIAL MIN. 24 GAGE WITH WATER TIGHT SEAMS. SOLDER ALL JOINTS IN KICKOUT DIVERTER.
3. EXTEND ROOFING UNDERLAYMENT 5" (127 MM) UP VERTICAL WALL BEHIND METAL FLASHING.
4. METAL FLASHINGS ARE 10" (254 MM) X 2" (51 MM) LONGER THAN THE EXPOSED PORTION OF THE ROOFING SHINGLE AND ARE BENT IN HALF TO ALLOW FOR TWO 5" (127 MM) LEGS. ALTHOUGH NOT SHOWN, METAL FLASHINGS ARE STEP FLASHED (INTERWOVEN) WITH ROOFING SHINGLES.
5. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
6. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
7. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
8. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

<p style="font-size: 8px; margin-top: 5px;">Dryvit Technical Support: 800-556-7752</p>	Detail: Termination at Sloped Roof				File Name:		<p style="font-size: 8px; margin-top: 5px;">Construction Products Group</p>
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 24		
www.tremcocpg.com							

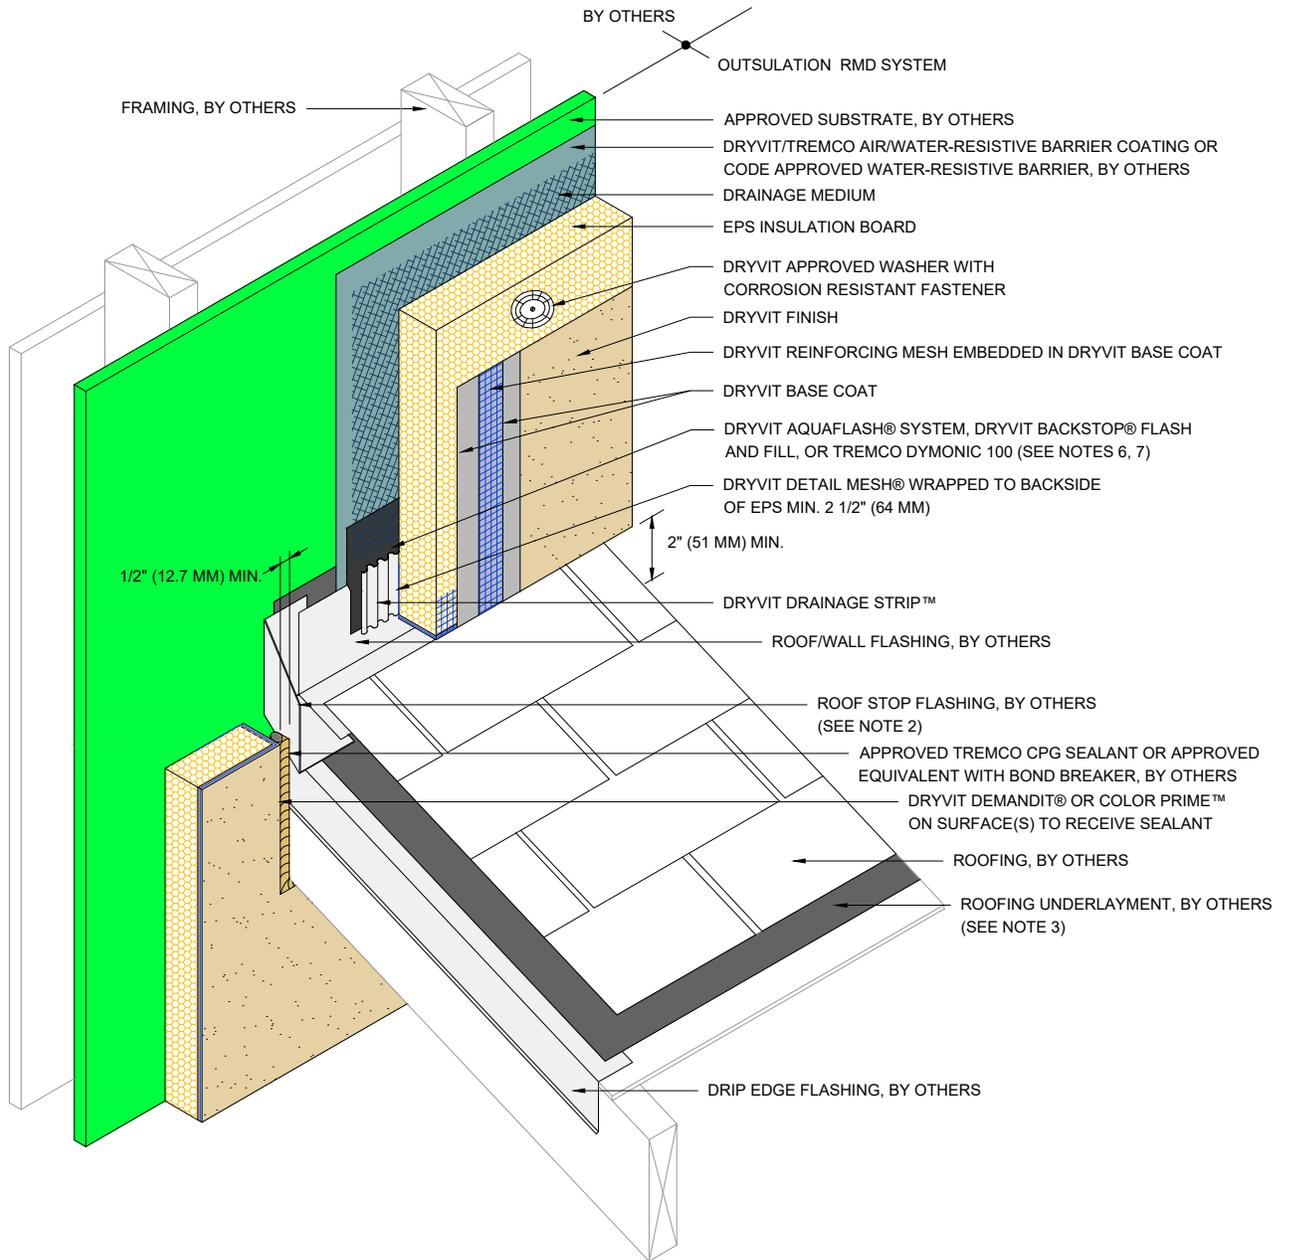

NOTE:

1. EXTEND ROOF STOP FLASHING 1" (25 MM) MINIMUM BEYOND FACE OF THE SYSTEM.
2. ROOF STOP TO BE MADE FROM CORROSION RESISTANT MATERIAL MIN. 24 GAGE WITH WATER TIGHT SEAMS.
3. EXTEND ROOFING UNDERLAYMENT 5" (127 MM) UP VERTICAL WALL BEHIND METAL FLASHING.
4. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
5. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
6. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
7. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™



Dryvit Technical Support: 800-556-7752

Detail: Termination at Roof Stop Flashing

Drawn by: HDE

Checked by: CS

Scale: NTS

Date: 5/19/2023


File Name:

O-RMD 25



Construction Products Group

www.tremcocpg.com

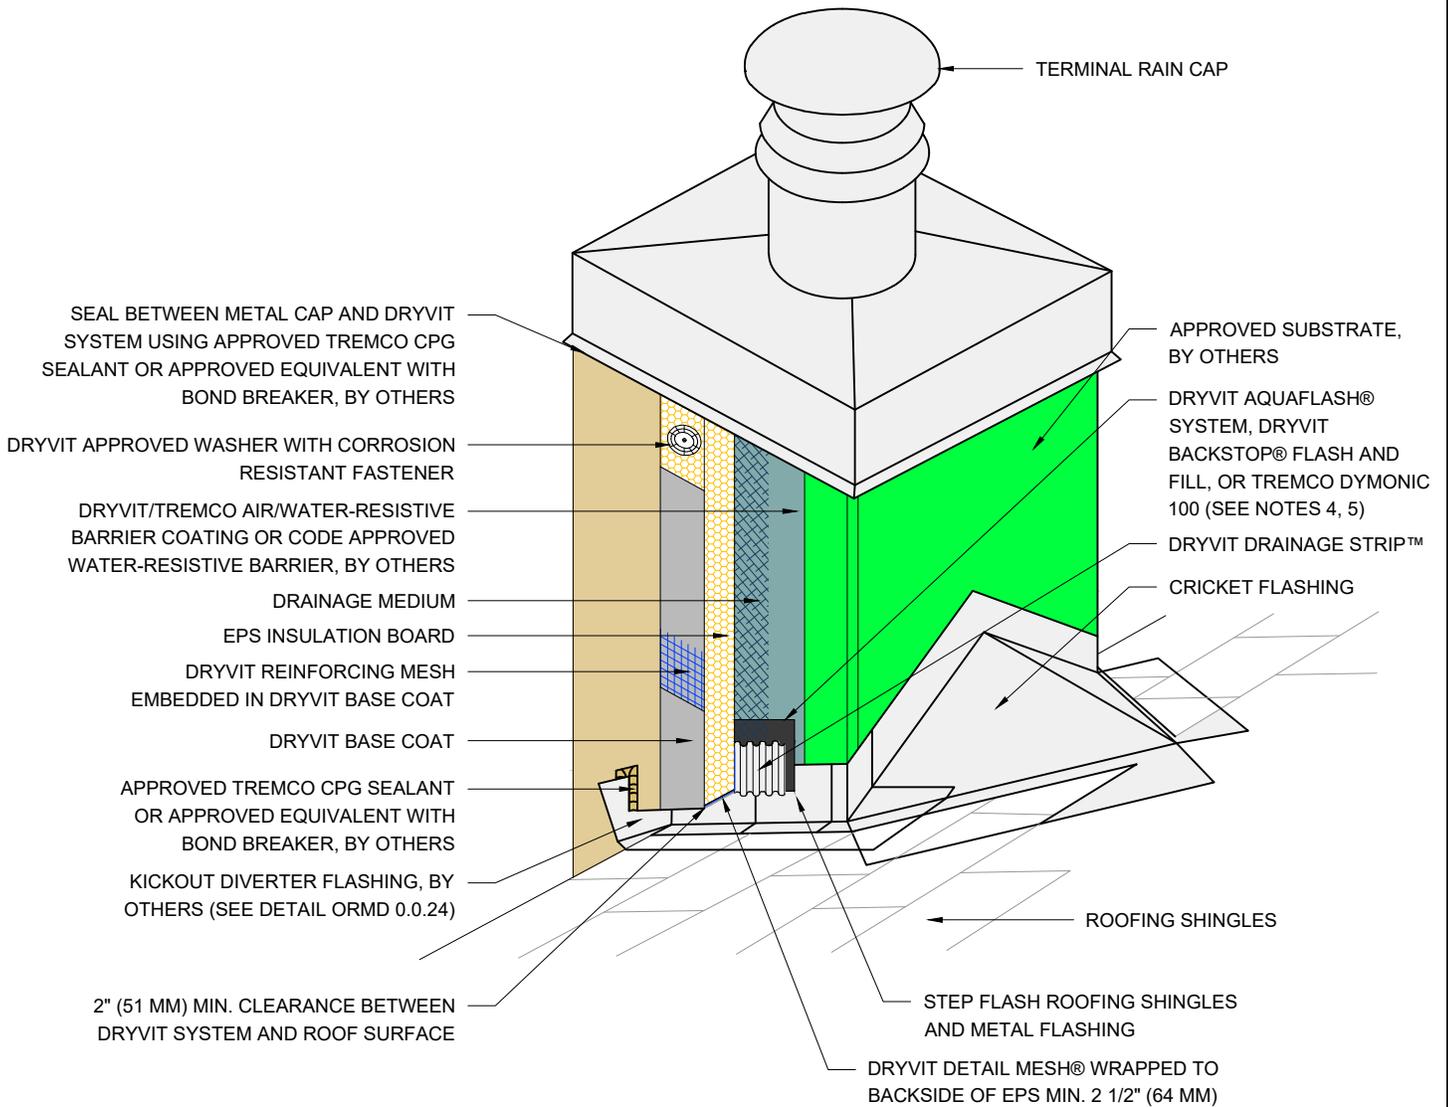


NOTE:

1. USE OF EPS INSULATION IS NOT RECOMMENDED ON MASONRY CHIMNEYS.
2. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
3. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
4. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
5. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

 Dryvit Technical Support: 800-556-7752	Detail: Chimney Enclosure				File Name:		 Construction Products Group
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 26		
www.tremcocpg.com							

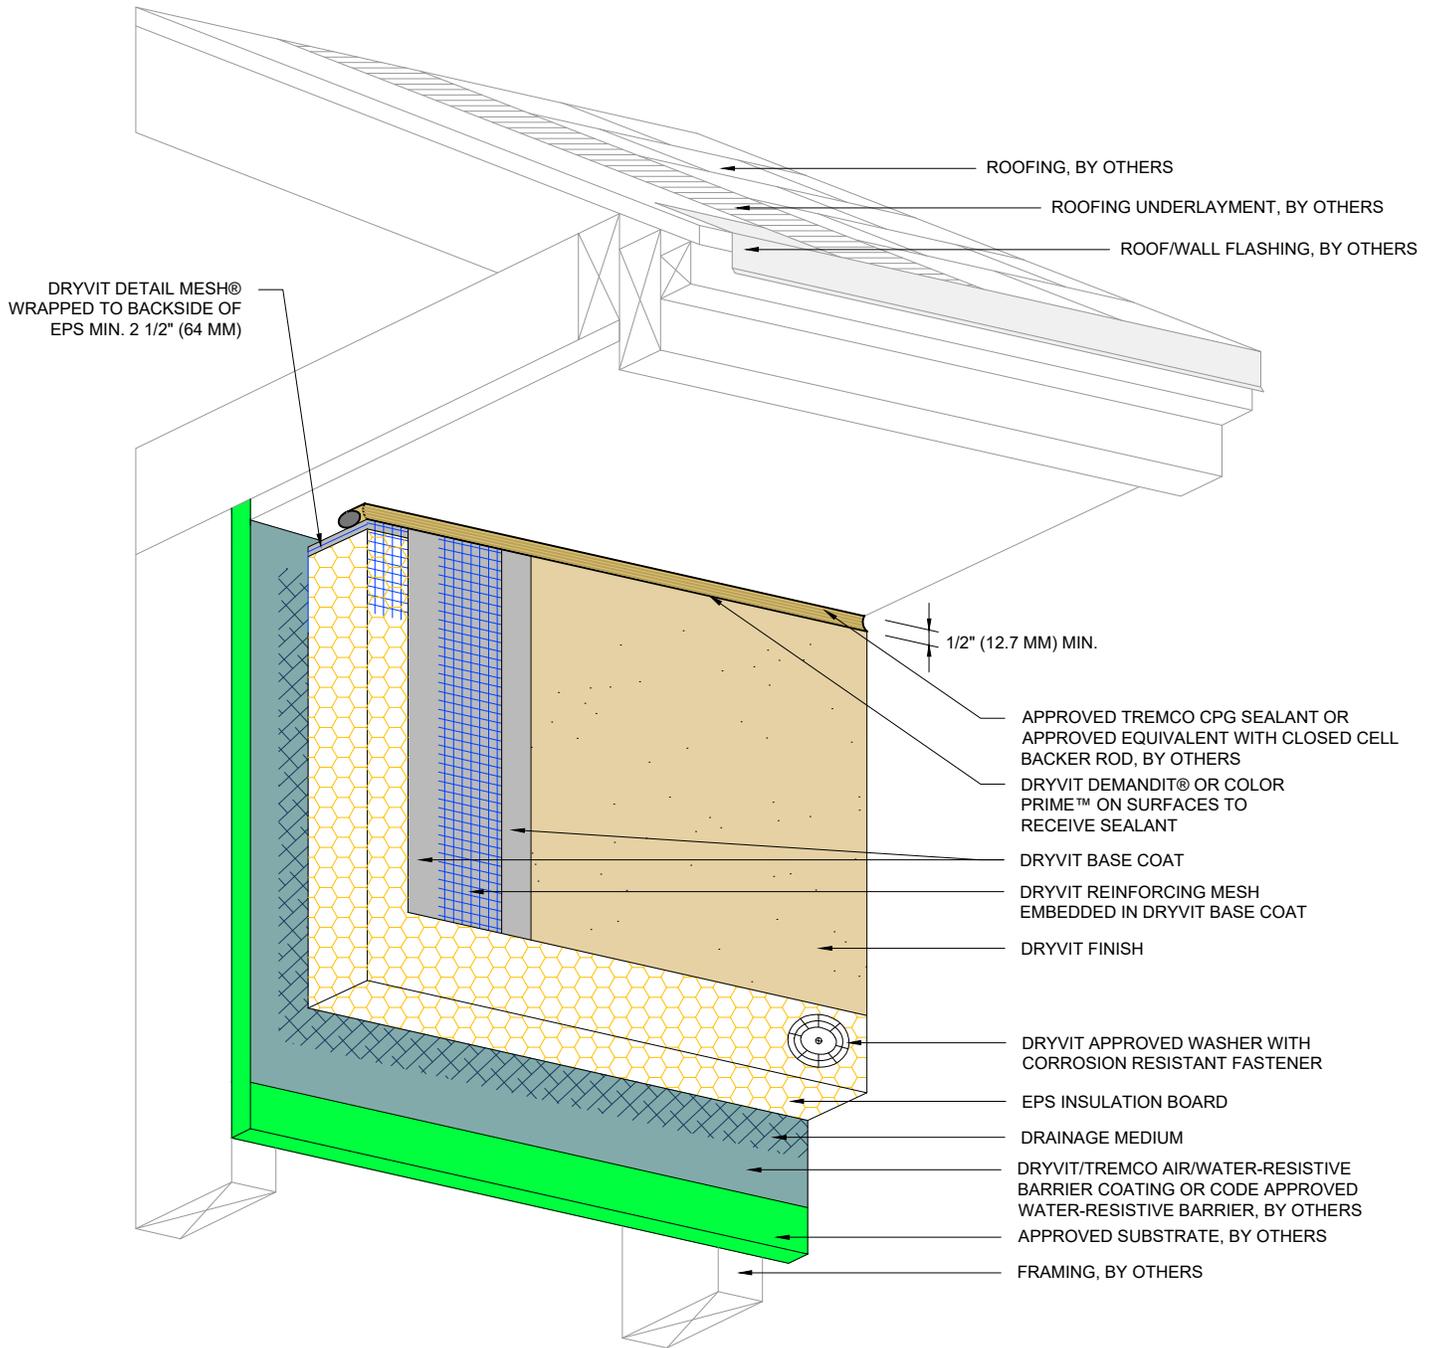


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
3. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

 <p>Dryvit Technical Support: 800-556-7752</p>	Detail: Soffit Termination				File Name:		 <p>Construction Products Group</p>
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 27		
www.tremcocpg.com							

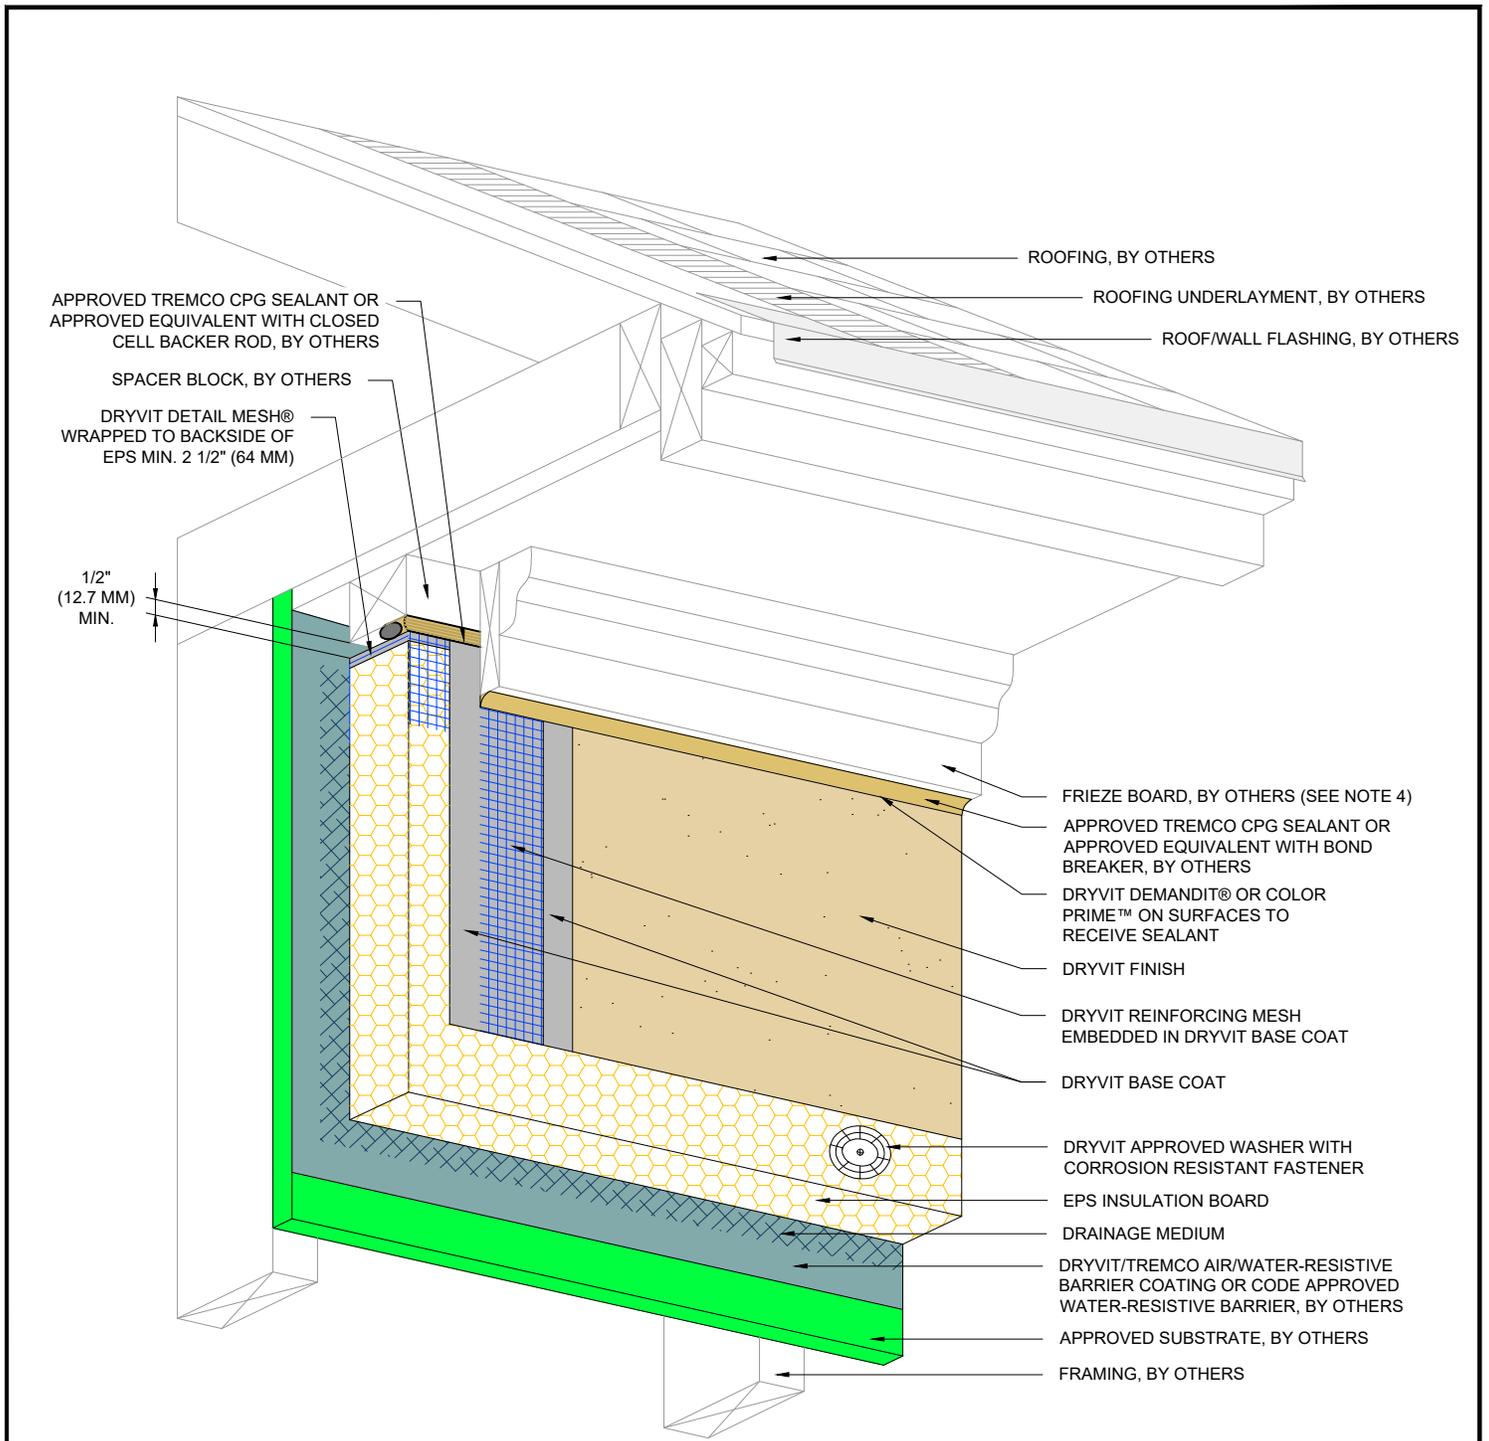


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
3. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
4. INSTALL SOFFIT FRIEZE BOARD AND TRIM AFTER OUTSULATION RMD SYSTEM IS IN PLACE.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

 <p>Dryvit Technical Support: 800-556-7752</p>	Detail: Soffit Termination with Frieze Board				File Name:		 <p>Construction Products Group</p>
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 28		
www.tremcocpg.com							

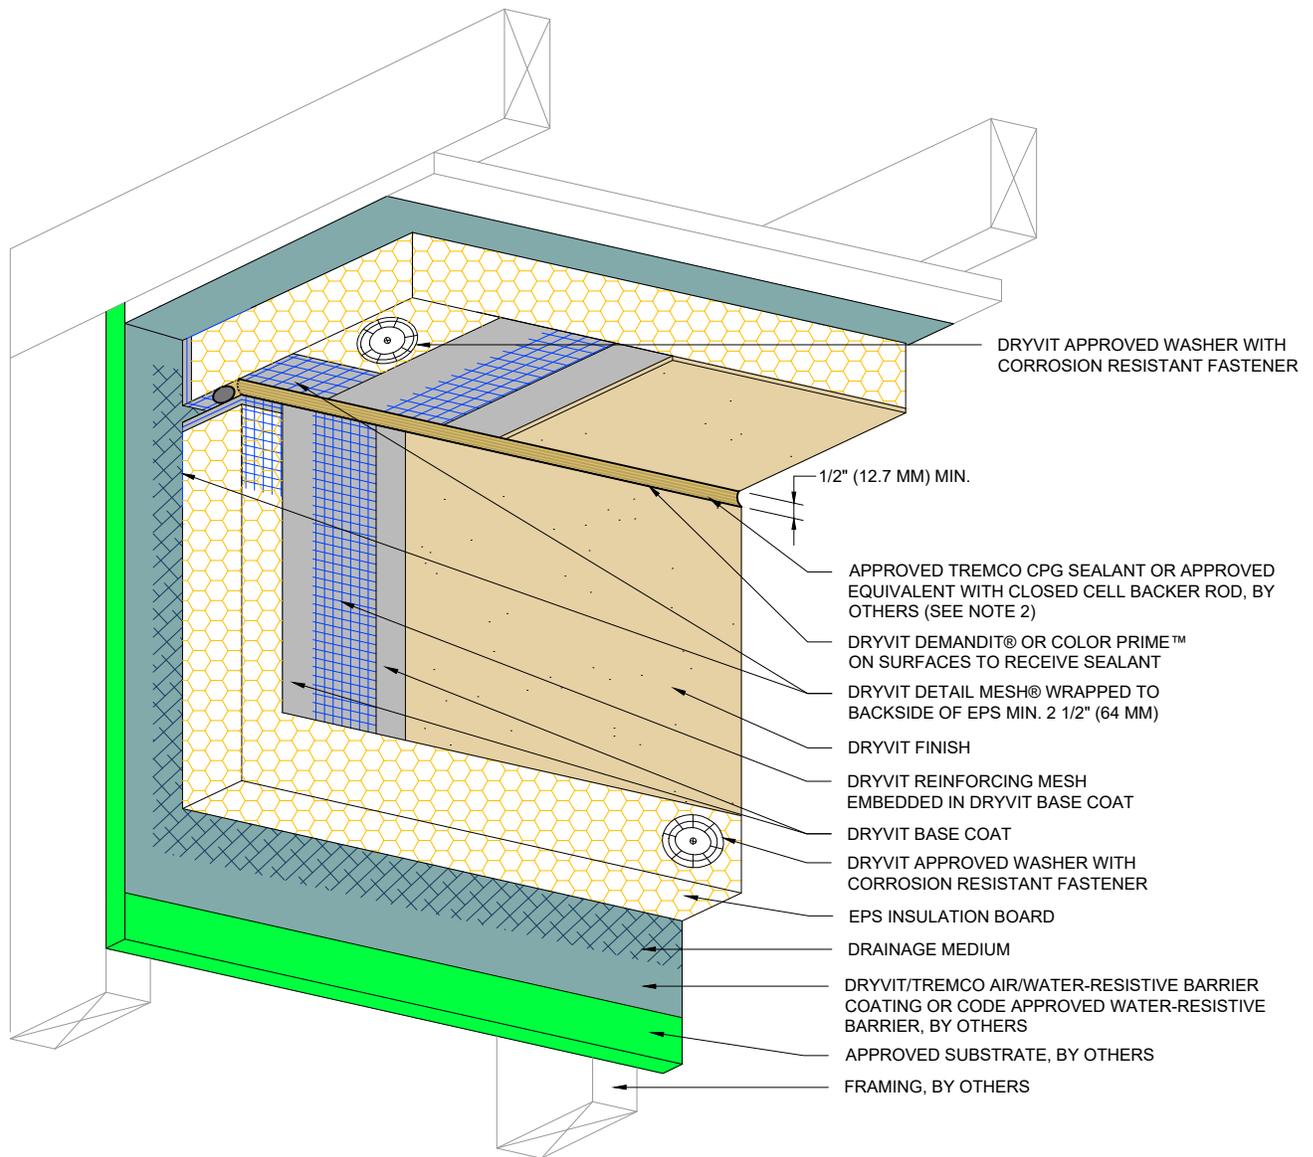


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. DRYVIT DEMANDIT® OR COLOR PRIME™ ON SURFACES TO RECEIVE SEALANT.
3. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
4. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

 Dryvit Technical Support: 800-556-7752	Detail: Vertical Wall / Suspended Soffit Transition				File Name:		 Construction Products Group
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 29		
www.tremcocpg.com							

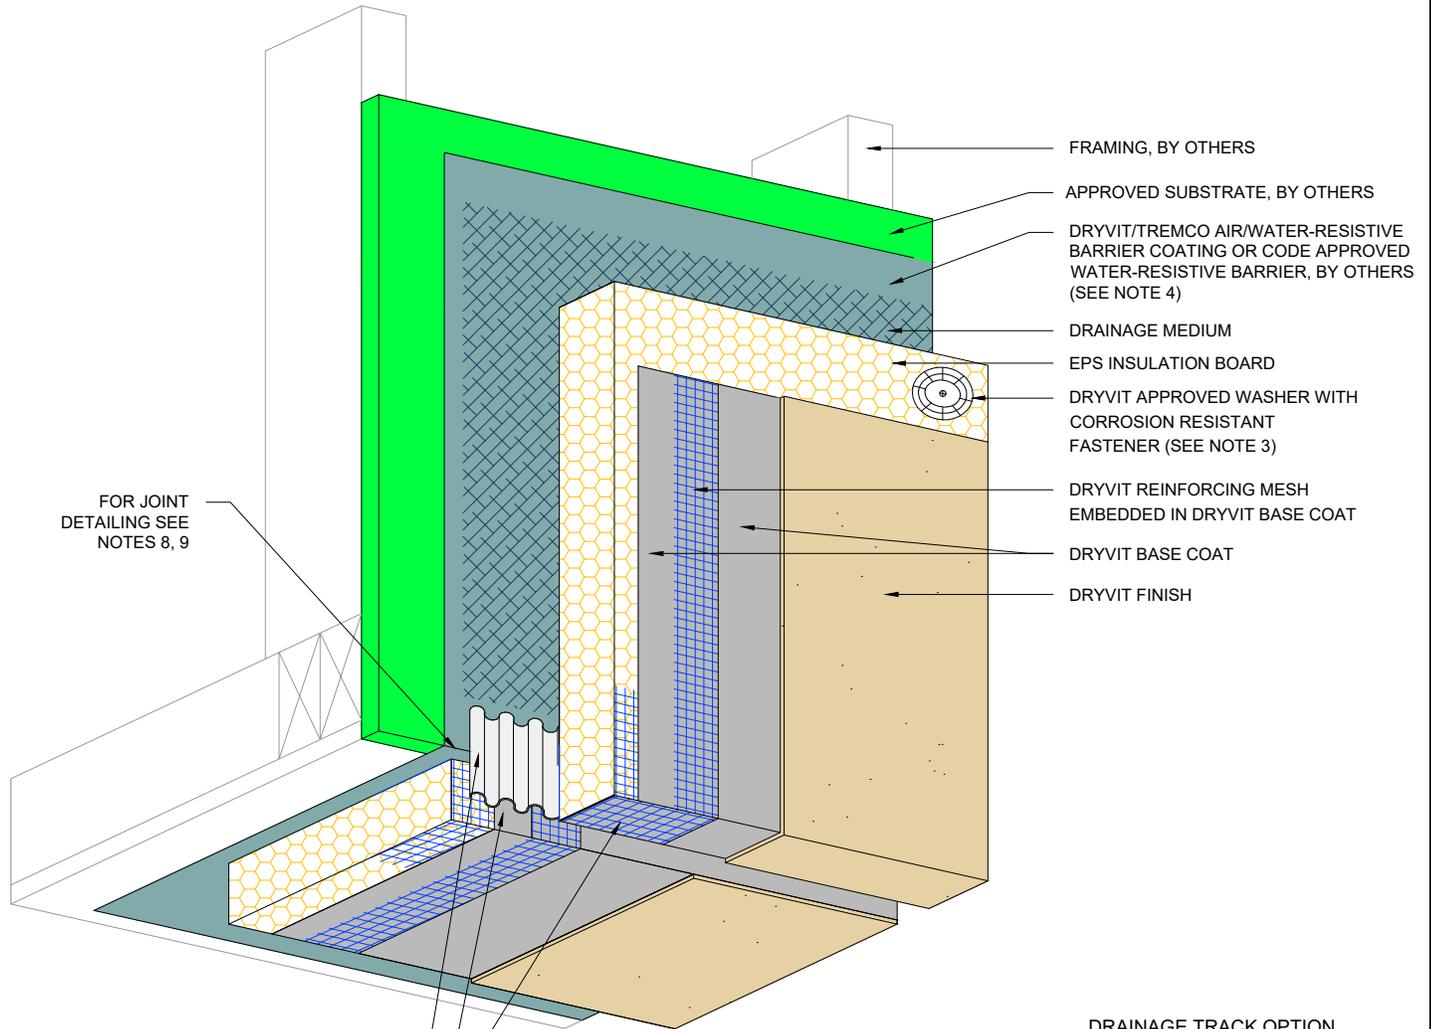

FOR JOINT
DETAILING SEE
NOTES 8, 9

- FRAMING, BY OTHERS
- APPROVED SUBSTRATE, BY OTHERS
- DRYVIT/TREMCO AIR/WATER-RESISTIVE BARRIER COATING OR CODE APPROVED WATER-RESISTIVE BARRIER, BY OTHERS (SEE NOTE 4)
- DRAINAGE MEDIUM
- EPS INSULATION BOARD
- DRYVIT APPROVED WASHER WITH CORROSION RESISTANT FASTENER (SEE NOTE 3)
- DRYVIT REINFORCING MESH EMBEDDED IN DRYVIT BASE COAT
- DRYVIT BASE COAT
- DRYVIT FINISH

FOR JOINT
DETAILING SEE
NOTES 8, 9

DRYVIT DRAINAGE STRIP™
(SEE NOTE 2)

DRYVIT DETAIL MESH® WRAPPED
TO BACKSIDE OF EPS MIN. 2 1/2" (64 MM)

DRAINAGE TRACK OPTION
(SEE NOTES 6, 7)

DRYVIT AQUAFASH® SYSTEM,
DRYVIT BACKSTOP® FLASH AND
FILL, OR TREMCO DYMONIC 100
(SEE NOTES 8, 9)

FOR JOINT
DETAILING
SEE NOTES 8, 9

APPROVED TREMCO CPG
SEALANT OR APPROVED
EQUIVALENT WITH BOND
BREAKER, BY OTHERS

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. ENSURE BOTTOM EDGE OF DRAINAGE STRIP IS LEFT FREE TO DRAIN.
3. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
4. CODE APPROVED WATER-RESISTIVE BARRIER IS REQUIRED OVER VERTICAL SUBSTRATES, APPLICATION OVER HORIZONTAL SOFFIT SUBSTRATE IS OPTIONAL.
5. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
6. LIGHTLY SAND SURFACE OF DRAINAGE TRACK TO MAXIMIZE ADHESION.
7. IF PROJECT IS DEFINED AS NON-COMBUSTIBLE, DRAINAGE TRACK USAGE IS LIMITED TO THE BASE OF THE SYSTEM AT FINISHED GRADE LEVEL.
8. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
9. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outulation® RMD System™



Dryvit Technical Support: 800-556-7752

Detail: Transition at Soffit / Fascia Intersection

Drawn by: HDE

Checked by: CS

Scale: NTS

Date: 5/19/2023


File Name:

O-RMD 30



Construction Products Group

www.tremcocpg.com

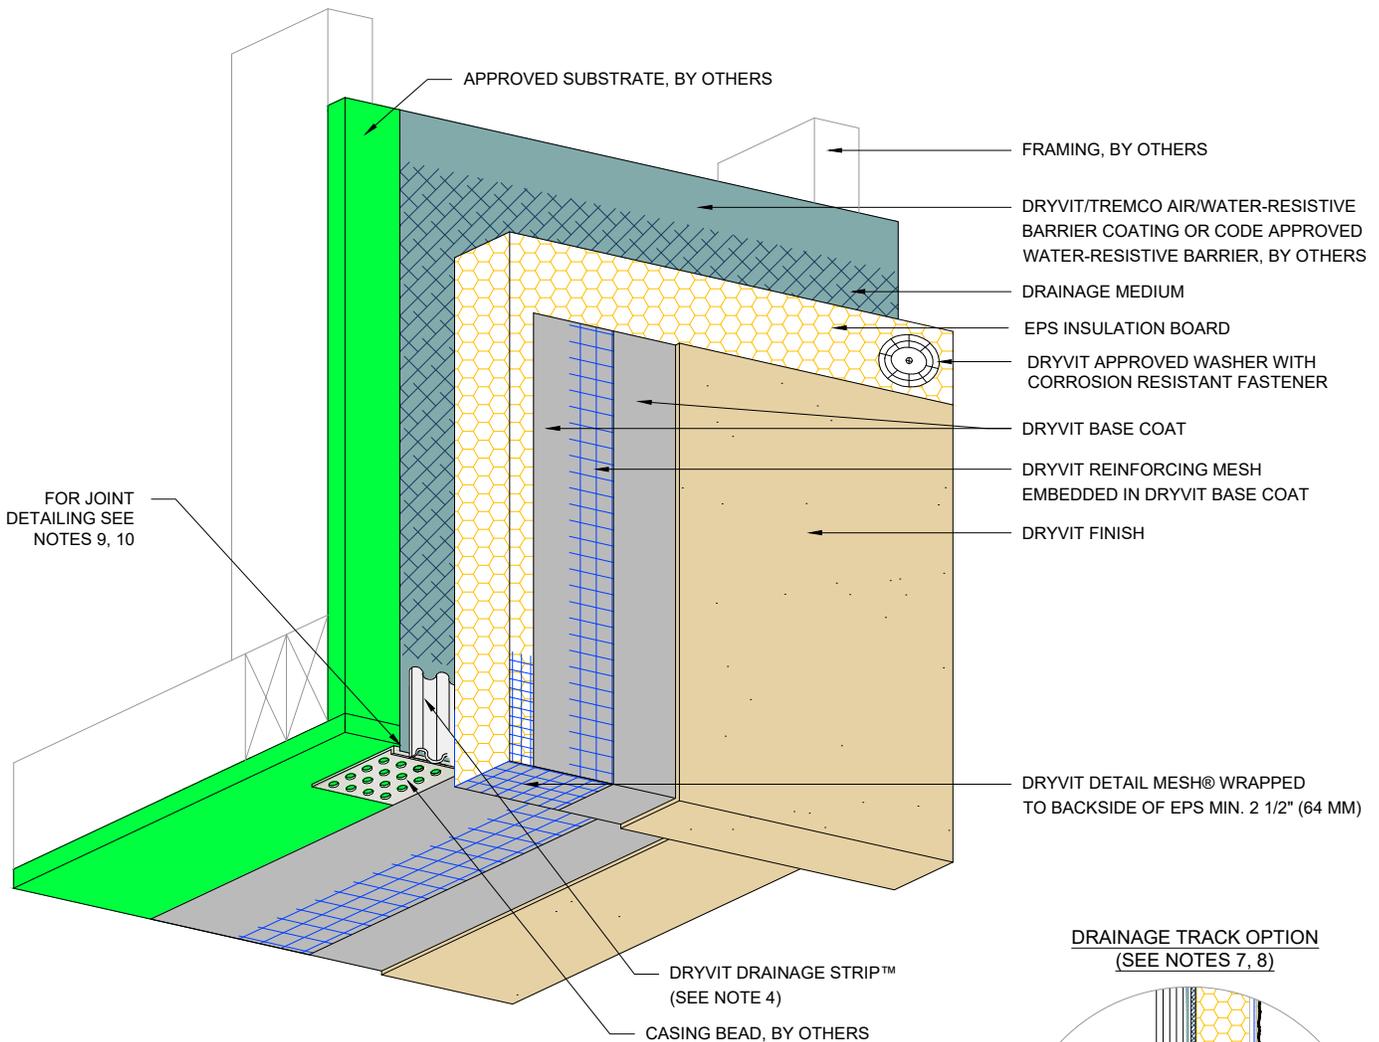


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. SOFFITS WITHOUT EPS INSULATION REQUIRE EXPANSION JOINTS EVERY 20 FT (6 M).
3. REFER TO DRYVIT PUBLICATION DS 173 FOR SPECIFIC REQUIREMENTS FOR SOFFIT AREAS.
4. BOTTOM EDGE OF DRYVIT DRAINAGE STRIP SHALL BE MASKED DURING INSTALLATION TO PREVENT CLOGGING OF DRAINAGE CHANNELS.
5. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
6. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
7. LIGHTLY SAND SURFACE OF DRAINAGE TRACK TO MAXIMIZE ADHESION.
8. IF PROJECT IS DEFINED AS NON-COMBUSTIBLE, DRAINAGE TRACK USAGE IS LIMITED TO THE BASE OF THE SYSTEM AT FINISHED GRADE LEVEL.
9. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
10. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

 Dryvit Technical Support: 800-556-7752	Detail: Fascia / Uninsulated Soffit Transition				File Name:		 Construction Products Group
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 31		
www.tremcocpg.com							

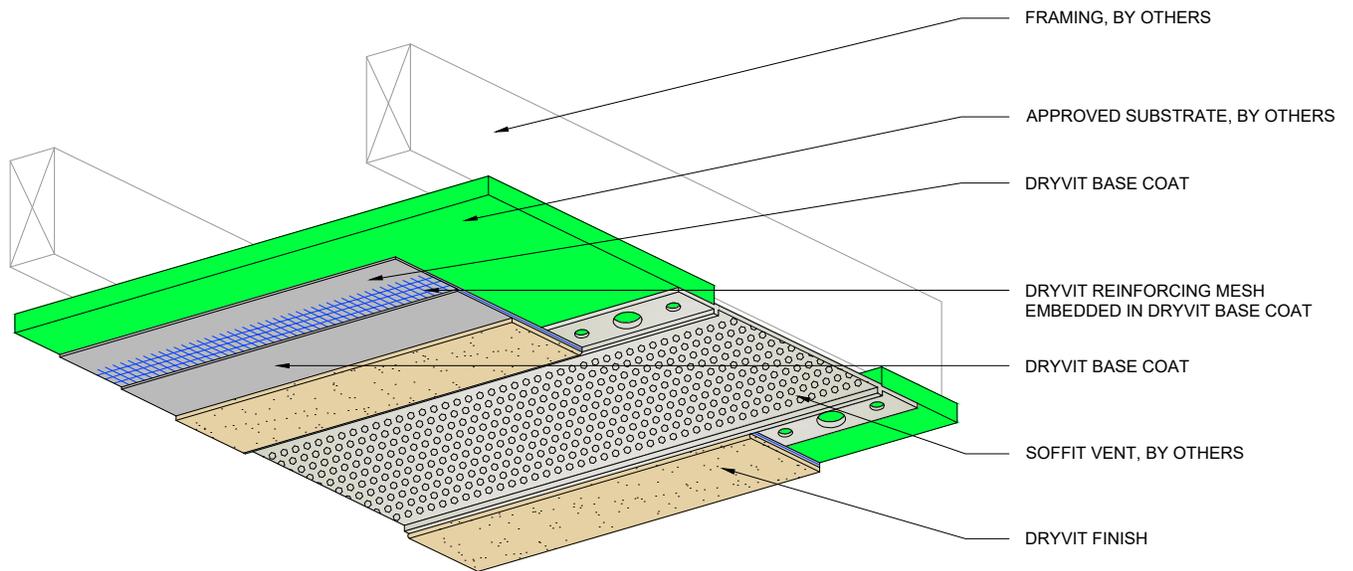



NOTE:

1. CONTROL JOINTS ARE RECOMMENDED EVERY 20 FT (6.1 M).
2. REFER TO DRYVIT PUBLICATION DS173 FOR SPECIFIC REQUIREMENTS FOR SOFFIT AREAS.
3. SEAL ALL BUTT JOINTS, INTERSECTIONS, AND ENDS OF VENTS WITH COMPATIBLE SEALANT.
4. SEE DRYVIT PUBLICATION DS842 FOR ADDITIONAL DIRECT APPLIED DETAILS.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

 Dryvit Technical Support: 800-556-7752	Detail: Termination at Uninsulated Soffit Vent				File Name:		 Construction Products Group
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 32		
www.tremcocpg.com							

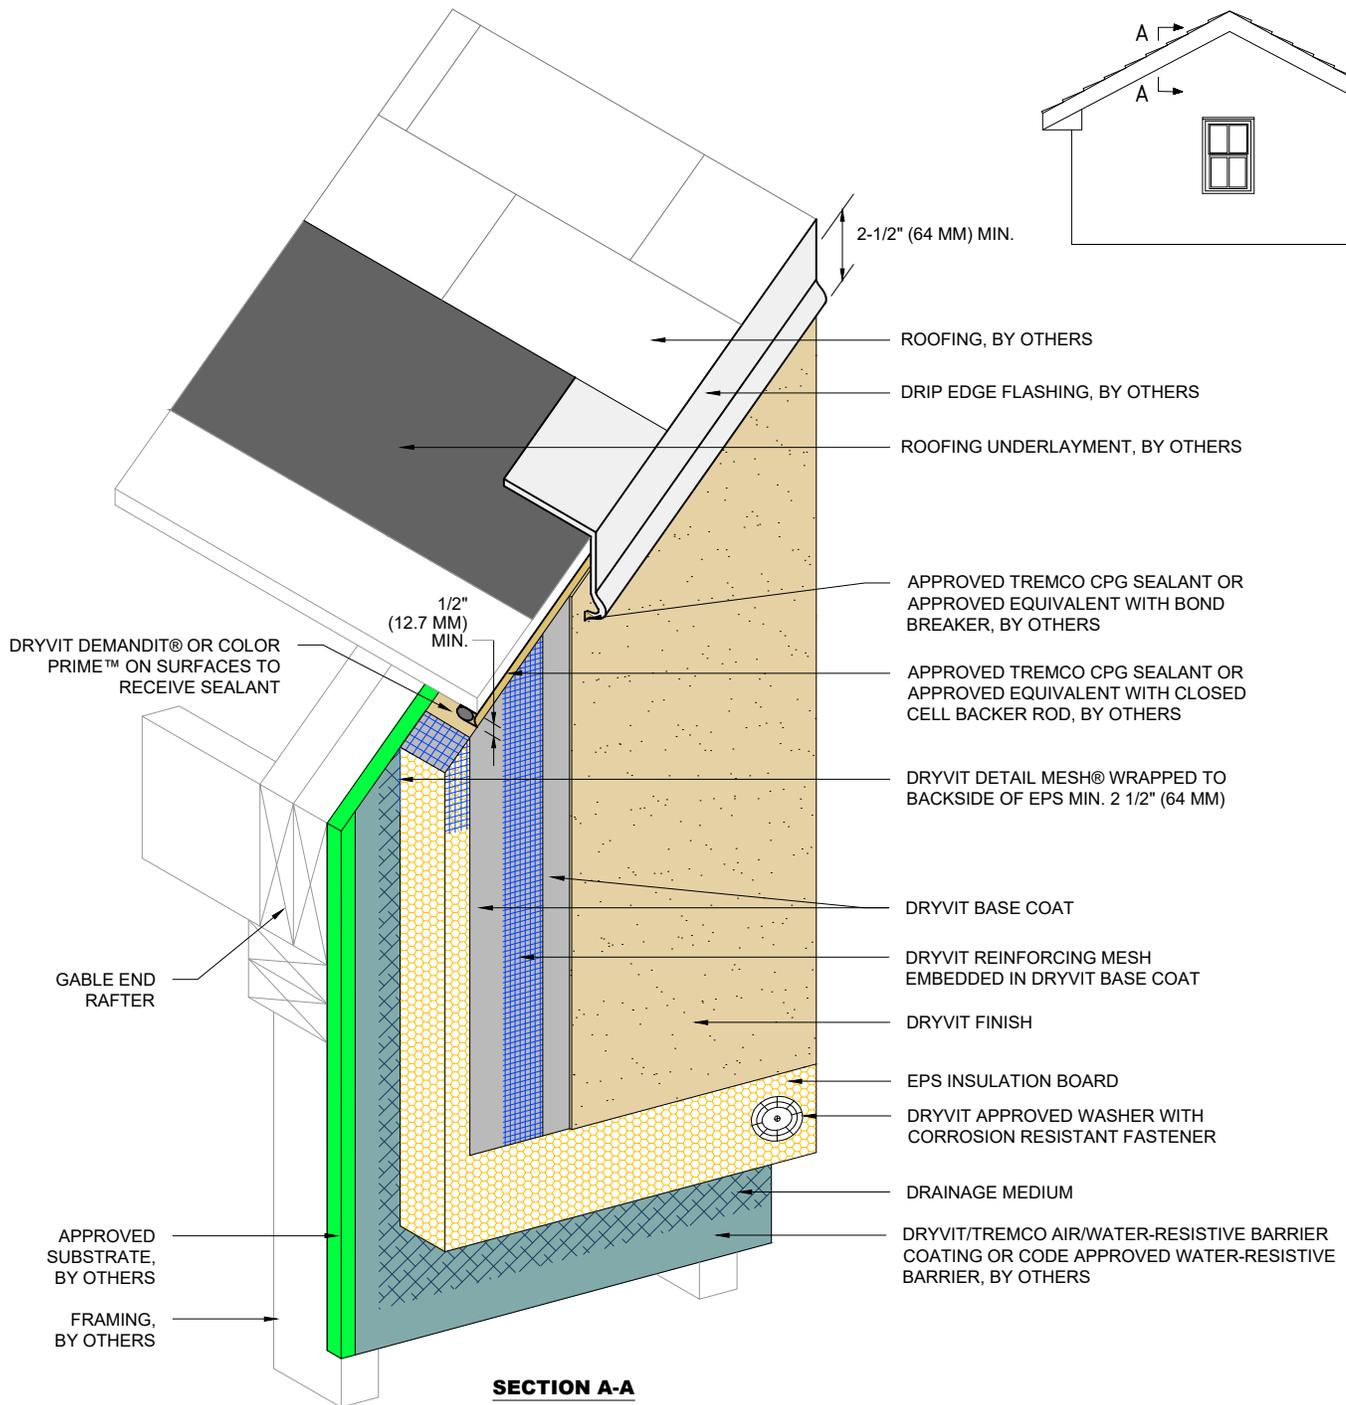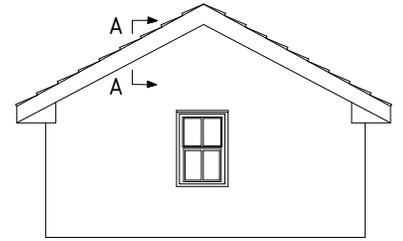

SECTION A-A


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
3. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
4. FOR RAKE WITH OVERHANG REFER TO ORMD 27 AND 28.
5. FOR EPS THICKNESS EXCEEDING 2-1/2" (64 MM), BLOCKING SHOULD BE PROVIDED TO STRUCTURALLY SUPPORT THE ROOF SHEATHING.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

 Dryvit Technical Support: 800-556-7752	Detail: Gable End				File Name:		 Construction Products Group
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 33		
www.tremcocpg.com							

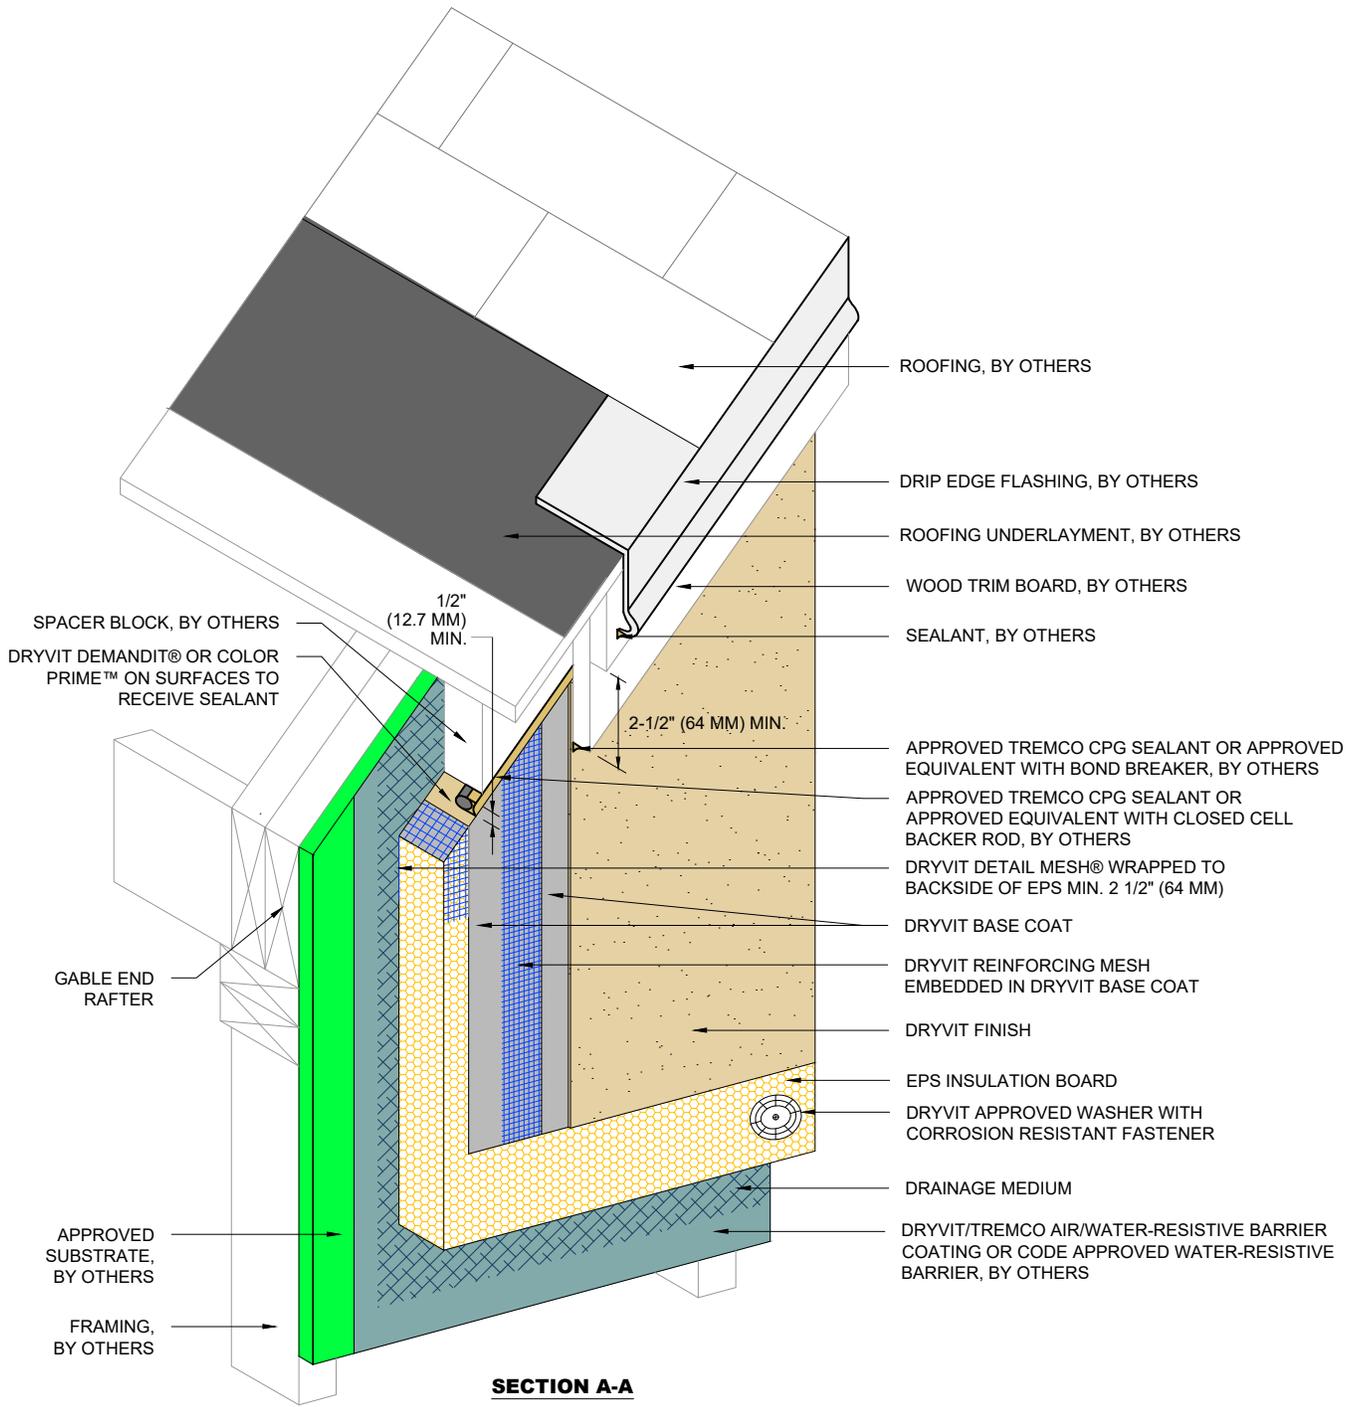

SECTION A-A


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
3. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
4. FOR RAKE WITH OVERHANG REFER TO ORMD 27 AND 28.
5. FOR EPS THICKNESS EXCEEDING 2-1/2" (64 MM), BLOCKING SHOULD BE PROVIDED TO STRUCTURALLY SUPPORT THE ROOF SHEATHING.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

 Dryvit Technical Support: 800-556-7752	Detail: Gable End with Wood Trim				File Name:		 Construction Products Group
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/19/2023	O-RMD 34		
www.tremcocpg.com							

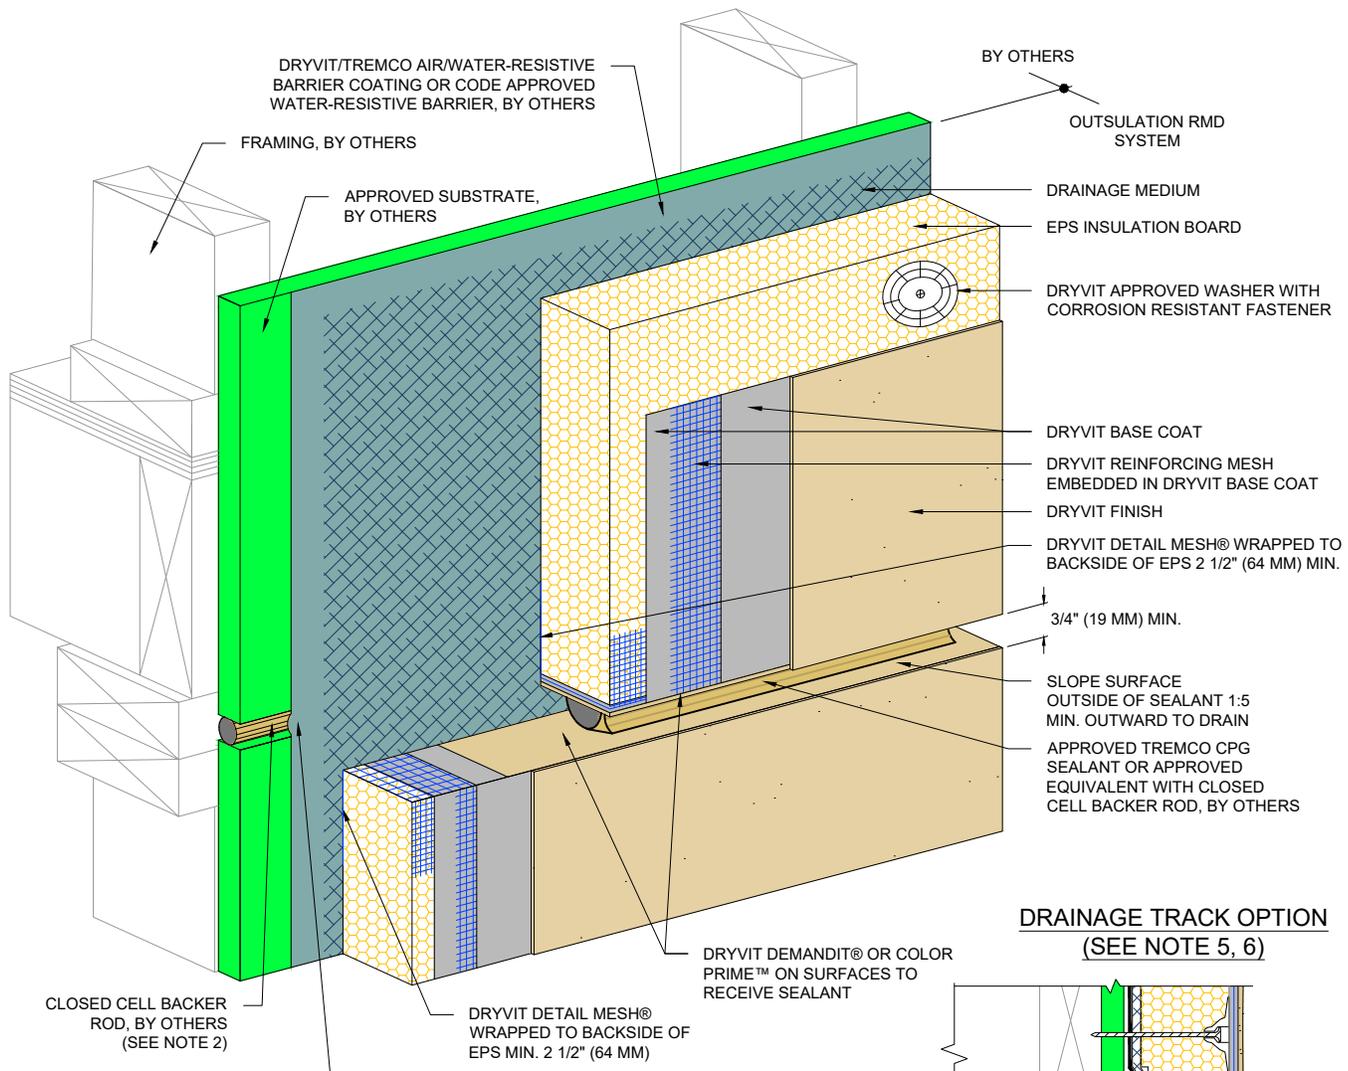


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. FOR WOOD FRAMED CONSTRUCTION: EXPANSION JOINT IS INTENDED TO ACCOMMODATE CROSS GRAIN SHRINKAGE FOR FLOOR BEAMS. LOCATE EXTERNAL SEALANT JOINT APPROXIMATELY 1" (25 MM) BELOW SHEATHING GAP.
3. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
4. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
5. LIGHTLY SAND SURFACE OF DRAINAGE TRACK TO MAXIMIZE ADHESION.
6. IF PROJECT IS DEFINED AS NON-COMBUSTIBLE, DRAINAGE TRACK USAGE IS LIMITED TO THE BASE OF THE SYSTEM AT FINISHED GRADE LEVEL.
7. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
8. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™


<p style="font-size: 8px; margin-top: 5px;">Dryvit Technical Support: 800-556-7752</p>	Detail: Horizontal Joint at Floor Line				File Name:		<p style="font-size: 8px; margin-top: 5px;">Construction Products Group</p>
	Drawn by: HDE	Checked by: CS	Scale: NTS	Date: 5/25/2023	O-RMD 35		
www.tremcopp.com							

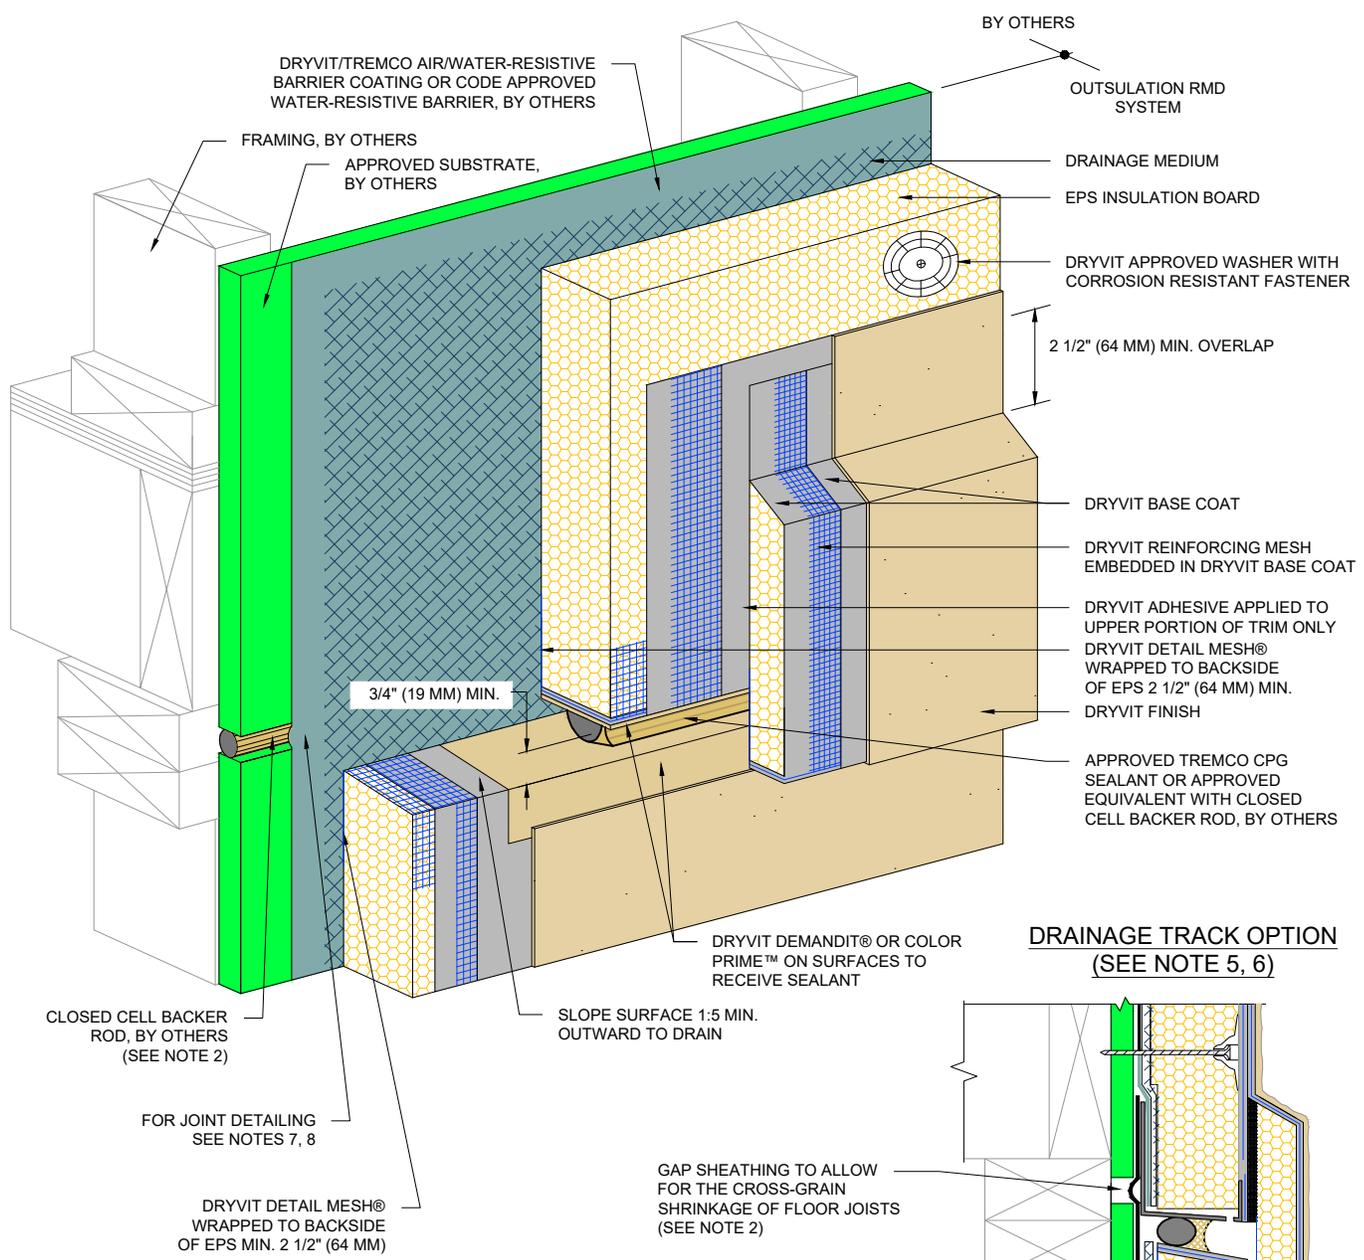

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. FOR WOOD FRAMED CONSTRUCTION: EXPANSION JOINT IS INTENDED TO ACCOMMODATE CROSS GRAIN SHRINKAGE FOR FLOOR BEAMS. LOCATE EXTERNAL SEALANT JOINT APPROXIMATELY 1" (25 MM) BELOW SHEATHING GAP.
3. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
4. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
5. LIGHTLY SAND SURFACE OF DRAINAGE TRACK TO MAXIMIZE ADHESION.
6. IF PROJECT IS DEFINED AS NON-COMBUSTIBLE, DRAINAGE TRACK USAGE IS LIMITED TO THE BASE OF THE SYSTEM AT FINISHED GRADE LEVEL.
7. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
8. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.


LEAVE MIN. 1/8" (3MM) GAP TO ALLOW FOR DRAINAGE

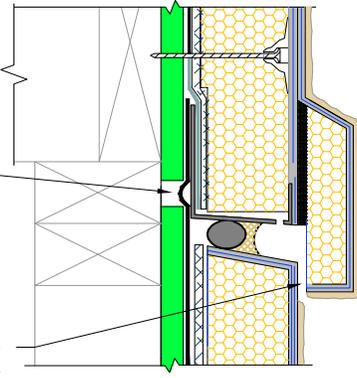

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

<p style="font-size: 8px; margin-top: 5px;">Dryvit Technical Support: 800-556-7752</p>	Detail: Concealed Floor Line Expansion Joint	File Name:	<p style="font-size: 8px; margin-top: 5px;">Construction Products Group</p>
	Drawn by: HDE Checked by: CS Scale: NTS Date: 5/25/2023	O-RMD 36	
www.tremcocpg.com			

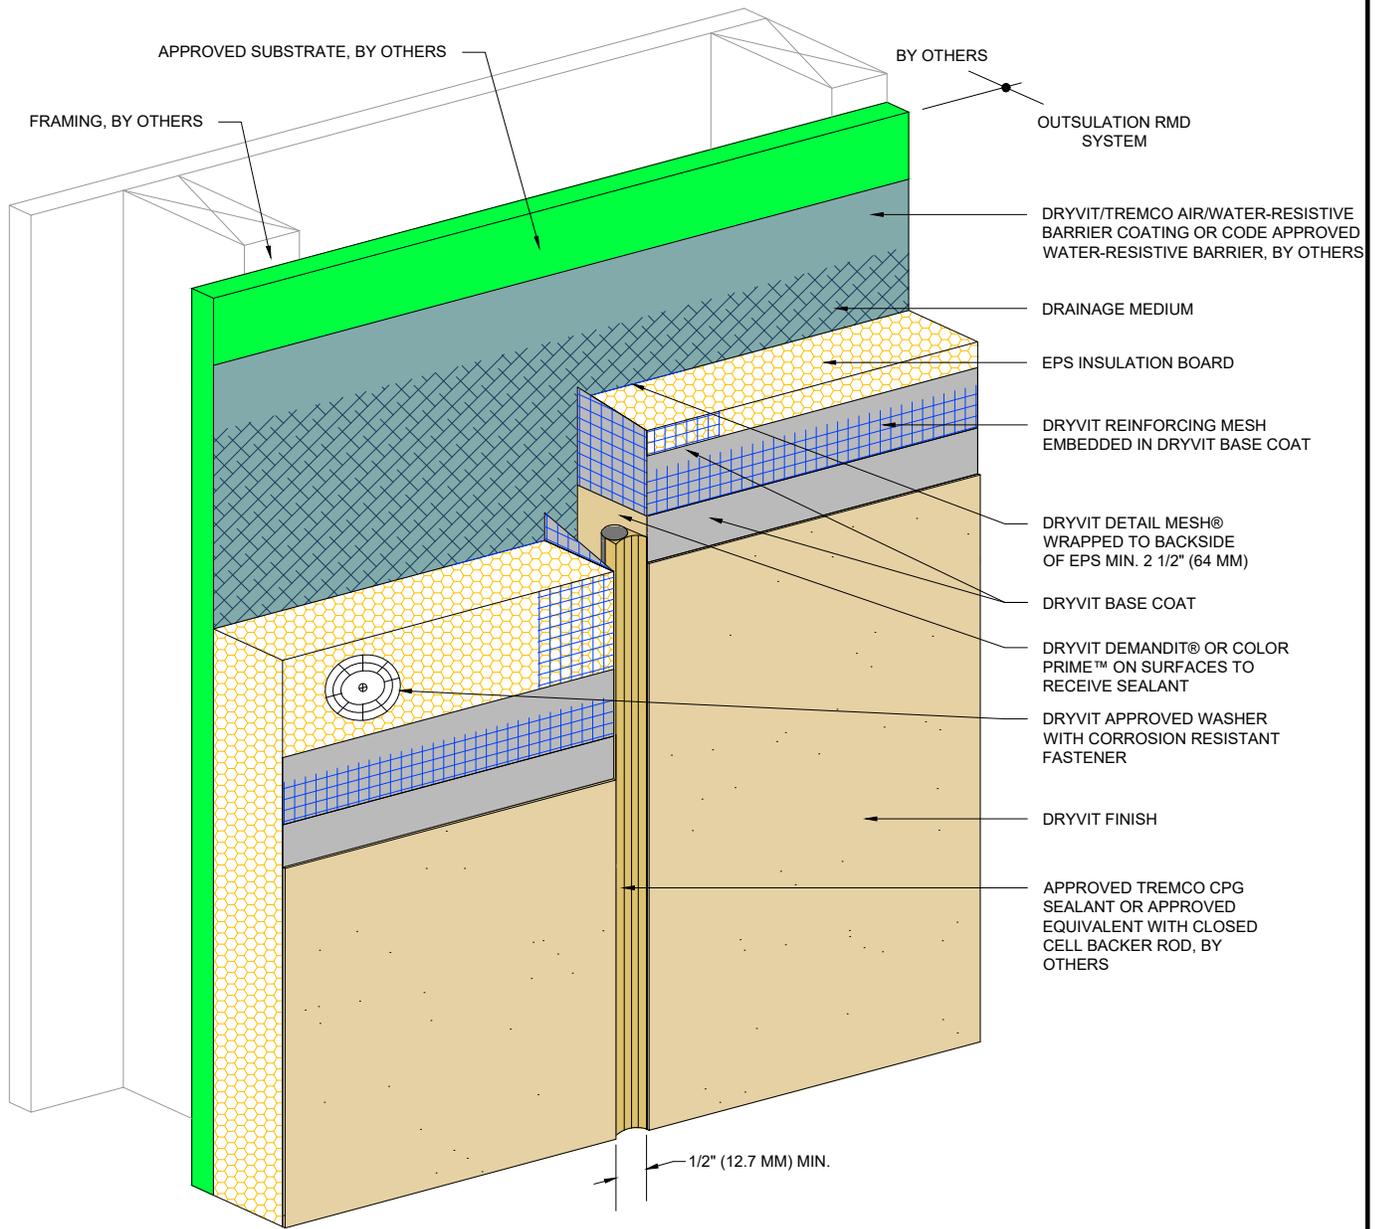

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. EIFS EXPANSION JOINTS ARE REQUIRED IN CONTINUOUS ELEVATIONS AT INTERVALS NOT EXCEEDING 75 FT (23 M).
3. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
4. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™



Dryvit Technical Support: 800-556-7752

Detail: Vertical Expansion Joint - EIFS²

Drawn by: HDE

Checked by: CS

Scale: NTS

Date: 5/19/2023


File Name:

O-RMD 37




Construction Products Group

www.tremcocpg.com

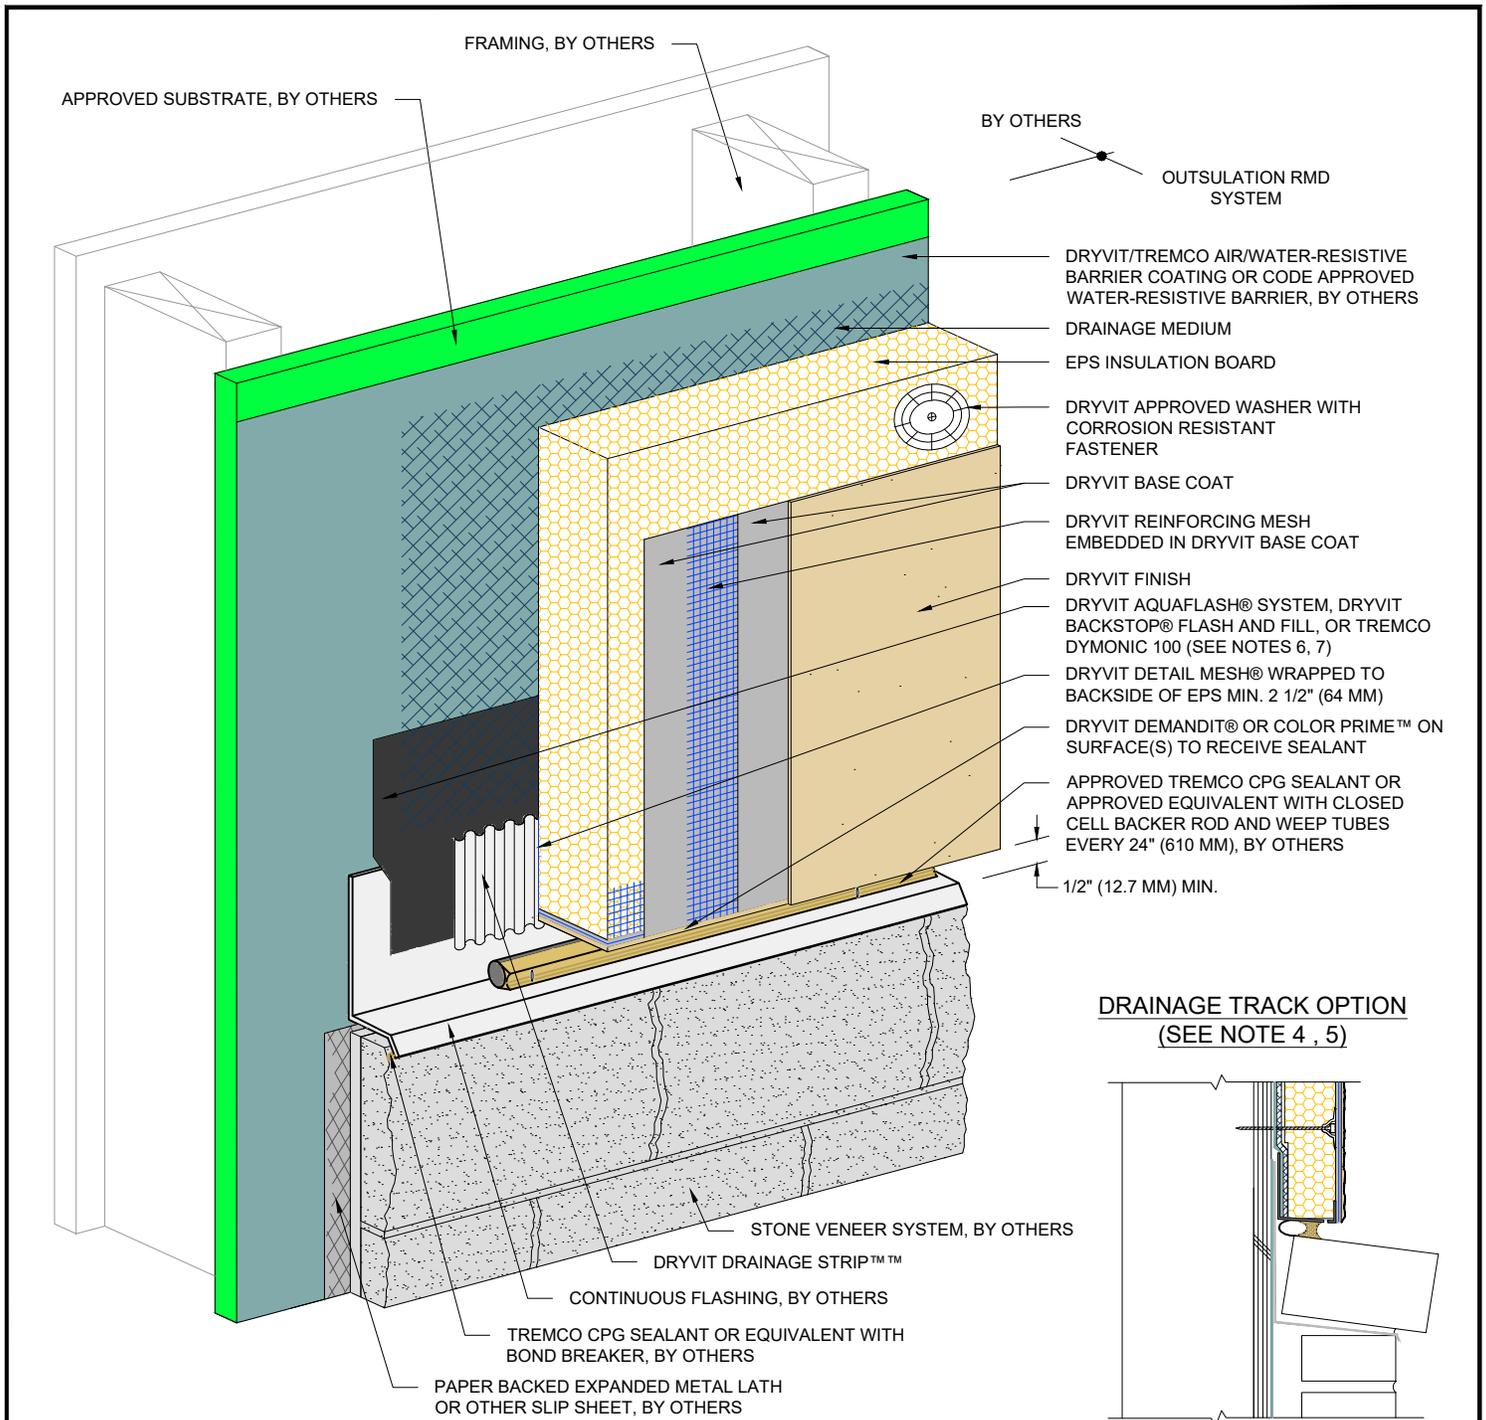

**DRAINAGE TRACK OPTION
(SEE NOTE 4, 5)**

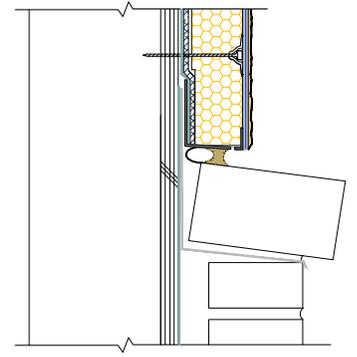


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
3. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
4. LIGHTLY SAND SURFACE OF DRAINAGE TRACK TO MAXIMIZE ADHESION.
5. IF PROJECT IS DEFINED AS NON-COMBUSTIBLE, DRAINAGE TRACK USAGE IS LIMITED TO THE BASE OF THE SYSTEM AT FINISHED GRADE LEVEL.
6. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
7. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

<p style="font-size: 8px; margin-top: 5px;">Dryvit Technical Support: 800-556-7752</p>	Detail: Horizontal Termination at Stone Veneer	File Name:	O-RMD 38	<p style="font-size: 8px; margin-top: 5px;">Construction Products Group</p>
	Drawn by: HDE Checked by: CS Scale: NTS Date: 5/19/2023	www.tremcocpg.com		

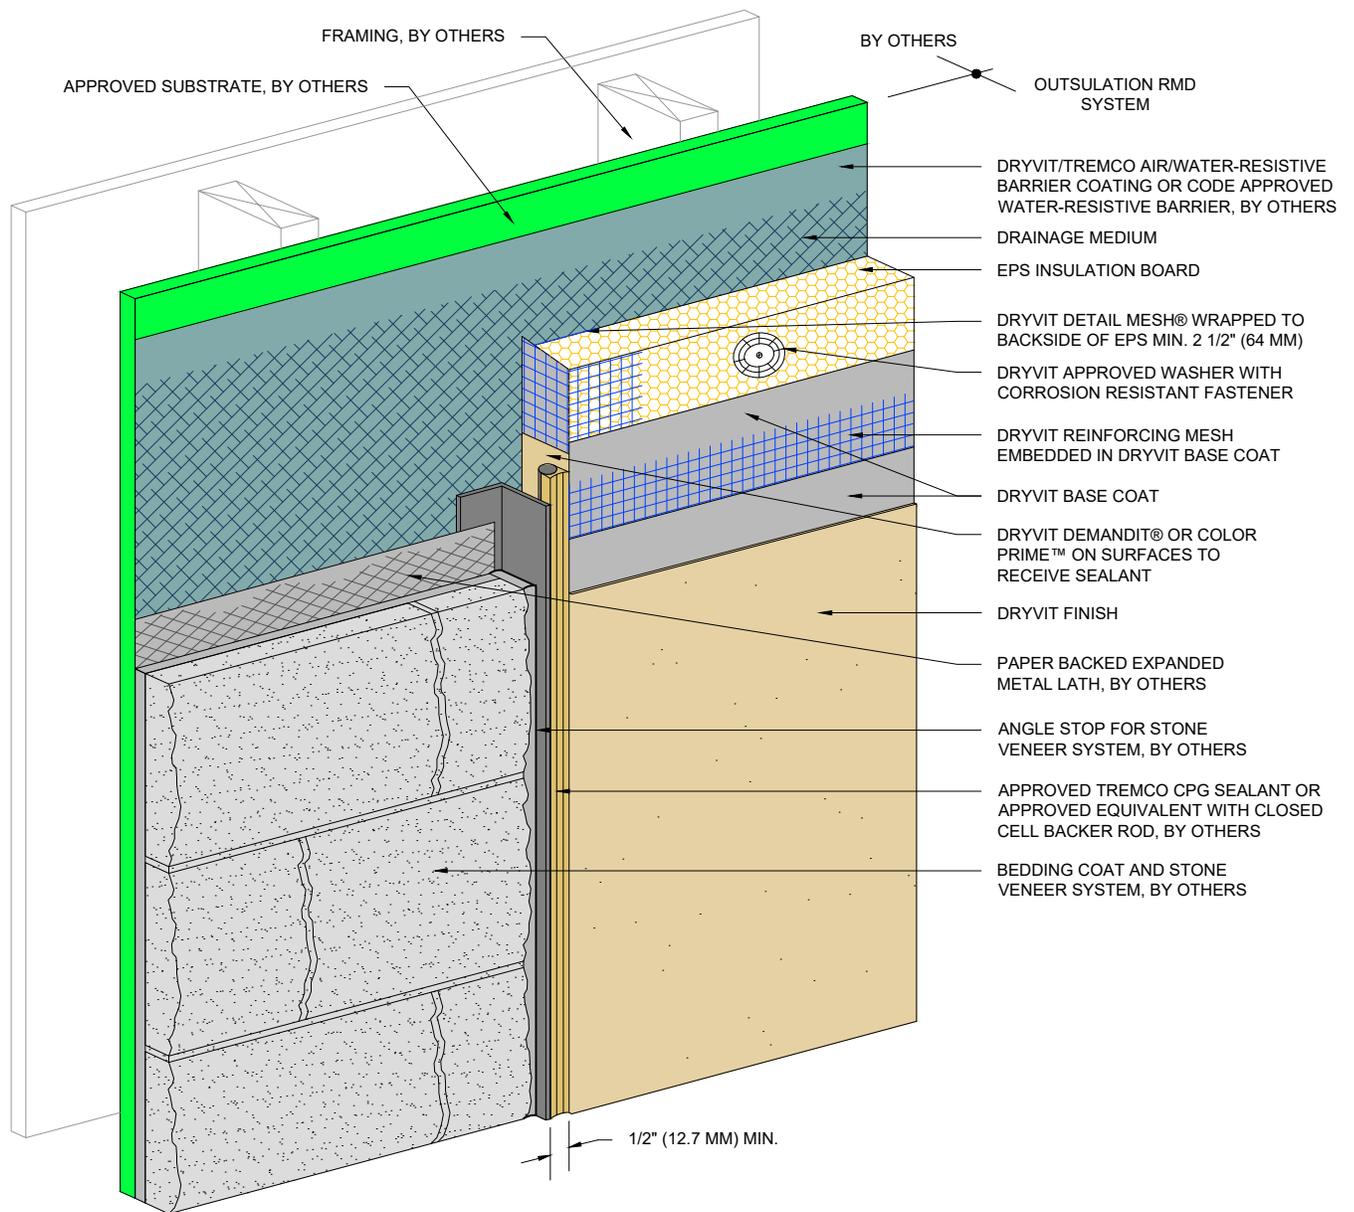

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
3. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™



Dryvit Technical Support: 800-556-7752

Detail: Vertical Termination at Stone Veneer

Drawn by: HDE

Checked by: KK

Scale: NTS

Date: 5/19/2023


File Name:

O-RMD 39



Construction Products Group

www.tremcocpg.com

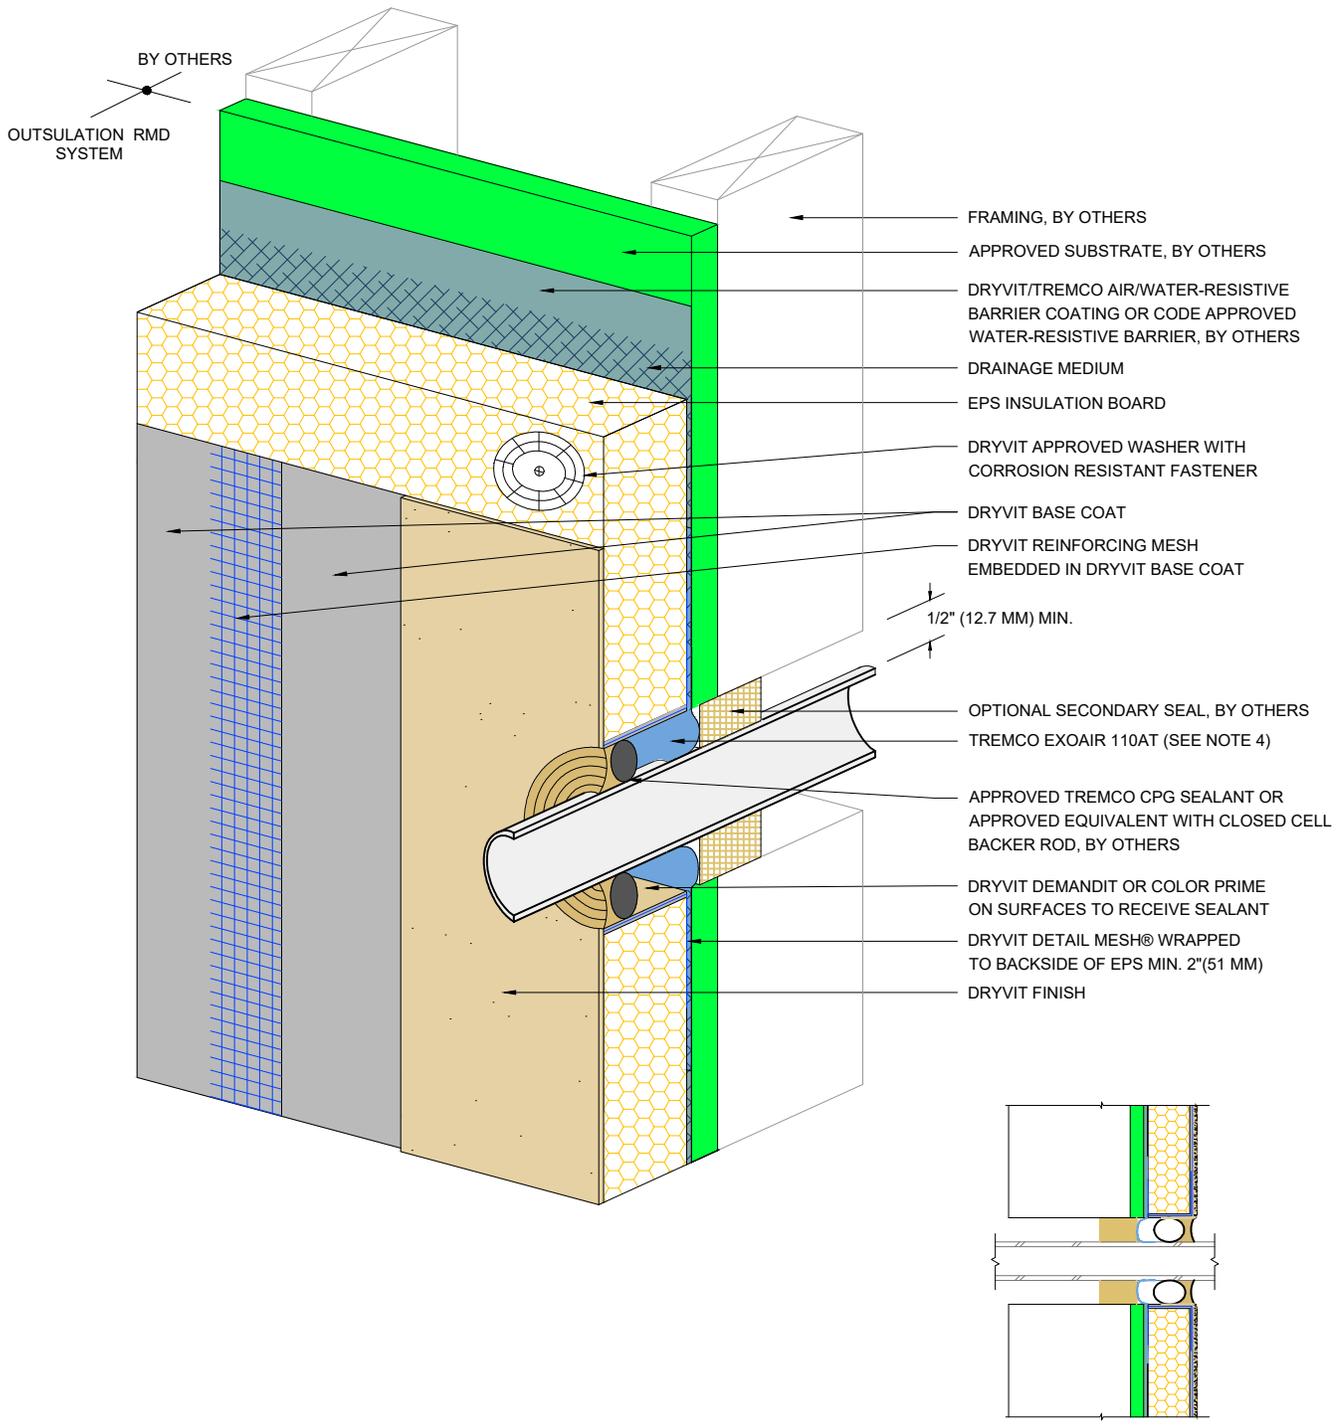


NOTE:
 DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
3. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
4. DRYVIT AQUAFLASH® SYSTEM MAY BE USED IN LIEU OF TREMCO EXOAIR 110AT FOR SYSTEM 4.


The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™


 Dryvit Technical Support: 800-556-7752	Detail: Penetrations	File Name:	 Construction Products Group
	Drawn by: HDE Checked by: KK Scale: NTS Date: 5/19/2023	O-RMD 40	
www.tremcocpg.com			

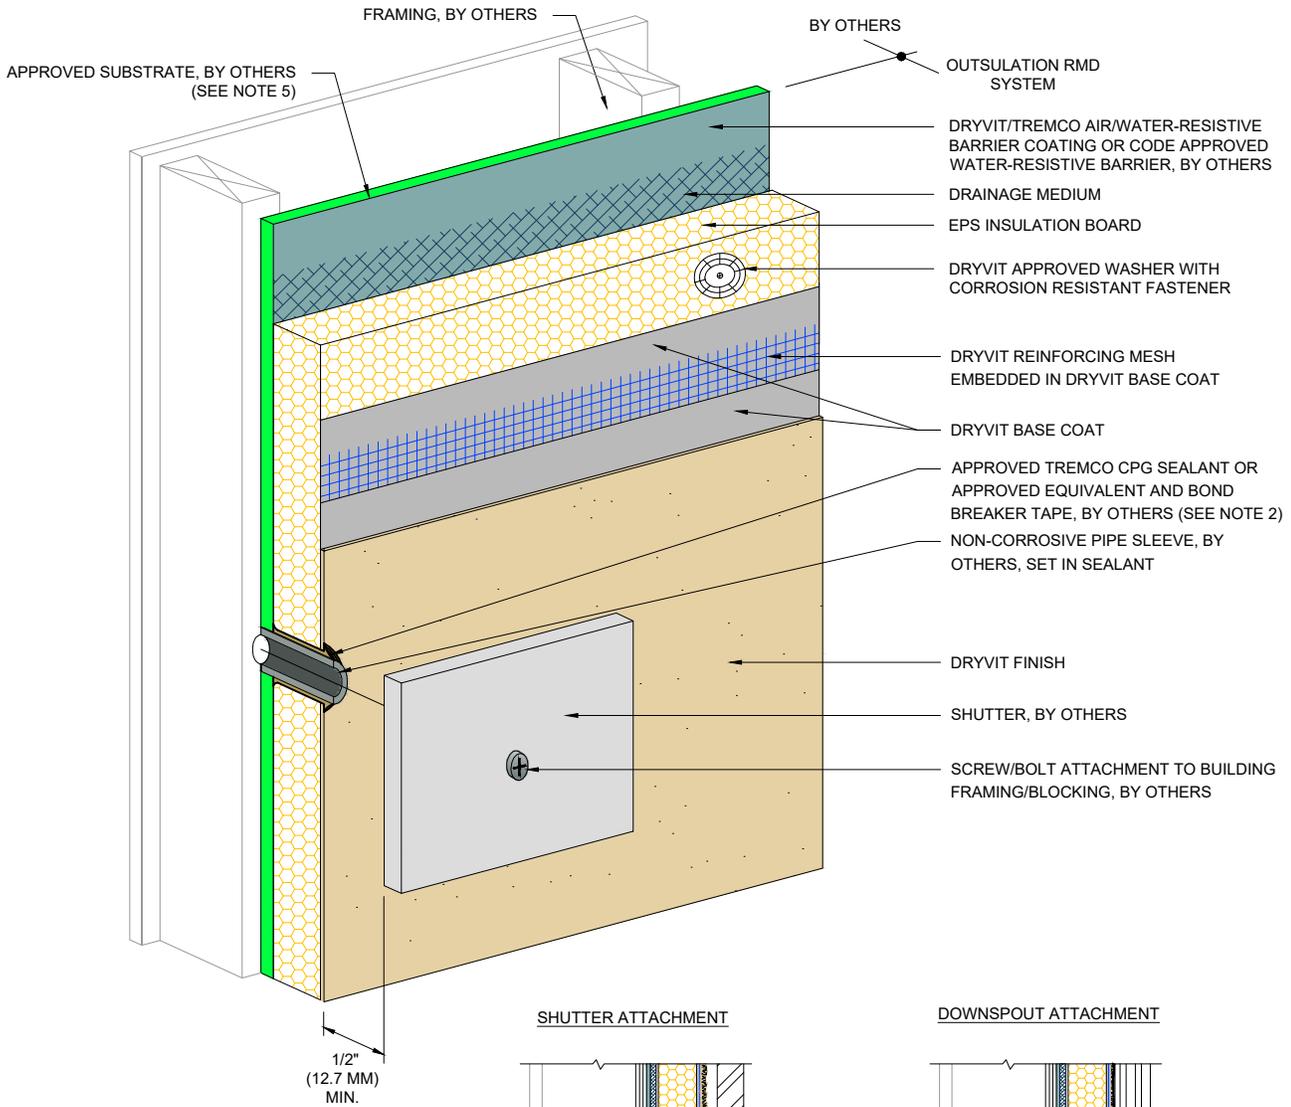

SHUTTER ATTACHMENT



DOWNSPOUT ATTACHMENT

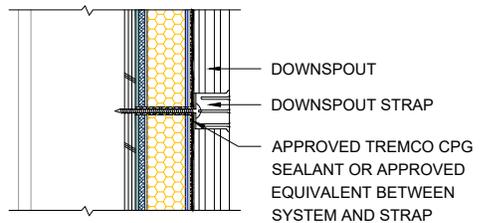



NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. PERIMETER OF PIPE SLEEVE IS SEALED TO PREVENT WATER ENTRY INTO WALL.
3. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
4. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
5. PROVIDE BLOCKING SECURED TO FRAMING WHEN FASTENING BETWEEN STUDS OR WHEN SECURING THROUGH NON-STRUCTURAL SUBSTRATE.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™

<p style="font-size: 8px; margin-top: 5px;">Dryvit Technical Support: 800-556-7752</p>	Detail: Shutter & Downspout Attachment				File Name:		<p style="font-size: 8px; margin-top: 5px;">Construction Products Group</p>
	Drawn by: HDE	Checked by: KK	Scale: NTS	Date: 5/19/2023	O-RMD 41		
www.tremcocpg.com							

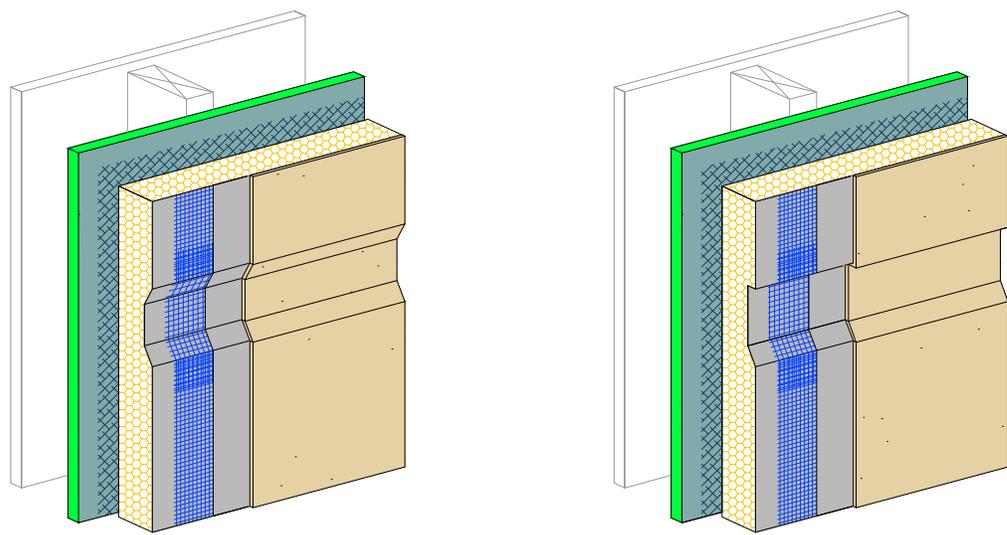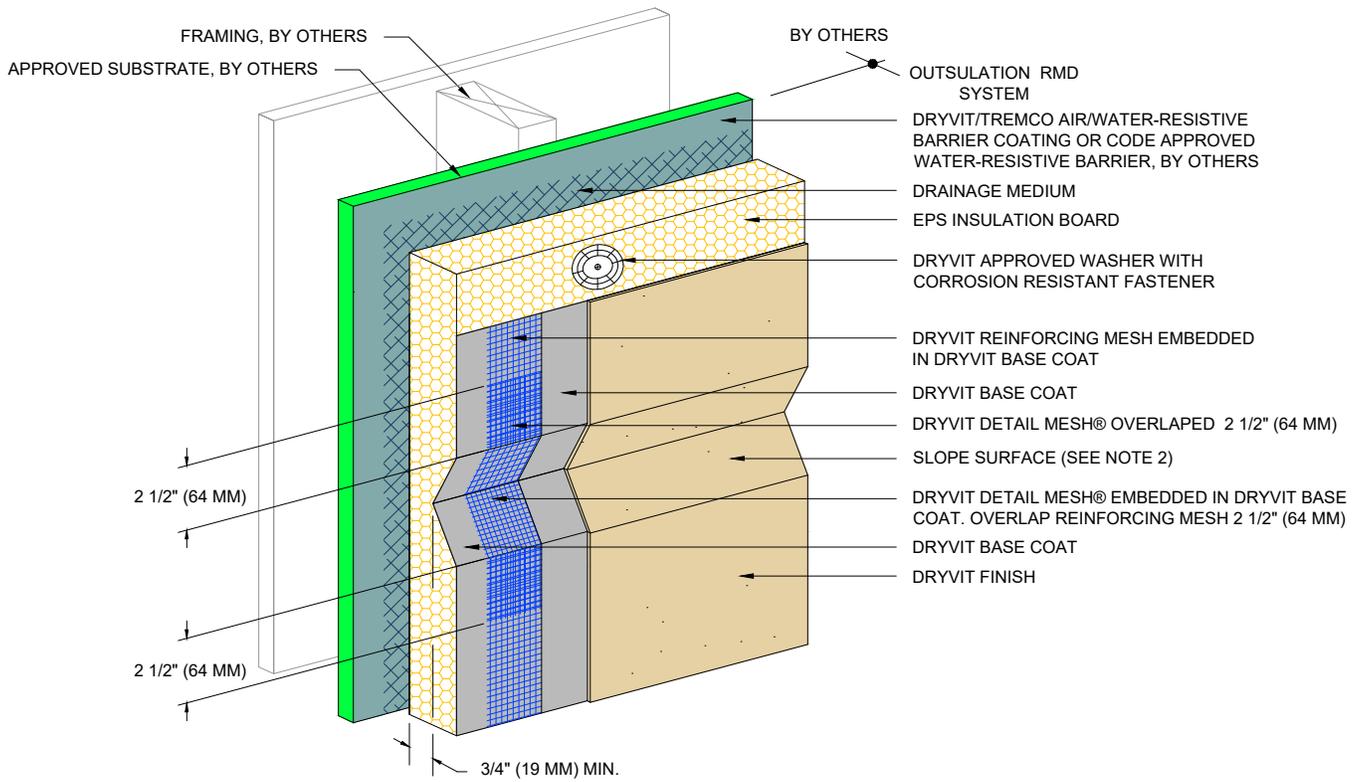

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. SLOPE BOTTOM EDGE OF REVEAL FOR POSITIVE DRAINAGE.
3. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
4. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™



Dryvit Technical Support: 800-556-7752

Detail: Aesthetic Reveals

Drawn by: HDE

Checked by: KK

Scale: NTS

Date: 5/19/2023


File Name:

O-RMD 42



Construction Products Group

www.tremcocpg.com

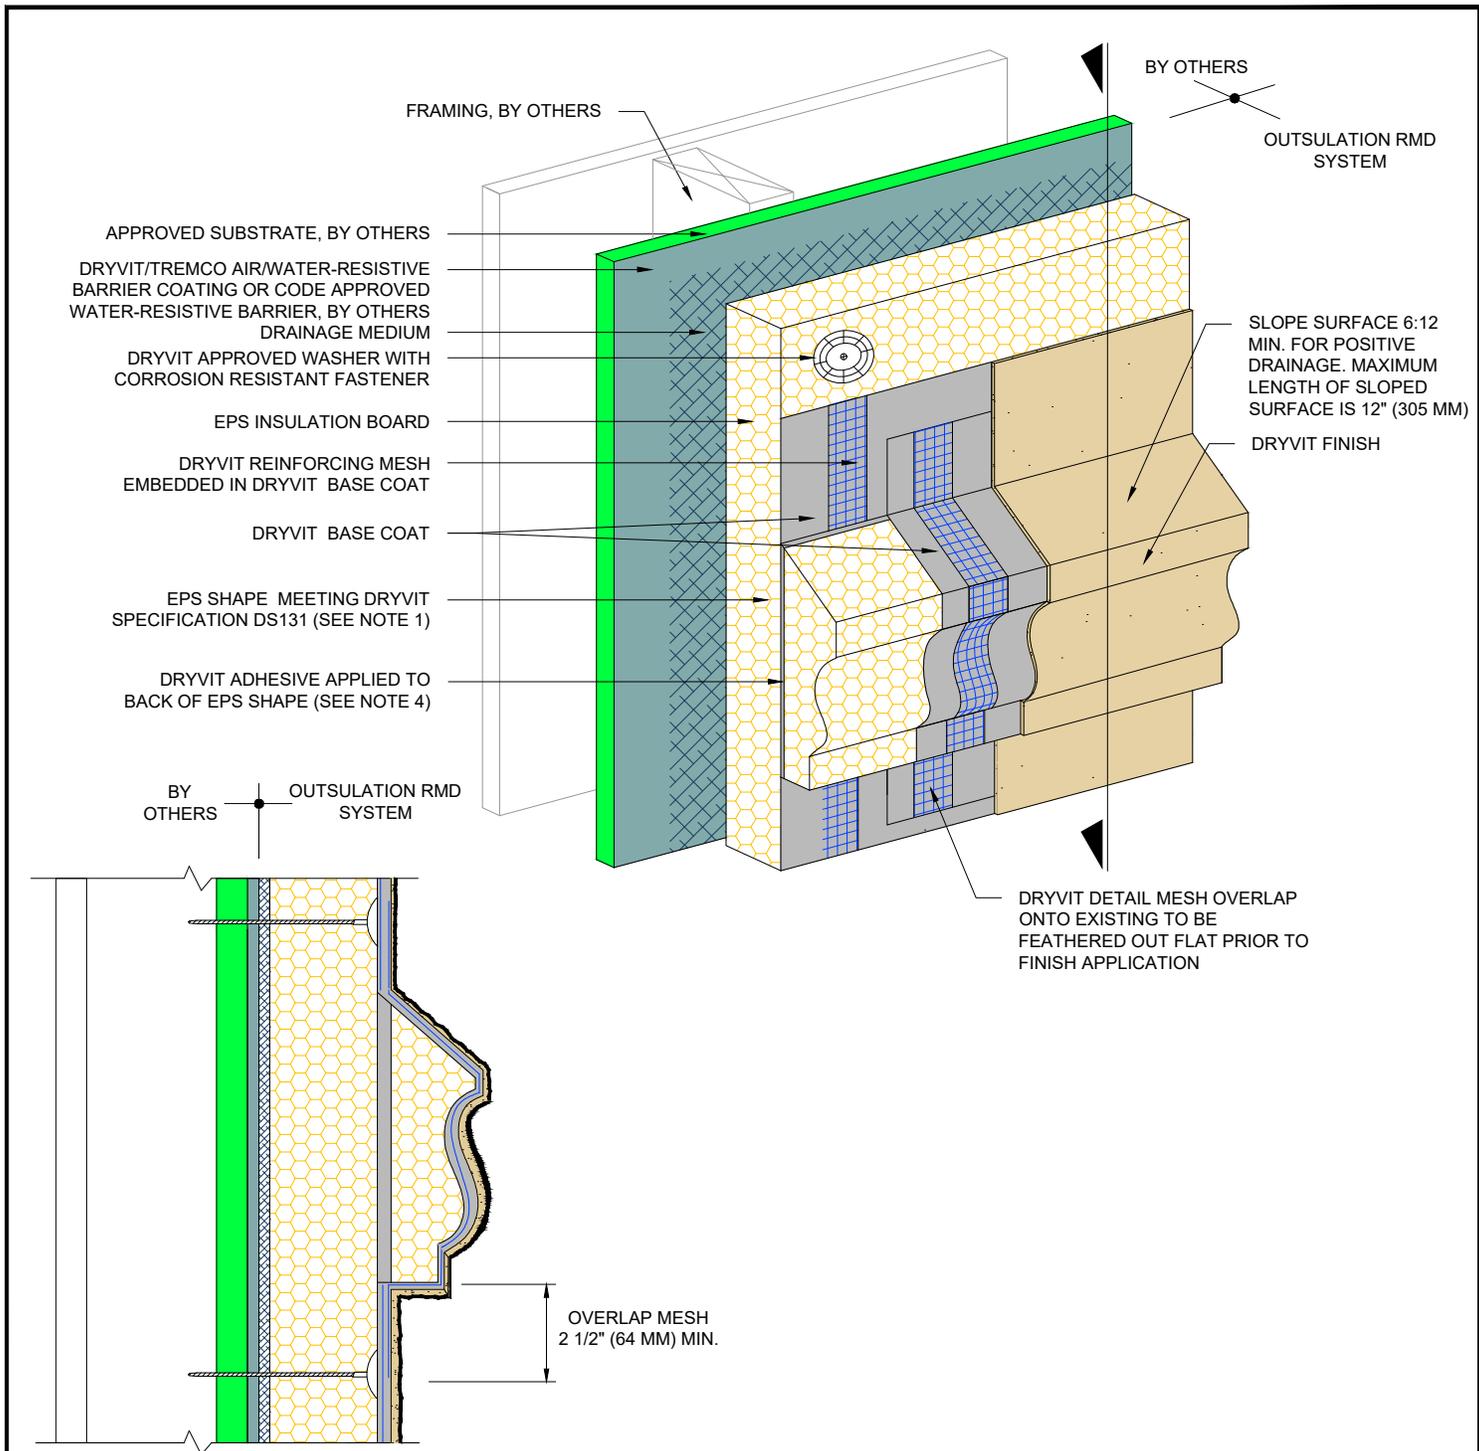

NOTES:

1. MAXIMUM EPS INSULATION THICKNESS IS DICTATED BY LOCAL CODE AUTHORITY AND APPLICABLE TESTING. REFER TO EVALUATION REPORTS FOR ANY LIMITATIONS TO EPS THICKNESS.
2. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.
3. FASTENERS ARE NOT REQUIRED FOR SYSTEMS 4 OR 5.
4. PROVIDE TEMPORARY MEANS OF SUPPORT WHEN REQUIRED.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™



Dryvit Technical Support: 800-556-7752

Detail: EPS Shapes

Drawn by: HDE

Checked by: KK

Scale: NTS

Date: 5/19/2023

File Name:


O-RMD 43



Construction Products Group


www.tremcocpg.com

ANGLE BEAD

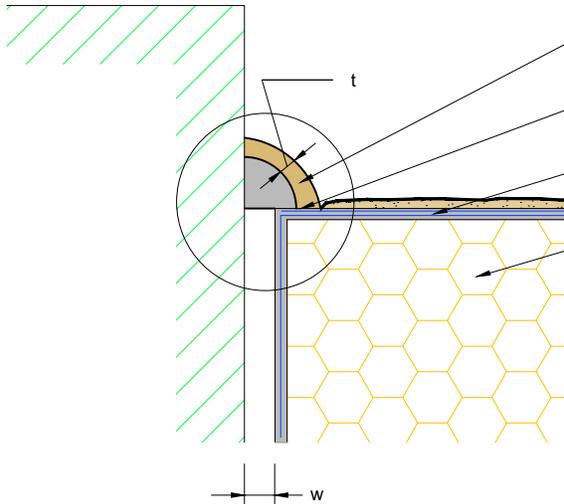

- APPROVED TREMCO CPG SEALANT OR APPROVED EQUIVALENT WITH QUARTER ROUND BACKER ROD, BY OTHERS (REFER TO OTHER OPTIONS BELOW)
- DRYVIT DEMANDIT® OR COLOR PRIME™ ON SURFACES TO RECEIVE SEALANT
- DRYVIT REINFORCING MESH EMBEDDED IN DRYVIT BASE COAT (SEE NOTE 3)
- EPS INSULATION BOARD


ANGLE BEAD BOND BREAKER OPTIONS

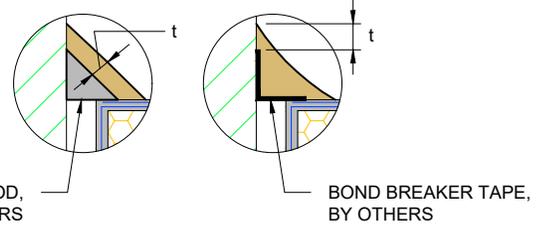

FOR ANGLE BEADS:

- t = 1/4" (6.4 MM) MIN.
- w = SPECIFIED BY MANUFACTURER OF ABUTTING MATERIAL BUT NOT LESS THAN 1/8" (3.2 MM)

RECTANGULAR BEAD

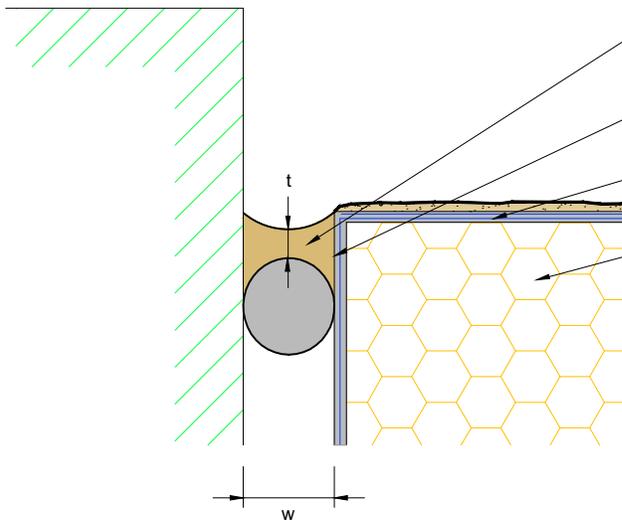

- APPROVED TREMCO CPG SEALANT OR APPROVED EQUIVALENT WITH QUARTER ROUND BACKER ROD, BY OTHERS
- DRYVIT DEMANDIT® OR COLOR PRIME™ ON SURFACES TO RECEIVE SEALANT
- DRYVIT REINFORCING MESH EMBEDDED IN DRYVIT BASE COAT (SEE NOTE 3)
- EPS INSULATION BOARD

FOR RECTANGULAR BEADS:

- t = 1/4" (6.4 MM) MIN.
- w = 1/2" (12.7 MM) MIN.
- w/t = 2:1

NOTE:

1. WEATHER SEAL JOINTS SUCH AS AT WINDOW AND DOOR PERIMETERS CAN USE ANGLE OR OR RECTANGULAR BEADS. RECTANGULAR BEADS USED AS A WEATHER SEAL REQUIRE A MINIMUM 1/2" (13 MM) WIDTH.
2. EXPANSION JOINTS SHALL USE RECTANGULAR BEADS AND BE DESIGNED FOR MINIMUM FOUR TIMES THE ANTICIPATED MOVEMENT, BUT NOT LESS THAN 3/4" (19 MM).
3. DRYVIT GENESIS® OR GENESIS DM BASE COAT IS REQUIRED FOR MECHANICALLY FASTENED SYSTEMS 1-3.

The architecture, engineering, and design of the project using the Dryvit and Tremco products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit and Tremco specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Dryvit and Tremco to ensure you have the most recent version.

Outsulation® RMD System™



Dryvit Technical Support: 800-556-7752

Detail: Sealant Configuration Options^{1,2}

Drawn by: HDE

Checked by: KK

Scale: NTS

Date: 5/19/2023

File Name:

O-RMD 44



Construction Products Group

www.tremcocpg.com