OUTSULATION®



An Exterior Wall Insulation and Finish System That Incorporates Continuous Insulation

mat moorporatoo contina		
	Outsulation System	
	Installation Details	


TABLE OF CONTENTS

DETAIL		DETAIL	
OUTSULATION SYSTEM	OS 0.0.01	VERTICAL EXPANSION JOINT -	OS 0.0.30
OUTSULATION SYSTEM	OS 0.0.01a	DOUBLE SEAL OPTION	
STARTER BOARD OPTION		VERTICAL TERMINATION	OS 0.0.31
OPENING PREPARATION-	OS 0.0.02	AT STONE VENEER	
AQUAFLASH® SYSTEM OPTION		PENETRATIONS	OS 0.0.32
INSIDE/OUTSIDE CORNERS	OS 0.0.03	SIGN ATTACHMENT	OS 0.0.33
OUTSIDE CORNER - HIGH IMPACT	OS 0.0.04	AESTHETIC REVEALS	OS 0.0.34
GRADE TERMINATION	OS 0.0.05	RECESSED GRAPHICS	OS 0.0.35
TERMINATION AT CONCRETE CURB	OS 0.0.06	PROJECTING GRAPHICS	OS 0.0.36
TERMINATION AT	OS 0.0.07		
ADA COMPLIANT SIDEWALK			
EPS PREPARATION AT	OS 0.0.08		
WALL PENETRATIONS			
PREPARATION OF OPENING FOR	OS 0.0.09		
STOREFRONT WINDOW			
PREPARATION OF OPENING FOR	OS 0.0.10		
NAIL-ON WINDOW			
WINDOW HEAD	OS 0.0.11		
TERMINATION AT	OS 0.0.12		
WOOD FRAMED DECK			
TERMINATION AT	OS 0.0.13		
WATERPROOF DECK			
PREPARATION AT PARAPET/	OS 0.0.14		
WALL INTERSECTION		NOTE	
TERMINATION AT PARAPET -	OS 0.0.15	NOTE	
CAP FLASHING		DRYVIT MAKES NO REPRESENTATION	REGARDING
TERMINATION AT PARAPET -	OS 0.0.16	CONFORMITY OF ITS SUGGESTIONS T	O MODEL BUILDING
SOLID SUBSTRATE		CODES, ENGINEERING CRITERIA, SPE	CIFIC APPLICATIONS,
TERMINATION AT SLOPED ROOF	OS 0.0.17	OR PROJECT LOCATIONS. ALL COMPO	
VERTICAL WALL/SUSPENDED	OS 0.0.18	IN ILLUSTRATIONS, AS WELL AS OTHE	RS THAT MAY BE
SOFFIT TRANSITION		REQUIRED FOR THE INTEGRITY OF TH	E SYSTEM SHALL BE
TRANSITION AT SOFFIT/	OS 0.0.19	DESIGNED, DETAILED, AND ENGINEER	ED BY
FASCIA INTERSECTION		REPRESENTATIVES OF THE ARCHITEC	CT, OWNER, OR
FASCIA/UNINSULATED	OS 0.0.20	CONTRACTOR TO BE IN CONFORMANO	CE WITH MODEL
SOFFIT TRANSITION		CODES, ARCHITECTURAL, AND ENGIN	EERING
TERMINATION AT UNINSULATED	OS 0.0.21	REQUIREMENTS PERTAINING TO SPEC	CIFIC BUILDING
SOFFIT VENT		PROJECTS.	
HORIZONTAL JOINT AT FLOOR LINE	OS 0.0.22		
HORIZONTAL JOINT -	OS 0.0.23	DRYVIT MAKES NO WARRANTY, EXPRE	ESSED OR IMPLIED,
SUBSTRATE CHANGE		AS TO THE ARCHITECTURAL DESIGN,	ENGINEERING, OR
HORIZONTAL TERMINATION AT	OS 0.0.24	WORKMANSHIP OF PROJECTS UTILIZII	NG DRYVIT SYSTEMS
STONE VENEER		OR PRODUCTS.	
HORIZONTAL TERMINATION AT	OS 0.0.25		
STUCCO		THE LIABILITIES OF DRYVIT SHALL BE	AS STATED IN THE
HORIZONTAL TERMINATION AT	OS 0.0.26	OUTSULATION LIMITED COMMERCIAL	
WOOD SIDING		CONTACT DRYVIT FOR A FULL AND CO	MPLETE COPY OF
VERTICAL EXPANSION JOINT - EIFS	OS 0.0.27	THE WARRANTY.	
THROUGH-WALL EXPANSION JOINT	OS 0.0.28		
VERTICAL EXPANSION JOINT -	OS 0.0.29		
FLUSH AND RECESSED OPTIONS			

Outsulation[®] System



OS 0.0.01

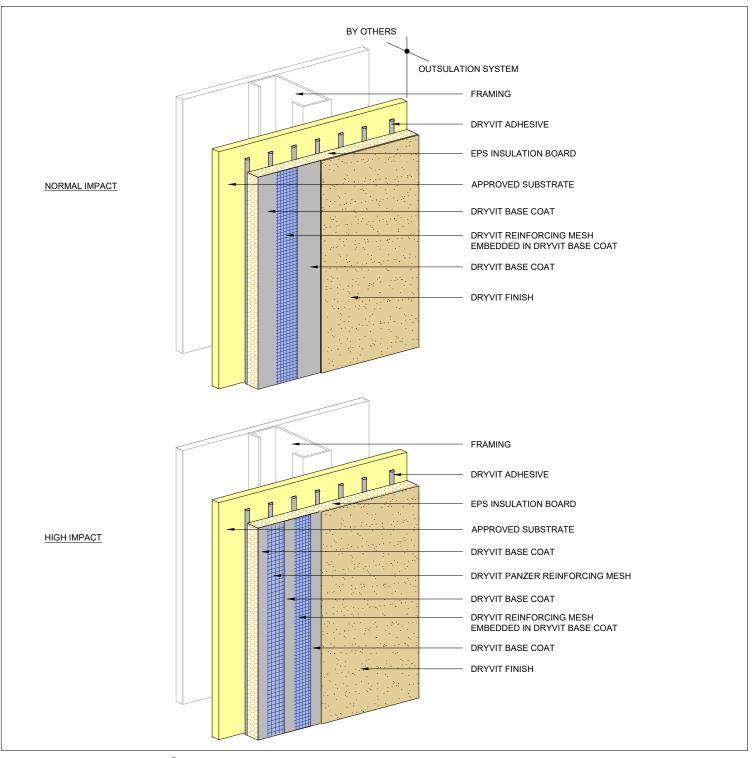

Outsulation® System


Outsulation System

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.



OS 0.0.01a

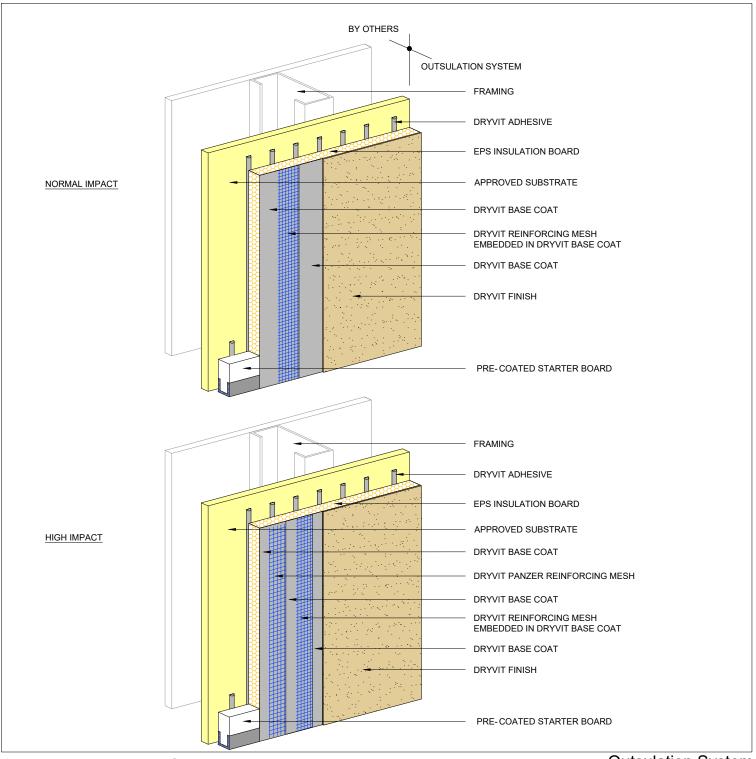


Outsulation[®] System

Outsulation System Starter Board Option

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.



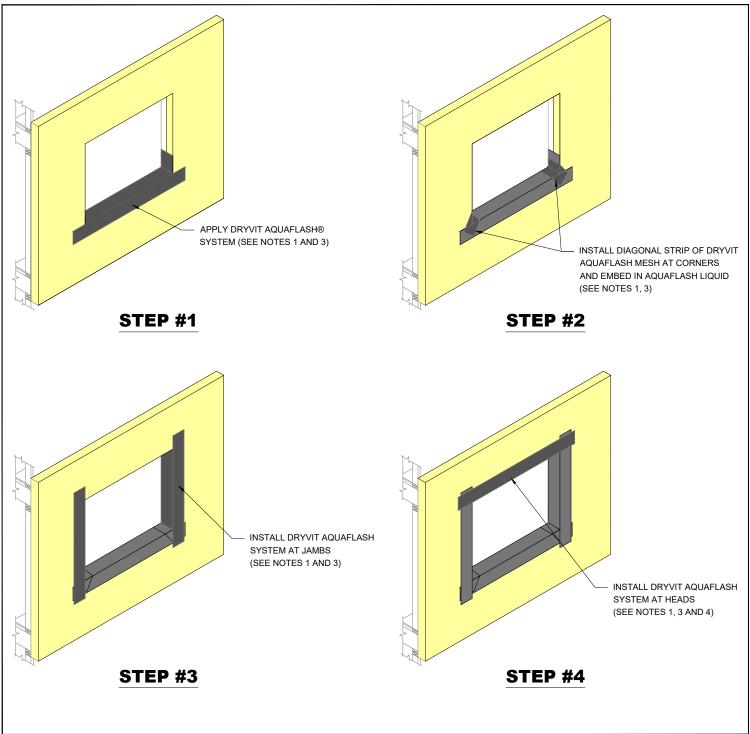


NOTE:

- 1. DRYVIT AQUAFLASH SHALL EXTEND TO INTERIOR FACE OF OPENING.
- 2. REFER TO HEAD, SILL AND JAMB DETAILS FOR FLASHING INTEGRATION.
- 3. DRYVIT FLASHING TAPE SURFACE CONDITIONER™ AND DRYVIT FLASHING TAPE™ MAY BE USED IN LIEU OF DRYVIT AQUAFLASH SYSTEM.
- 4. INSTALL WINDOW UNIT AND ASSOCIATED FLASHINGS PER MANUFACTURER'S RECOMMENDATIONS, CODE REQUIREMENTS AND PROJECT DOCUMENTS.
- 5. AQUAFLASH SYSTEM CONSISTS OF AQUAFLASH MESH AND AQUAFLASH LIQUID.

Opening Preparation AguaFlash® System⁵ Option



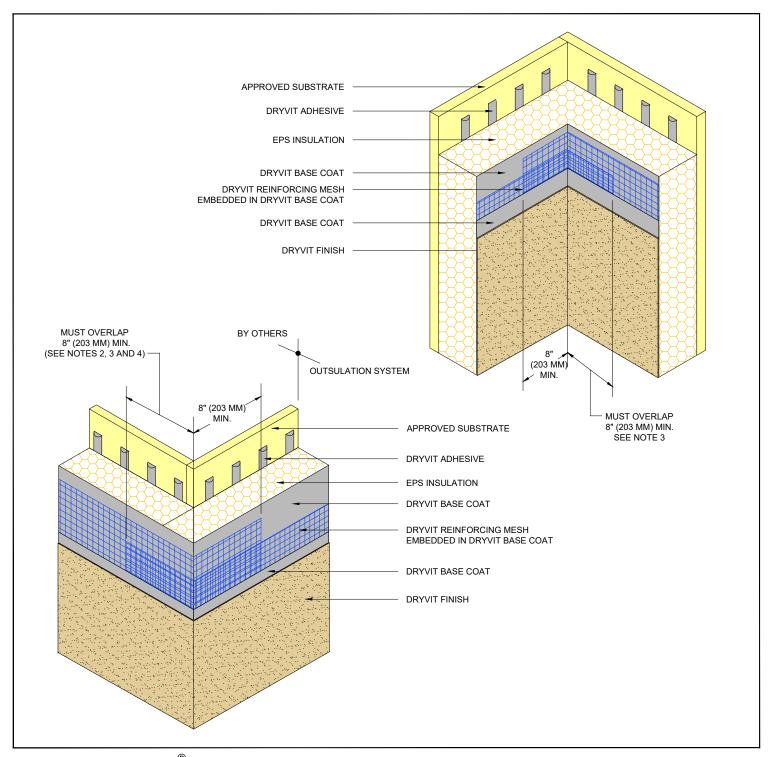

Inside/Outside Corners

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS


2. DOUBLE WRAP OUTSIDE CORNERS WITH REINFORCING MESH OR USE CORNER MESH.

8" (203 MM) OF A CORNER.

3. DO NOT LAP REINFORCING MESH WITHIN

4. OUTSIDE INSULATION BOARD EDGES SHALL BE OFFSET.



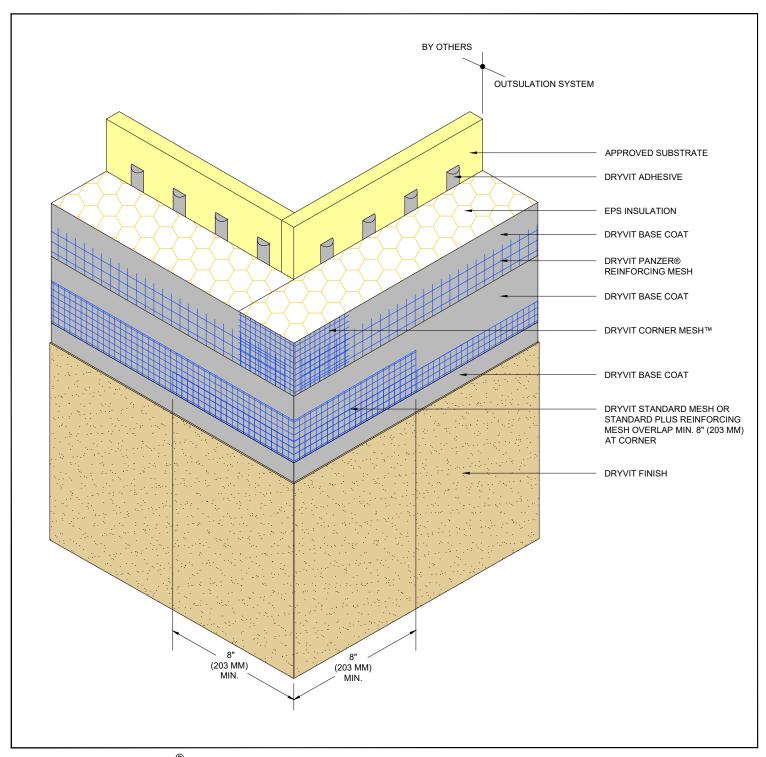


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. OUTSIDE INSULATION BOARD EDGES SHALL BE OFFSET.

Outside Corner - High Impact



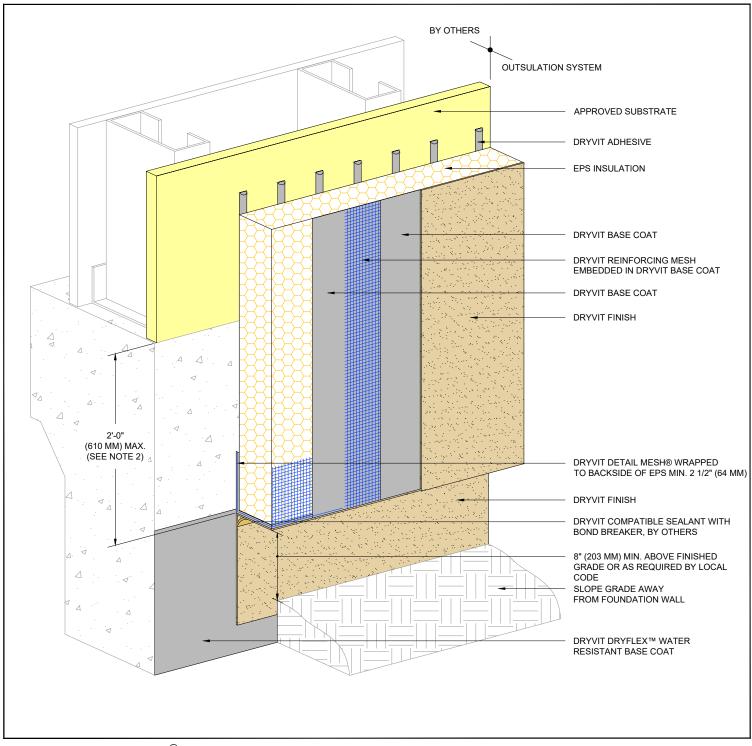

NOTE:


1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. EXPANSION JOINT IS REQUIRED ALONG TOP OF FOUNDATION IF 2'-0" (610 MM) DIMENSION IS EXCEEDED.

- 3. SLOPE GRADE AWAY FROM WALL
- 4. STOP FINISH APPROXIMATELY 2" (51 MM) BELOW GRADE.

Grade Termination



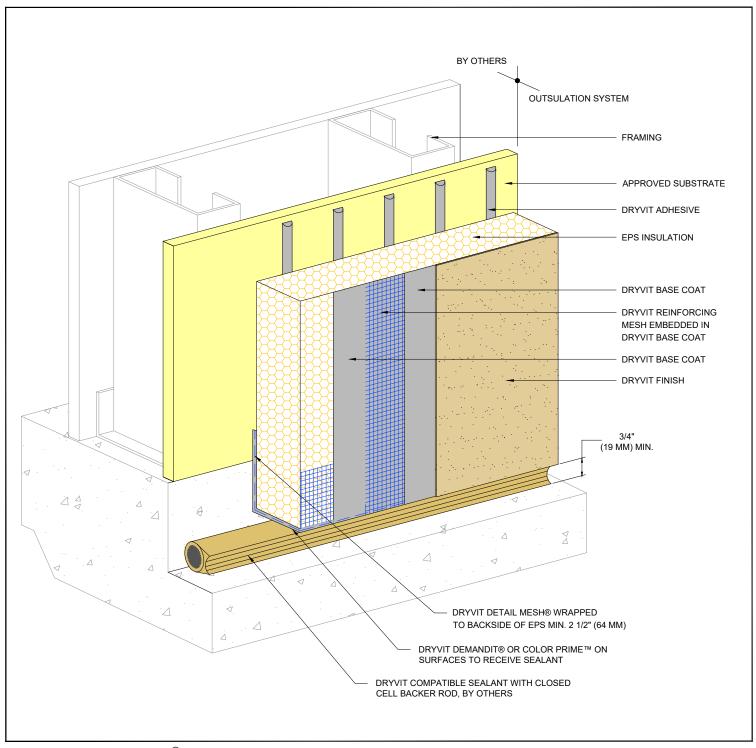


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

Termination At Concrete Curb



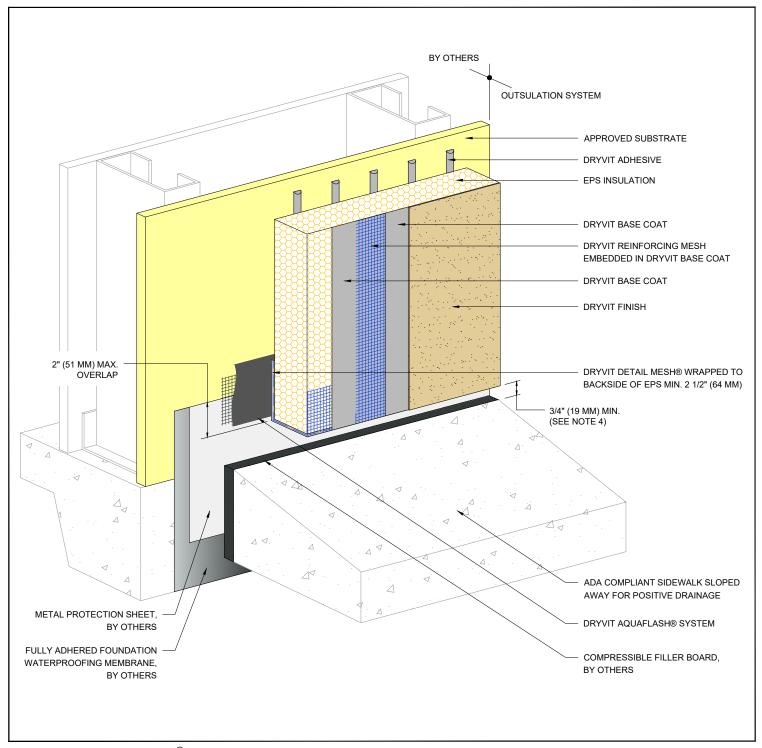

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT


2. USE OF THIS DETAIL IS LIMITED TO

SLAB-ON-GRADE APPLICATIONS.

4. TO PREVENT DEBRIS ACCUMULATION IT IS RECOMMENDED TO TERMINATE SYSTEM 2" (51 MM) ABOVE SIDEWALK.

Termination At ADA Compliant Sidewalk



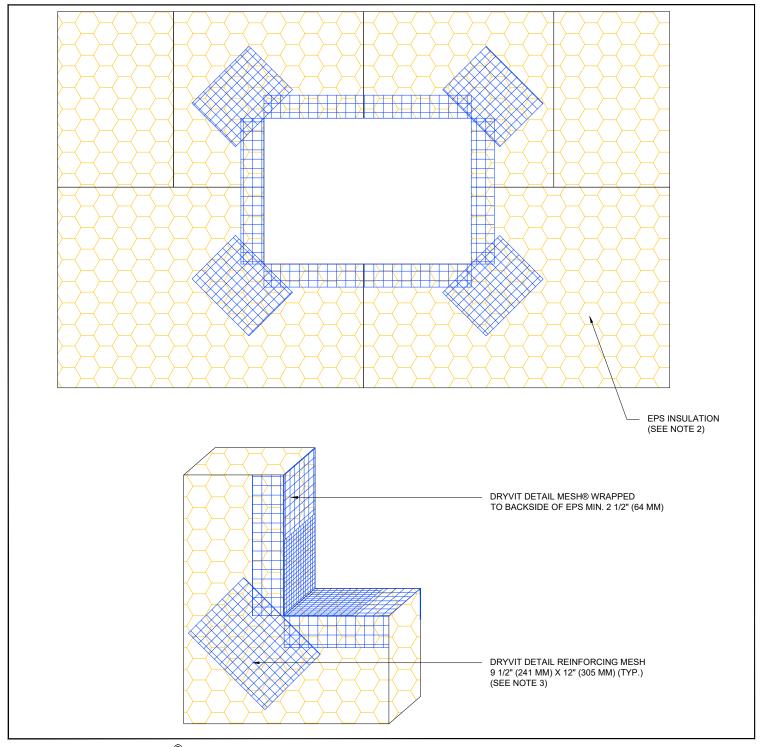

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.


2. LOCATE INSULATION BOARDS SUCH THAT BOARD EDGES DO NOT ALIGN WITH CORNERS OF PENETRATION.


3. APPLY A PIECE OF 9 1/2" (241 MM) X 12" (305 MM) DETAIL REINFORCING MESH DIAGONALLY AT EACH CORNER.


EPS Preparation At Wall Penetrations



OS 0.0.09









STEP 1: PREPARE OPENING AS PER OS 0.0.02. INSTALL SILL PAN FLASHING AND SECURE TO FRAMING AND BLOCKING. SHIM UNDERSIDE OF FLASHING TO ENSURE INCIDENTAL MOISTURE IS DIRECTED TO THE EXTERIOR FACE OF THE WALL. (SEE NOTES 1,2 AND 3)

STEP 2: APPLY DRYVIT AQUAFLASH® SYSTEM SPLICES OVER UPTURNED LEGS OF PAN FLASHING (SEE NOTE 3)



STEP 3: INSTALL WINDOW UNIT AND ASSOCIATED HEAD FLASHING.

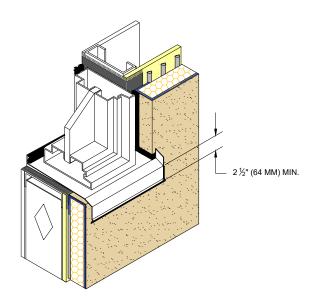

STEP 4: INSTALL EIFS AND APPLY BACKER ROD AND SEALANT ALONG JAMBS AND AT SYSTEM TERMINATIONS, ALSO ALONG EDGES OF FLASHING.

Outsulation® System

NOTE:


1. PAN FLASHING SHOULD OVERLAP EIFS MIN. 2 1/2" (64 MM) MEASURED FROM THE TOP OF THE EPS.

2. PAN FLASHING MUST HAVE WATERTIGHT SEAMS.

3. DRYVIT FLASHING TAPE SURFACE CONDITIONER** AND DRYVIT FLASHING TAPE** MAY BE USED IN LIEU OF AQUAFLASH SYSTEM.

Preparation of Opening for Storefront Window




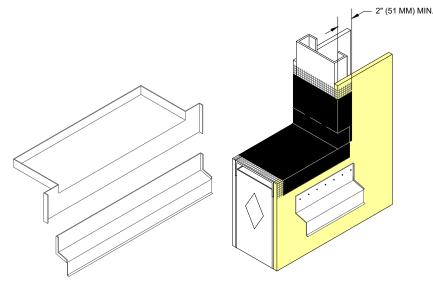

(SEE NOTES 1,2 AND 5)

STEP 1: APPLY DRYVIT AQUAFLASH® SYSTEM AT SILL PER OS 0.0.02 AND SECURE


FLASHING TO FRAMING (SEE NOTES 1,2,5 AND 7)

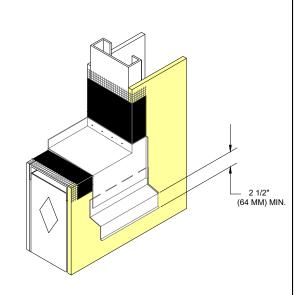


STEP 2: INSTALL SILL PAN FLASHING. SHIM UNDERSIDE OF PAN FLASHING TO ENSURE WATER RUN OFF

(SEE NOTE 2)


STEP 5:



STEP 3: APPLY DRYVIT AQUAFLASH SYSTEM
OVER METAL FLASHING TRANSITION
AND AT JAMBS LAPPING OVER
UPTURNED LEGS OF PAN FLASHING (SEE
NOTES 1,2,5 AND 7)



STEP 4: INSTALL WINDOW UNIT AND ASSOCIATED HEAD FLASHING.



INSTALL EIFS AND APPLY BACKER ROD AND SEALANT ALONG JAMBS AND AT SYSTEM TERMINATIONS, ALSO ALONG EDGES OF FLASHING (SEE NOTES 3,4,5 AND 6)

Outsulation® System


NOTE:

- 1. PAN FLASHING SHOULD OVERLAP EIFS MIN. 2 1/2" (64 MM) MEASURED FROM THE TOP OF THE EPS.
- 2. PAN FLASHING MUST HAVE WATERTIGHT SEAMS.
- 3. DRYVIT FLASHING TAPE SURFACE CONDITIONER** AND DRYVIT FLASHING TAPE** MAY BE USED IN LIEU OF AQUAFLASH SYSTEM.
- 4. EIFS AT SILL SHALL BE SLOPED FOR DRAINAGE.

- 5. APPLY DRYVIT AQUAFLASH SYSTEM AT SILL. SEE DETAIL OS 0.0.02
- 6. ADHESIVE ONLY APPLICATION IS ACCEPTABLE WHEN USING THE AQUAFLASH SYSTEM.
- 7. DRYVIT FLASHING TAPE SURFACE CONDITIONER AND DRYVIT FLASHING TAPE MAY BE USED IN LIEU OF AQUAFLASH

Preparation of Opening for Nail-On Window



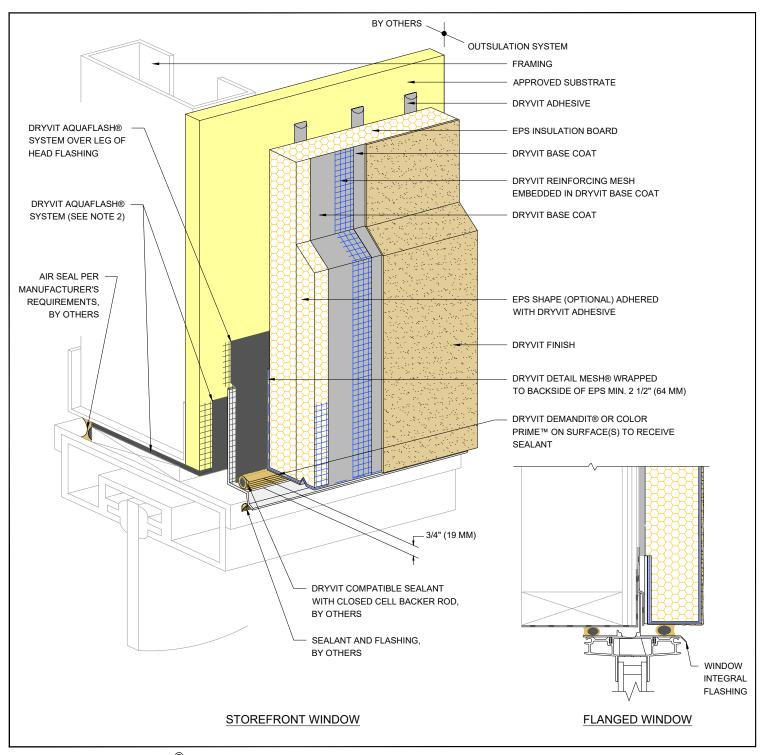


Window Head

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. DRYVIT FLASHING TAPE SURFACE CONDITIONER™ AND DRYVIT FLASHING TAPE™ MAY BE USED IN LIEU OF DRYVIT AQUAFLASH SYSTEM.



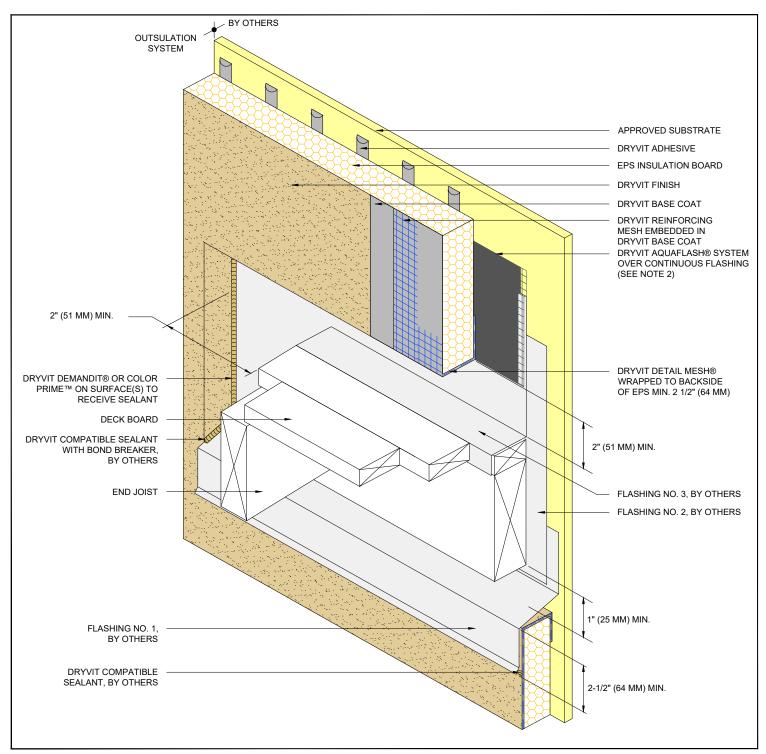


NOTE:

I. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. DRYVIT FLASHING TAPE SURFACE CONDITIONER™ AND DRYVIT FLASHING TAPE™ MAY BE USED IN LIEU OF DRYVIT AQUAFLASH SYSTEM. 3. DETAIL DOES NOT APPLY TO CANTILEVERED DECKS. CANTILEVERED DECKS REQUIRE JOB SPECIFIC FLASHING DETAILS.

Termination at Wood Framed Deck



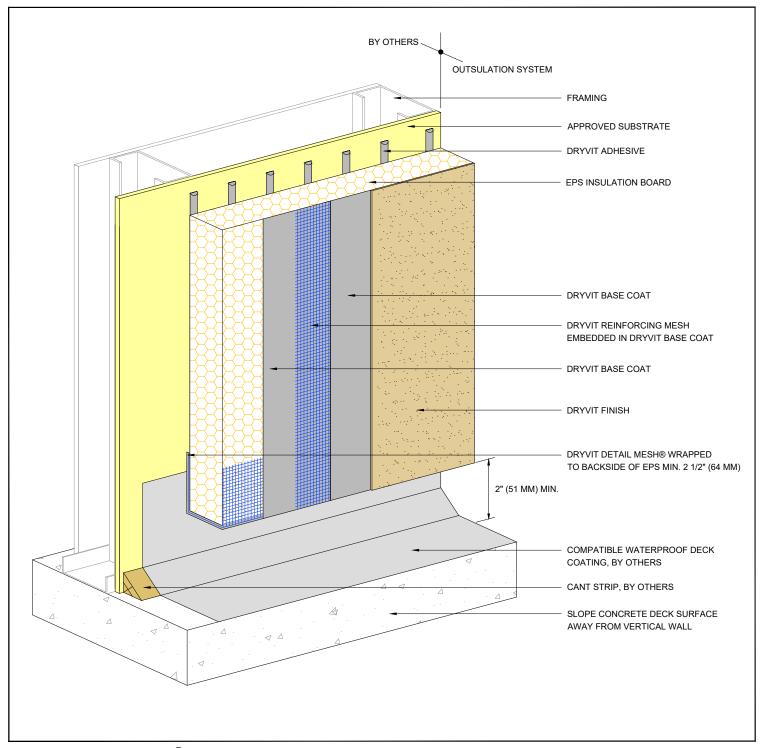


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

Termination at Waterproof Deck



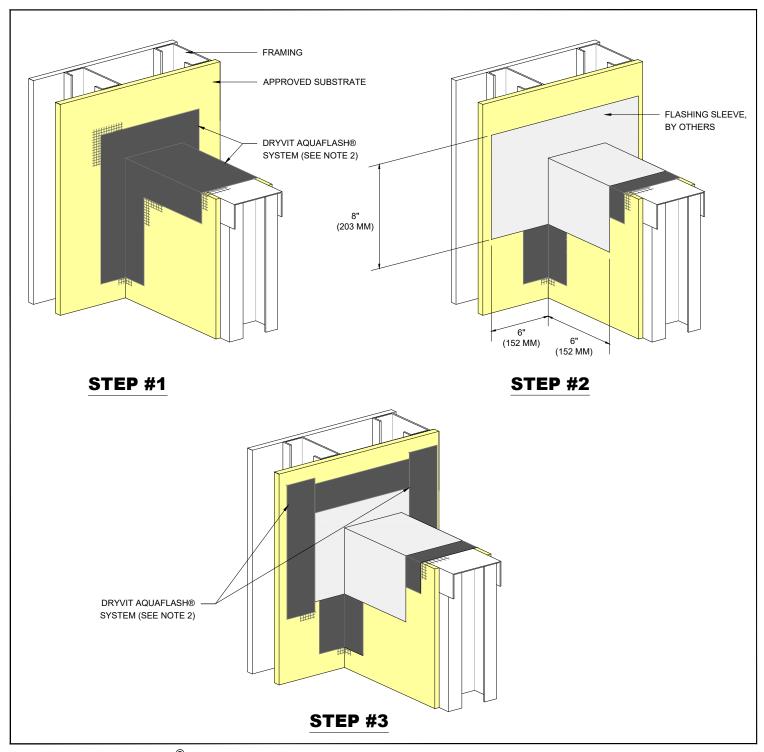


Preparation At Parapet/Wall Intersection

NOTE:

1. DRYVIT FLASHING TAPE SURFACE CONDITIONER™ AND DRYVIT FLASHING TAPE™ MAY BE USED IN LIEU OF DRYVIT AQUAFLASH SYSTEM.



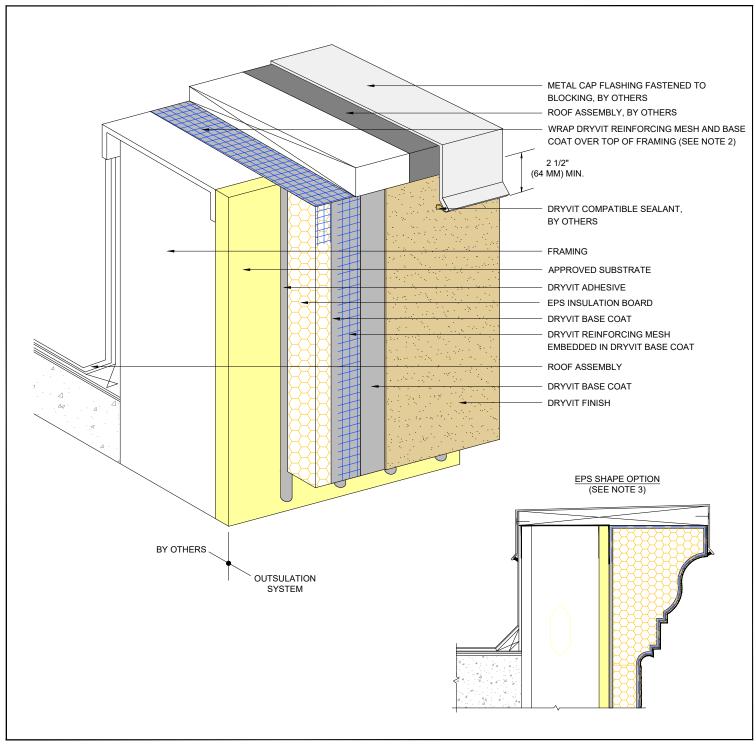

NOTE:


APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. AS AN OPTION, DRYVIT AQUAFLASH SYSTEM OR DRYVIT FLASHING TAPE SURFACE CONDITIONER AND DRYVIT FLASHING TAPE MAY BE USED TO PROVIDE ADDITIONAL PROTECTION AT TOP OF A PARAPET WALL.

3. MAXIMUM THICKNESS OF EPS BUILT OUT SHAPES SHALL NOT EXCEED 13" (330 MM) AT ANY POINT MEASURED FROM THE SUBSTRATE.

Termination At Parapet - Cap Flashing



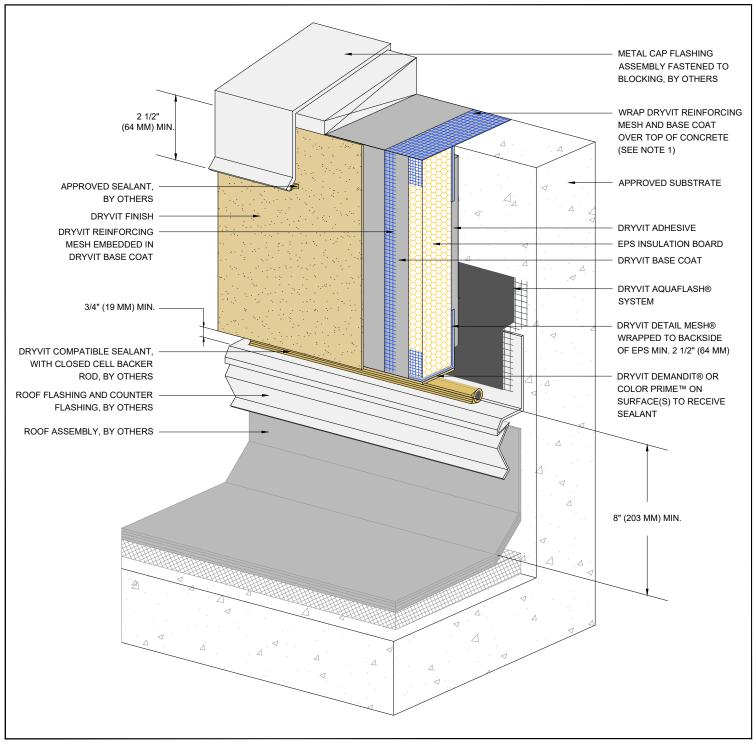


NOTE:

ADDITION AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. AS AN OPTION, DRYVIT AQUAFLASH® SYSTEM OR DRYVIT FLASHING TAPE SURFACE CONDITIONER™ AND DRYVIT FLASHING TAPE™ MAY BE USED TO PROVIDE ADDITIONAL PROTECTION AT THE TOP OF A PARAPET WALL.

Termination At Parapet - Solid Substrate



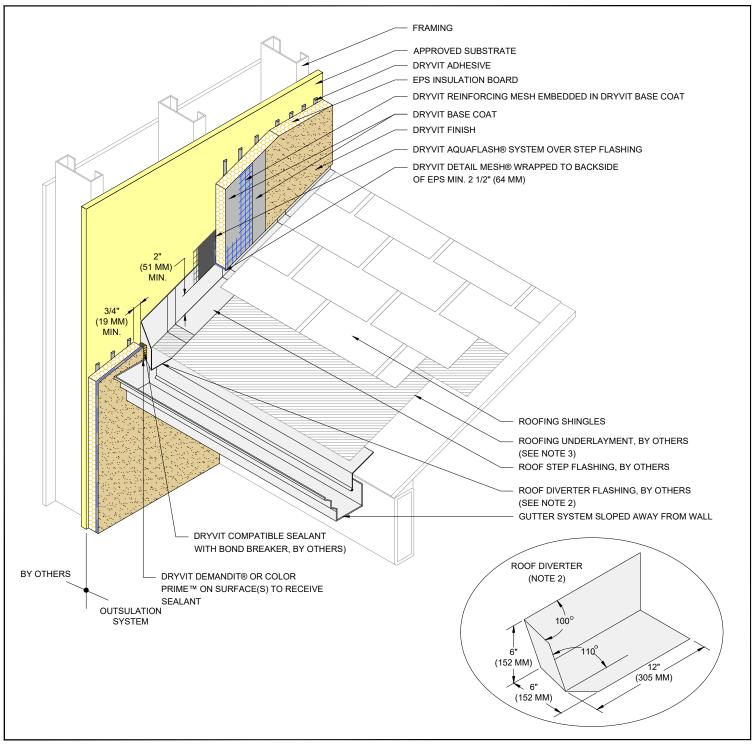


Termination at Sloped Roof

NOTE:

- 1. EXTEND DIVERTER FLASHING (KICKOUT) A MINIMUM OF 1" (25 MM) BEYOND FACE OF THE SYSTEM.
- 2. ROOF DIVERTER TO BE MADE FROM CORROSION RESISTANT MATERIAL MIN. 24 GAGE WITH WATER TIGHT SEAMS.
- 3. EXTEND ROOFING UNDERLAYMENT 5" (127 MM) UP VERTICAL WALL BEHIND METAL FLASHING.
- 4. METAL FLASHINGS ARE 10" (254 MM) X 2" (51 MM) LONGER THAN THE EXPOSED PORTION OF THE ROOFING SHINGLE AND ARE BENT IN HALF TO ALLOW FOR TWO 5" (127 MM) LEGS. ALTHOUGH NOT SHOWN, METAL FLASHINGS ARE STEP FLASHED (INTERWOVEN) WITH ROOFING SHINGLES.
- 5. FOR ADDITIONAL SLOPED ROOF DETAILS, REFER TO DRYVIT PUBLICATION DS106.



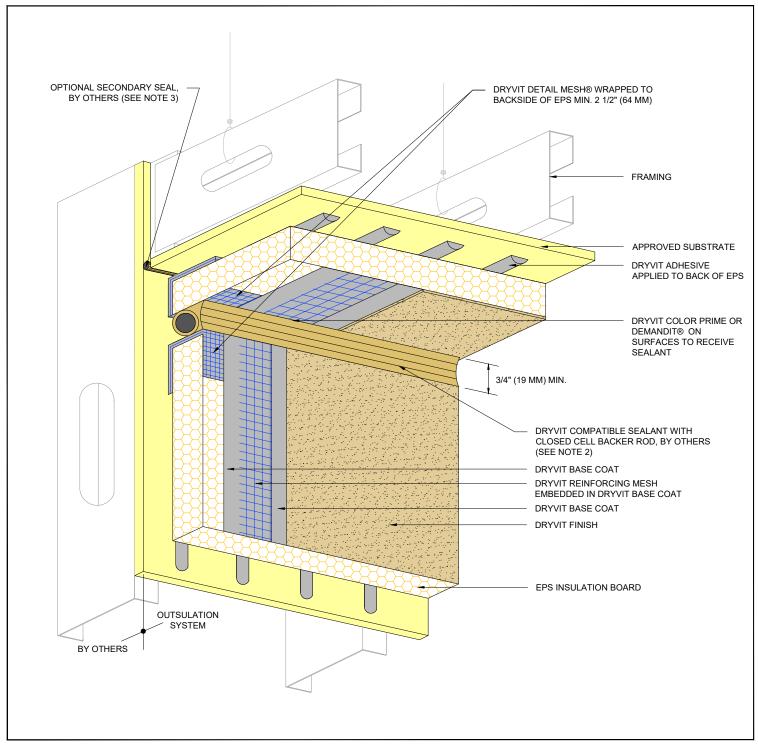


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. SEALANT JOINT IS REQUIRED FOR SUSPENDED SOFFITS. OPTIONAL FOR RIGIDLY FRAMED.

Vertical Wall/Suspended Soffit Transition



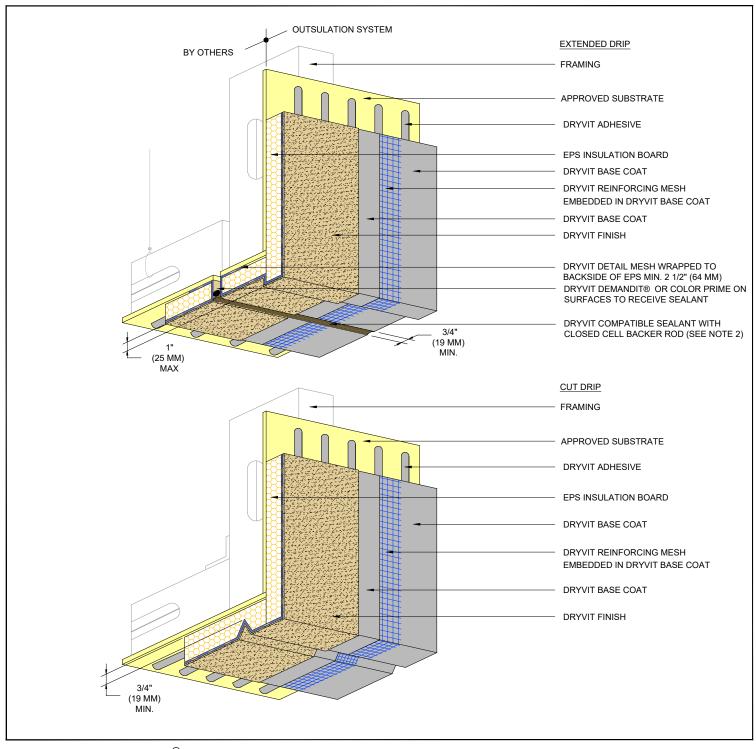


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. EXPANSION JOINT IS REQUIRED FOR SUSPENDED SOFFITS. OPTIONAL FOR RIGIDLY FRAMED.

Transition At Soffit/Fascia Intersection



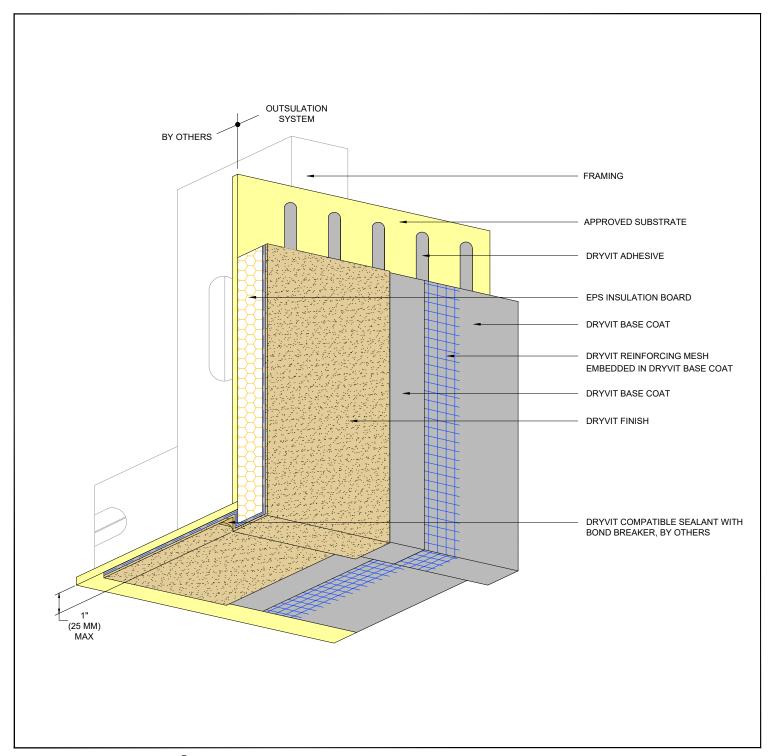


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

Fascia/Uninsulated Soffit Transition



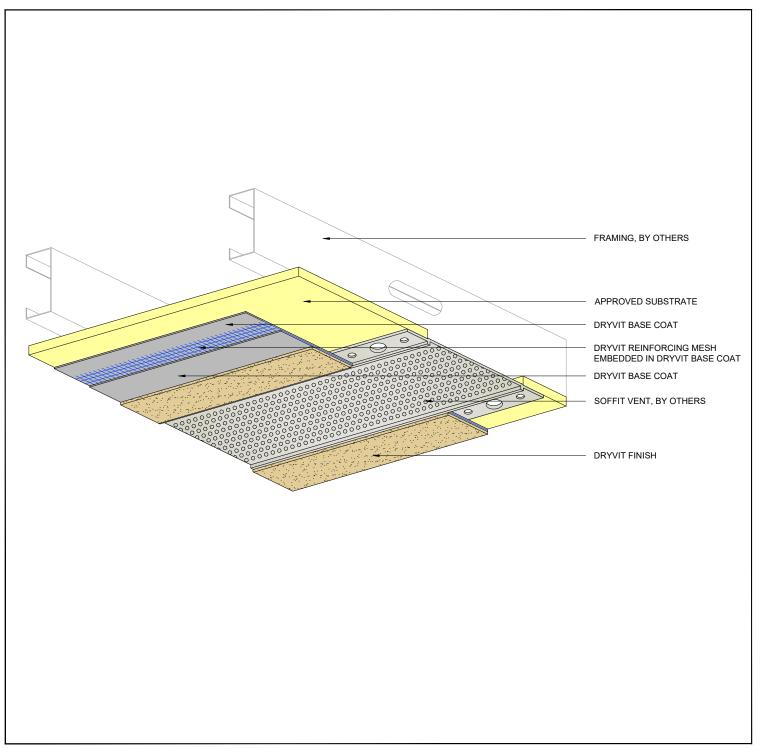

NOTE:

1. CONTROL JOINTS ARE RECOMMENDED EVERY 20 FT (6.1 M).


2. REFER TO DRYVIT PUBLICATION DS173 FOR SPECIFIC REQUIREMENTS FOR SOFFIT AREAS.

3. SEAL ALL BUTT JOINTS, INTERSECTIONS, AND ENDS OF VENTS WITH COMPATIBLE SEALANT.

4. SEE DRYVIT PUBLICATION DS842 FOR ADDITIONAL DIRECT APPLIED DETAILS.

Termination at Uninsulated Soffit Vent



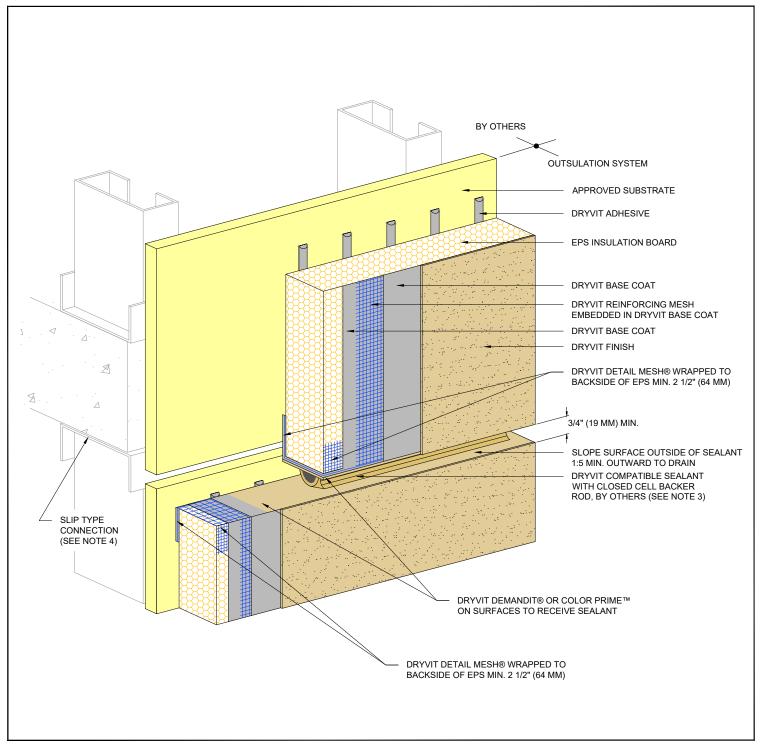

Horizontal Joint At Floor Line

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.


2. LOCATE EXTERNAL SEALANT JOINT WITHIN 2" (51 MM) OF BREAK IN SHEATHING.

3. EXPANSION JOINT IN THE OUTSULATION SYSTEM IS NECESSARY WHERE SIGNIFICANT DIFFERENTIAL MOVEMENT IS EXPECTED AT FLOOR LINES.

AT SLIP CONNECTION.

FOR WOOD FRAMED CONSTRUCTION: EXPANSION JOINT IS INTENDED TO ACCOMMODATE CROSS GRAIN SHRINKAGE OF FLOOR BEAMS.



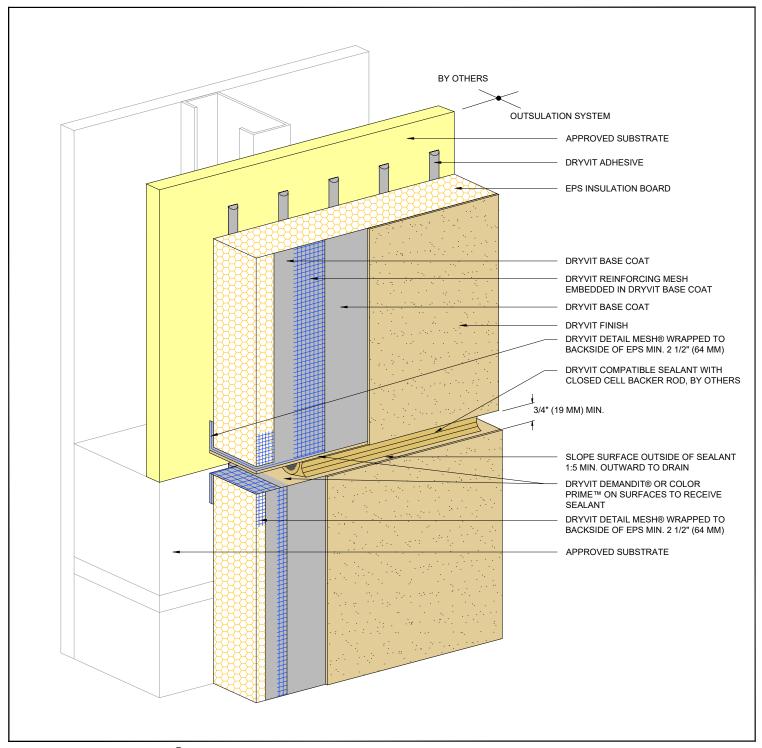


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

Horizontal Joint - Substrate Change



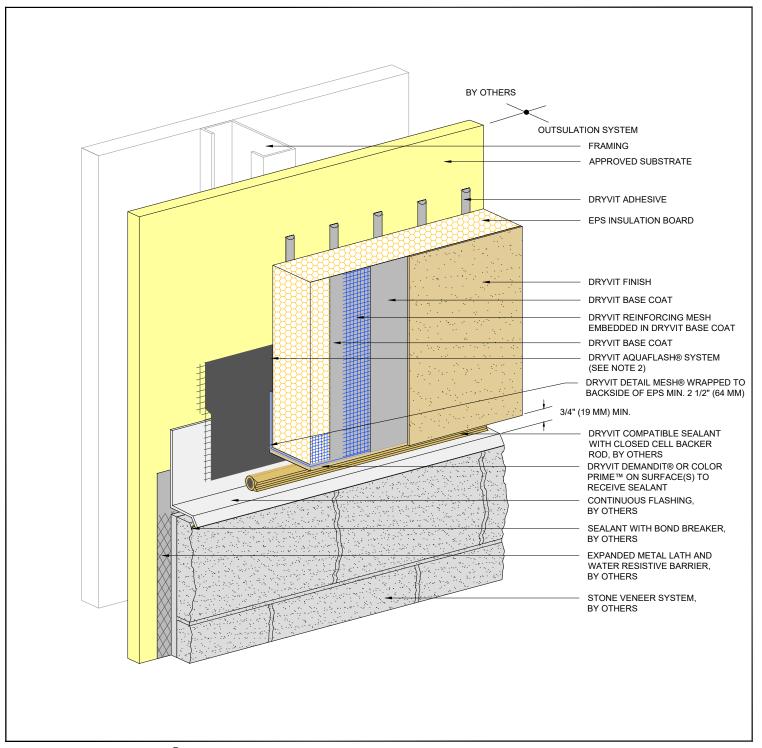

NOTE:


1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. DRYVIT FLASHING TAPE SURFACE CONDITIONER™ AND DRYVIT FLASHING TAPE™ MAY BE USED IN LIEU OF DRYVIT AQUAFLASH SYSTEM.

3. FOR INSTALLATION OF DRYVIT AIRWATER-RESISTIVE BARRIER COATING BENEATH CLADDINGS OTHER THAN DRYVIT EIFS, REFER TO DRYVIT PUBLICATION DS840.

Horizontal Termination at Stone Veneer



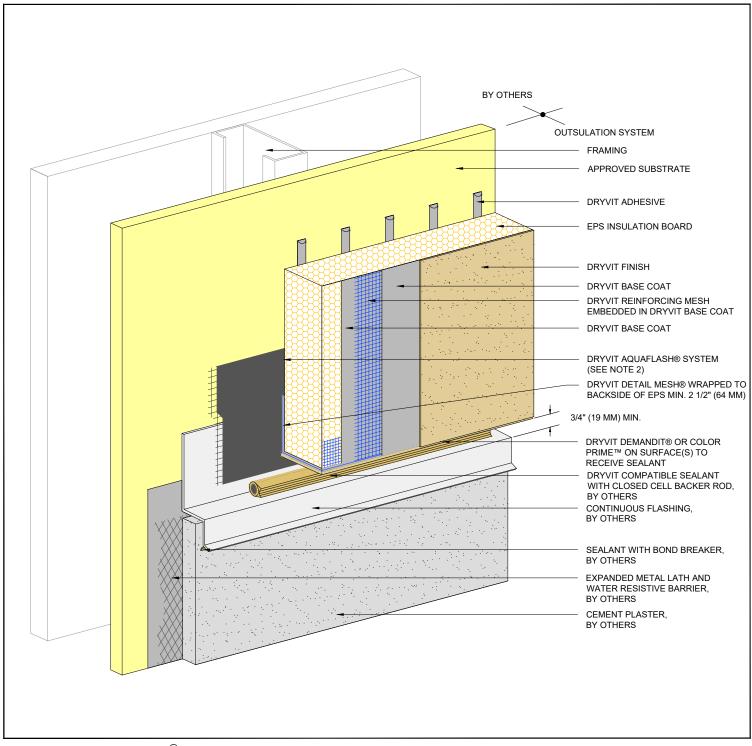


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. DRYVIT FLASHING TAPE SURFACE CONDITIONER™ AND DRYVIT FLASHING TAPE™ MAY BE USED IN LIEU OF DRYVIT AQUAFLASH SYSTEM.

Horizontal Termination at Stucco



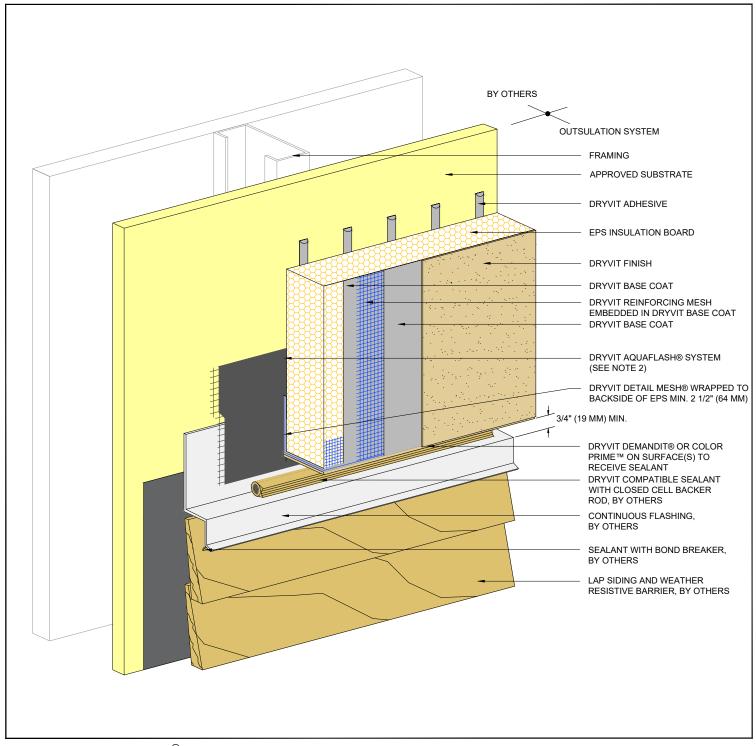


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. DRYVIT FLASHING TAPE SURFACE CONDITIONER™ AND DRYVIT FLASHING TAPE™ MAY BE USED IN LIEU OF DRYVIT AQUAFLASH SYSTEM.

Horizontal Termination at Wood Siding



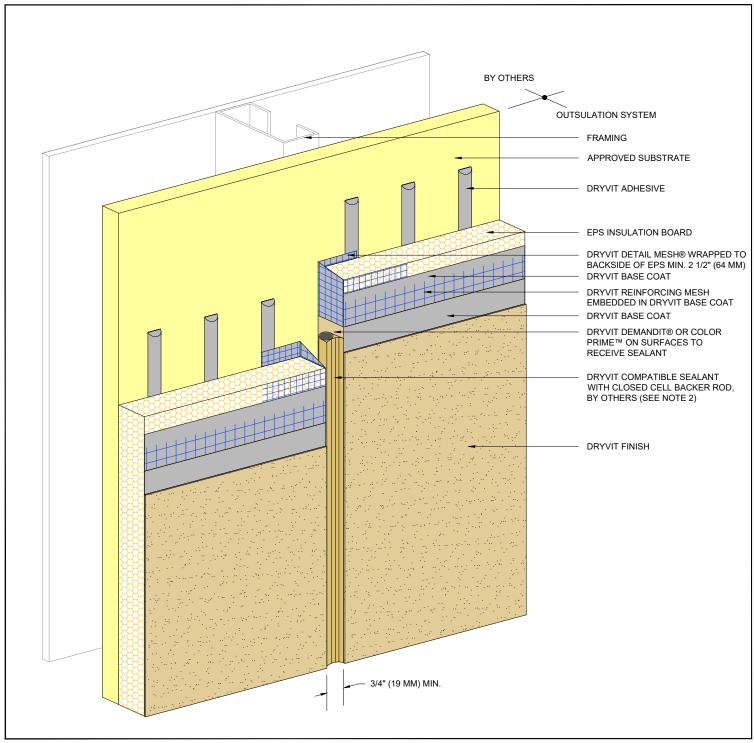


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH, LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS

2. EIFS EXPANSION JOINTS ARE REQUIRED IN CONTINUOUS ELEVATIONS AT INTERVALS NOT EXCEEDING 75 FT (23 M).

Vertical Expansion Joint - EIFS²



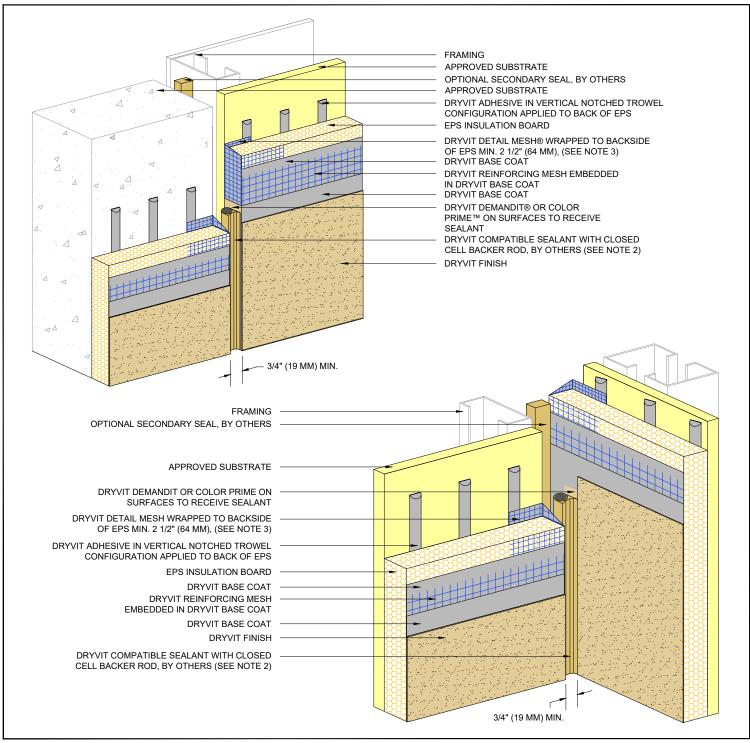

NOTE:


1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. LOCATE EXTERNAL SEALANT JOINT WITHIN 2" (51 MM) OF SUBSTRATE JOINT.

3. AS AN OPTION, THE REINFORCED BASE COAT MAY BE EXTENDED ONTO THE CONCRETE EDGE AND/OR FRAMING, CREATING AN EDGE WRAP RATHER THAN BACK WRAP

Through-Wall Expansion Joint



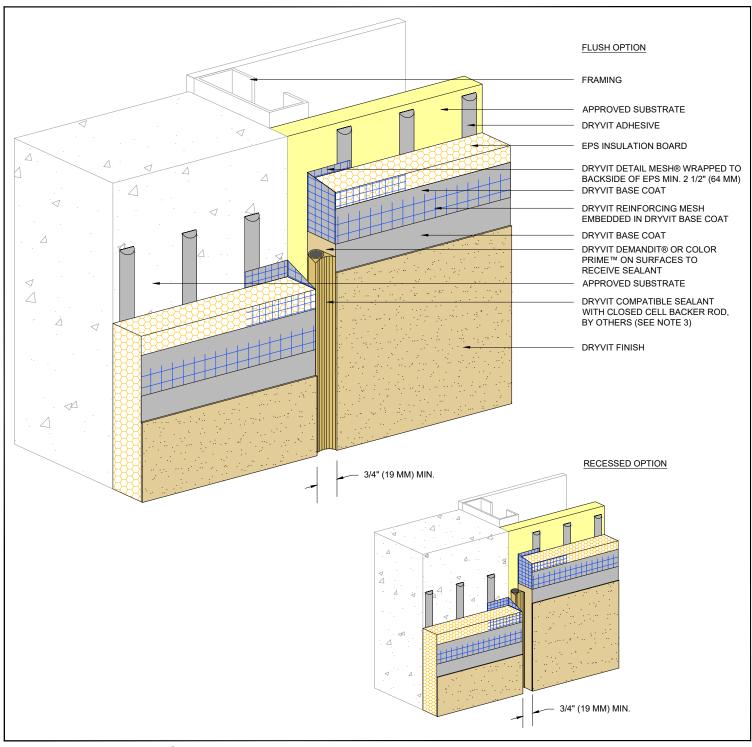


Vertical Expansion Joint - Flush and Recessed Options

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.



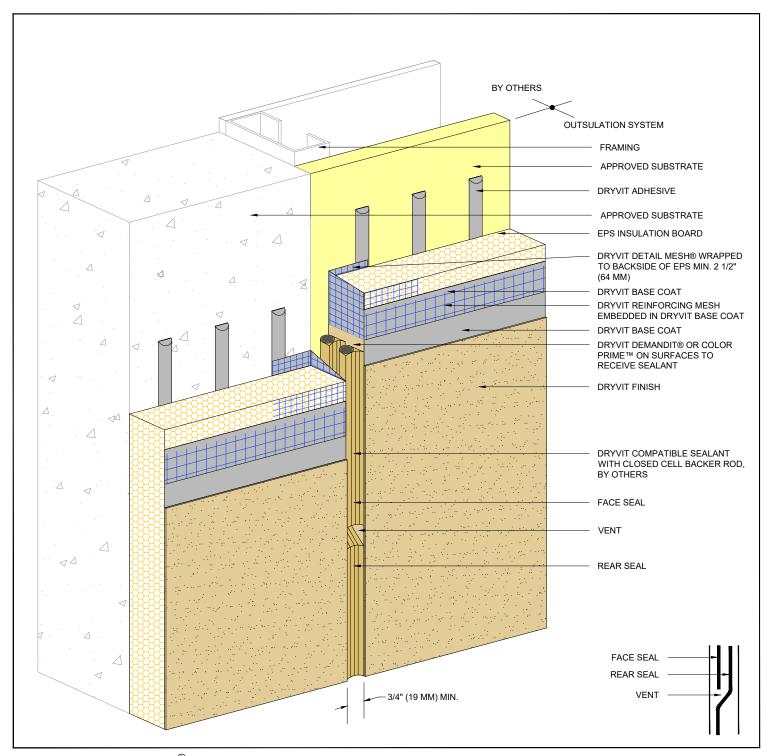


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

Vertical Expansion Joint - Double Seal Option



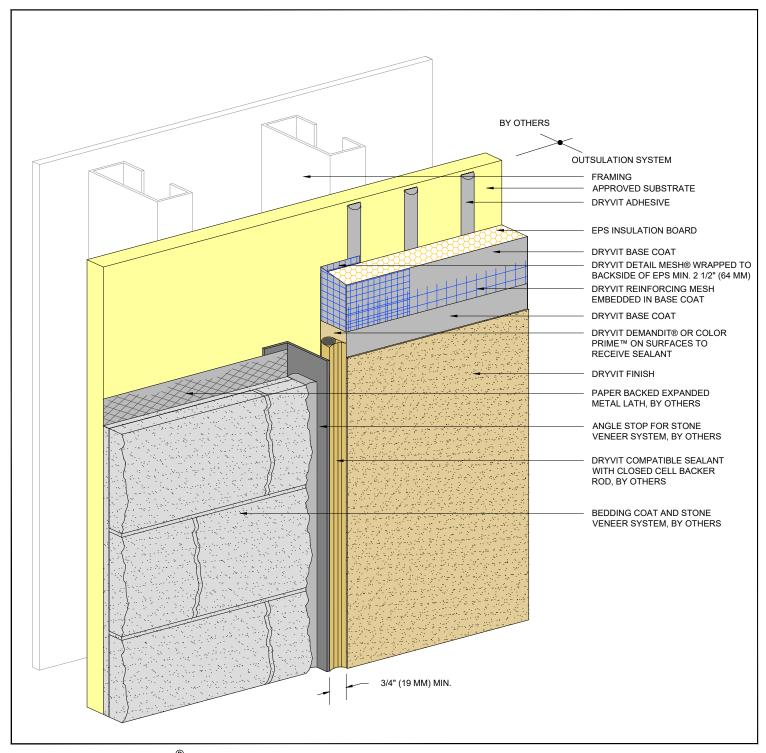


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

Vertical Termination At Stone Veneer



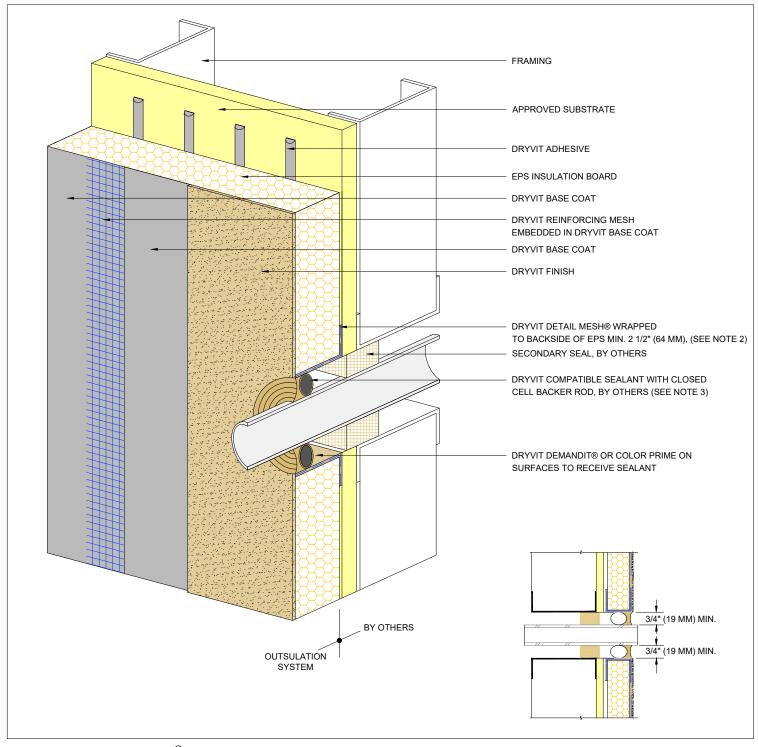

Penetrations


NOTE

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. AS AN OPTION, THE REINFORCED BASE COAT MAY BE EXTENDED ONTO THE FRAMING CREATING AN EDGE WRAP.

3. SEALANT SHALL NOT BE IN DIRECT CONTACT WITH ASPHALTIC ADHESIVE ON DRYVIT FLASHING TAPE. COVER DRYVIT FLASHING TAPE LAPS WITH POLYETHYLENE TAPE OR BACKER ROD.



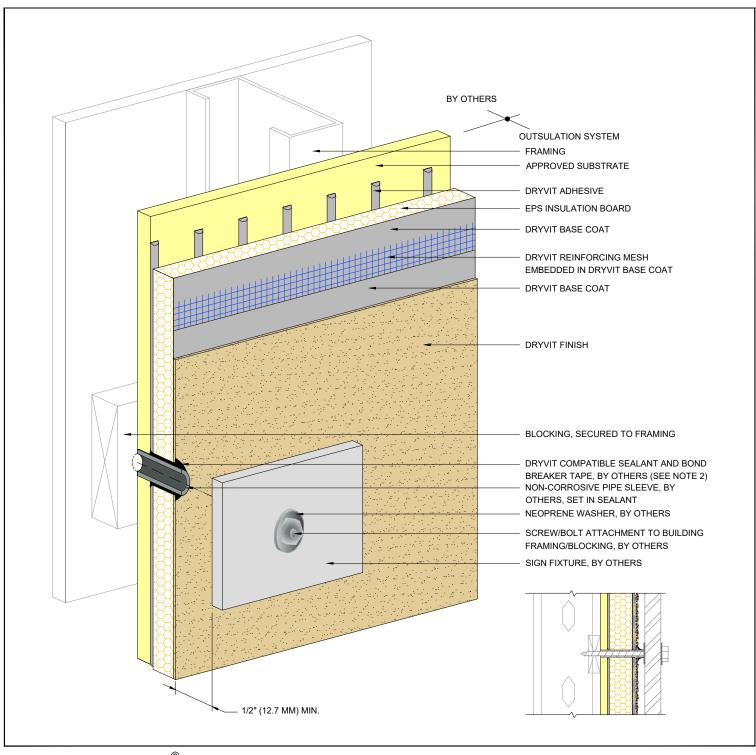


Sign Attachment

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. PERIMETER OF PIPE SLEEVE IS CAULKED TO PREVENT WATER ENTRY INTO WALL.



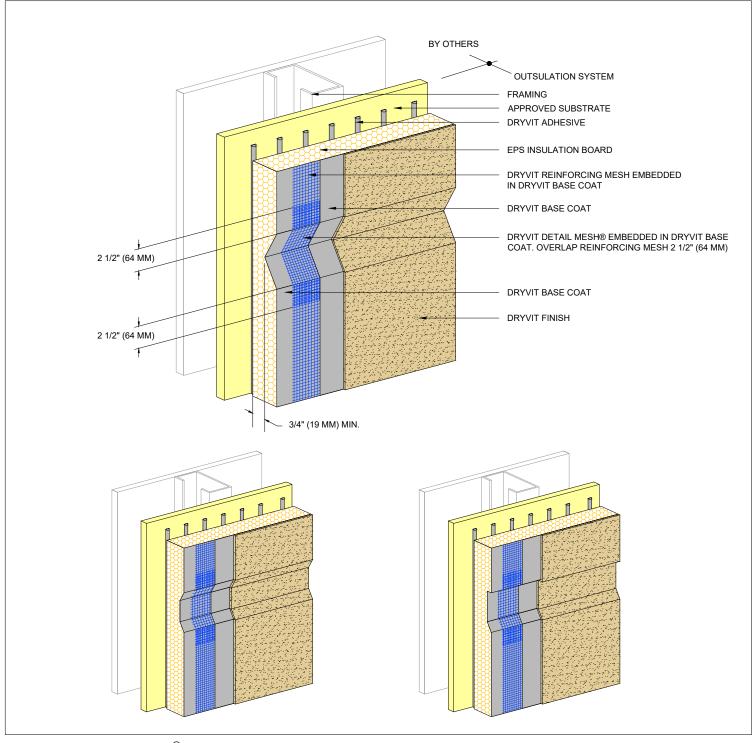


Aesthetic Reveals

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS


2. SLOPE BOTTOM EDGE OF REVEAL FOR POSITIVE DRAINAGE.



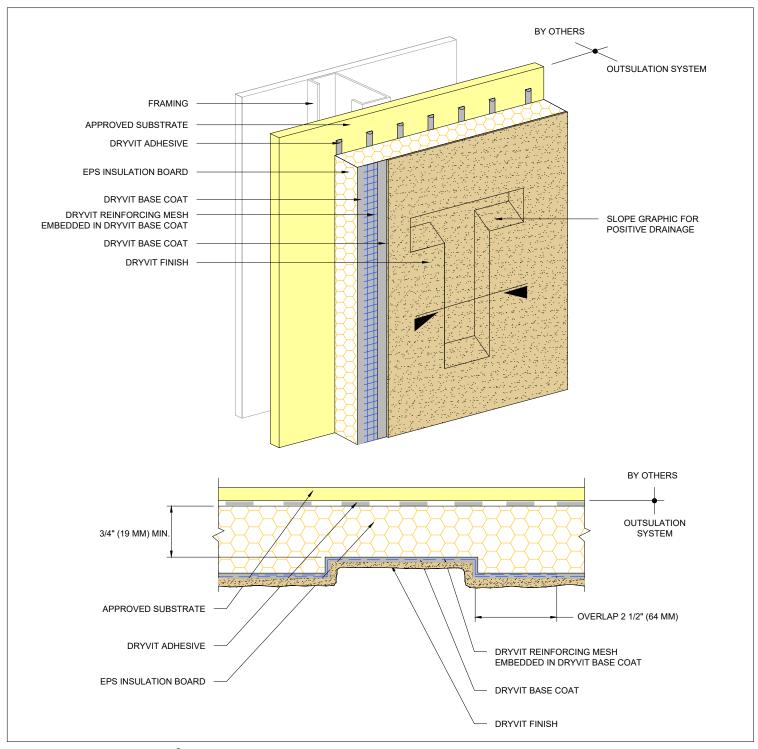

Recessed Graphics



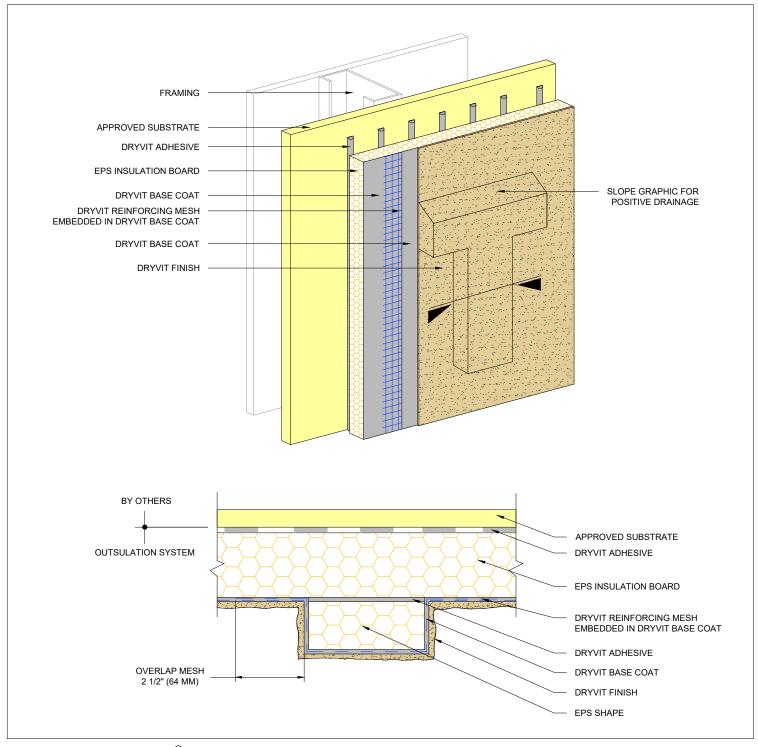

Projecting Graphics

NOTE:

OUT SHAPES SHALL NOT EXCEED

13 INCHES (330 MM) AT ANY POINT
MEASURED FROM THE SUBSTRATE.

