# Outsulation<sup>®</sup> HDCI<sup>™</sup> Systems dryvit

A Highly Durable Exterior Cladding System That Incorporates Continuous Insulation



**DS866** 

### **Outsulation HDCI System Installation Details**

### **TABLE OF CONTENTS**

### DETAIL

OUTSULATION HDCI SYSTEM	HDCI 0.0.01
OUTSULATION HDCI SYSTEM -	HDCI 0.0.01a
STARTER BOARD OPTION	
AWRB APPLICATION	HDCI 0.0.02
OPENING PREPARATION-	HDCI 0.0.03
AQUAFLASH® SYSTEM OPTION	112 01 0.0.00
OPENING PREPARATION-	HDCI 0.0.04
BACKSTOP® NT OPTION	11001 0.0.04
OPENING FLASHING INTEGRATION	HDCI 0.0.05
INSIDE CORNER	HDCI 0.0.05
OUTSIDE CORNER	HDCI 0.0.07
GRADE TERMINATION WITH	HDCI 0.0.07
	HDCI 0.0.06
GRADE TERMINATION WITH	HDCI 0.0.09
DRAINAGE TRACK	
TERMINATION AT CONCRETE CURB	HDCI 0.0.10
TERMINATION AT ADA COMPLIANT	HDCI 0.0.11
SIDEWALK	
EPS PREPARATION AT	HDCI 0.0.12
WALL PENETRATIONS	
STOREFRONT WINDOW SILL - JAMB	HDCI 0.0.13
SELF FLASHING WINDOW SILL - JAMB	HDCI 0.0.14
STOREFRONT AND FLANGED	HDCI 0.0.15
WINDOW HEAD	
HEAD J-TRACK OPTION	HDCI 0.0.16
TERMINATION AT	HDCI 0.0.17
WOOD FRAMED DECK	
TERMINATION AT	HDCI 0.0.18
WATERPROOF DECK	
PREPARATION AT PARAPET/	HDCI 0.0.19
WALL INTERSECTION	
TERMINATION AT PARAPET -	HDCI 0.0.20
CAP FLASHING	
TERMINATION AT ROOF MEMBRANE	HDCI 0.0.21
TERMINIATION AT DOOF STOD ELASUINO	
TERMINATION AT ROOF STOP PLASHING TERMINATION AT SLOPED ROOF	HDCI 0.0.23
VERTICAL WALL/ SUSPENDED	HDCI 0.0.24
SOFFIT TRANSITION	112 01 0.0.21
TRANSITION AT SOFFIT/	HDCI 0.0.25
FASCIA INTERSECTION	11001 0.0.20
FASCIA/ UNINSULATED SOFFIT	HDCI 0.0.26
TRANSITION	TIDCI 0.0.20
TERMINATION AT	HDCI 0.0.27
UNINSULATED SOFFIT VENT	HDCI 0.0.27
	HDCI 0.0.28
WITHOUT WEEPS	
HORIZONTAL SLIP JOINT	HDCI 0.0.29
WITH WEEPS	
HORIZONTAL JOINT -	HDCI 0.0.30
SUBSTRATE CHANGE	

### DETAIL

HORIZONTAL TERMINATIONHDCI 0.0.32AT STUCCOHORIZONTAL TERMINATIONHDCI 0.0.33HORIZONTAL TERMINATIONHDCI 0.0.33AT LAPPED SIDINGVERTICAL EIFS EXPANSION JOINTHDCI 0.0.34VERTICAL EIFS EXPANSION JOINTHDCI 0.0.35VERTICAL EXPANSION JOINT -HDCI 0.0.36FLUSH AND RECESSED OPTIONSVERTICAL EXPANSION JOINT -VERTICAL EXPANSION JOINT -HDCI 0.0.37DOUBLE SEAL OPTIONVERTICAL TERMINATIONVERTICAL TERMINATIONHDCI 0.0.38AT STONE VENEERPENETRATIONSPENETRATIONSHDCI 0.0.40AESTHETIC REVEALSHDCI 0.0.41	HORIZONTAL TERMINATION AT STONE VENEER	HDCI 0.0.31
AT LAPPED SIDINGVERTICAL EIFS EXPANSION JOINTHDCI 0.0.34THROUGH-WALL EXPANSION JOINTHDCI 0.0.35VERTICAL EXPANSION JOINT -HDCI 0.0.36FLUSH AND RECESSED OPTIONSVERTICAL EXPANSION JOINT -VERTICAL EXPANSION JOINT -HDCI 0.0.37DOUBLE SEAL OPTIONVERTICAL TERMINATIONVERTICAL TERMINATIONHDCI 0.0.38AT STONE VENEERPENETRATIONSPENETRATIONSHDCI 0.0.40AESTHETIC REVEALSHDCI 0.0.41	HORIZONTAL TERMINATION	HDCI 0.0.32
THROUGH-WALL EXPANSION JOINTHDCI 0.0.35VERTICAL EXPANSION JOINT -HDCI 0.0.36FLUSH AND RECESSED OPTIONSHDCI 0.0.37VERTICAL EXPANSION JOINT -HDCI 0.0.37DOUBLE SEAL OPTIONVERTICAL TERMINATIONVERTICAL TERMINATIONHDCI 0.0.38AT STONE VENEERHDCI 0.0.39SIGN ATTACHMENTHDCI 0.0.40AESTHETIC REVEALSHDCI 0.0.41		HDCI 0.0.33
VERTICAL EXPANSION JOINT - FLUSH AND RECESSED OPTIONSHDCI 0.0.36VERTICAL EXPANSION JOINT - DOUBLE SEAL OPTIONHDCI 0.0.37VERTICAL TERMINATION VERTICAL TERMINATIONHDCI 0.0.38AT STONE VENEER 	VERTICAL EIFS EXPANSION JOINT	HDCI 0.0.34
FLUSH AND RECESSED OPTIONSVERTICAL EXPANSION JOINT -DOUBLE SEAL OPTIONVERTICAL TERMINATIONHDCI 0.0.38AT STONE VENEERPENETRATIONSHDCI 0.0.39SIGN ATTACHMENTHDCI 0.0.40AESTHETIC REVEALS	THROUGH-WALL EXPANSION JOINT	HDCI 0.0.35
VERTICAL EXPANSION JOINT - DOUBLE SEAL OPTIONHDCI 0.0.37VERTICAL TERMINATIONHDCI 0.0.38AT STONE VENEERHDCI 0.0.39PENETRATIONSHDCI 0.0.40AESTHETIC REVEALSHDCI 0.0.41	VERTICAL EXPANSION JOINT -	HDCI 0.0.36
DOUBLE SEAL OPTIONVERTICAL TERMINATIONHDCI 0.0.38AT STONE VENEERHDCI 0.0.39PENETRATIONSHDCI 0.0.40SIGN ATTACHMENTHDCI 0.0.40AESTHETIC REVEALSHDCI 0.0.41	FLUSH AND RECESSED OPTIONS	
VERTICAL TERMINATIONHDCI 0.0.38AT STONE VENEERHDCI 0.0.39PENETRATIONSHDCI 0.0.40SIGN ATTACHMENTHDCI 0.0.40AESTHETIC REVEALSHDCI 0.0.41	VERTICAL EXPANSION JOINT -	HDCI 0.0.37
AT STONE VENEERPENETRATIONSHDCI 0.0.39SIGN ATTACHMENTHDCI 0.0.40AESTHETIC REVEALSHDCI 0.0.41	DOUBLE SEAL OPTION	
PENETRATIONSHDCI 0.0.39SIGN ATTACHMENTHDCI 0.0.40AESTHETIC REVEALSHDCI 0.0.41	VERTICAL TERMINATION	HDCI 0.0.38
SIGN ATTACHMENTHDCI 0.0.40AESTHETIC REVEALSHDCI 0.0.41	AT STONE VENEER	
AESTHETIC REVEALS HDCI 0.0.41	PENETRATIONS	HDCI 0.0.39
	SIGN ATTACHMENT	HDCI 0.0.40
RECESSED GRAPHICS HDCI 0.0.42	AESTHETIC REVEALS	HDCI 0.0.41
	RECESSED GRAPHICS	HDCI 0.0.42
PROJECTING GRAPHICS HDCI 0.0.43	PROJECTING GRAPHICS	HDCI 0.0.43
EPS SHAPES HDCI 0.0.44	EPS SHAPES	HDCI 0.0.44

### NOTE


DRYVIT MAKES NO REPRESENTATION REGARDING CONFORMITY OF ITS SUGGESTIONS TO MODEL BUILDING CODES, ENGINEERING CRITERIA, SPECIFIC APPLICATIONS, OR PROJECT LOCATIONS. ALL COMPONENTS INDICATED IN ILLUSTRATIONS, AS WELL AS OTHERS THAT MAY BE REQUIRED FOR THE INTEGRITY OF THE SYSTEM SHALL BE DESIGNED, DETAILED, AND ENGINEERED BY REPRESENTATIVES OF THE ARCHITECT, OWNER, OR CONTRACTOR TO BE IN CONFORMANCE WITH MODEL CODES, ARCHITECTURAL, AND ENGINEERING REQUIREMENTS PERTAINING TO SPECIFIC BUILDING PROJECTS.

DRYVIT MAKES NO WARRANTY, EXPRESSED OR IMPLIED, AS TO THE ARCHITECTURAL DESIGN, ENGINEERING, OR WORKMANSHIP OF PROJECTS UTILIZING DRYVIT SYSTEMS OR PRODUCTS.

THE LIABILITIES OF DRYVIT SHALL BE AS STATED IN THE OUTSULATION HDCI LIMITED COMMERCIAL WARRANTY. CONTACT DRYVIT FOR A FULL AND COMPLETE COPY OF THE WARRANTY.

### Outsulation<sup>®</sup> HDCI<sup>™</sup> System



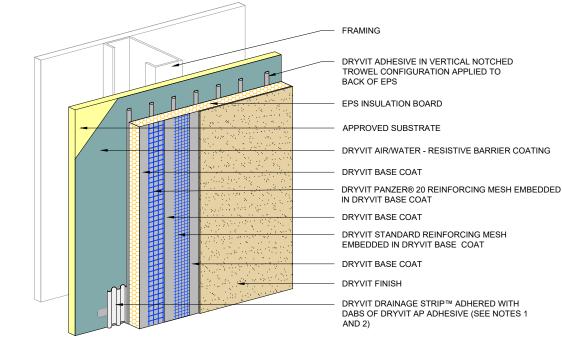

### Outsulation<sup>®</sup> HDCI<sup>™</sup> System

NOTE:


1. AS AN OPTION DRYVIT DRAINAGE TRACK™ CAN BE USED AT SYSTEM TERMINATION AT GRADE, REFER TO HDCI 0.0.09 FOR CONFIGURATION.

2. DRYVIT DRAINAGE TRACK SHALL ONLY BE USED AT GRADE LEVEL TERMINATIONS.

### **Outsulation HDCI System**



### HDCI 0.0.01a

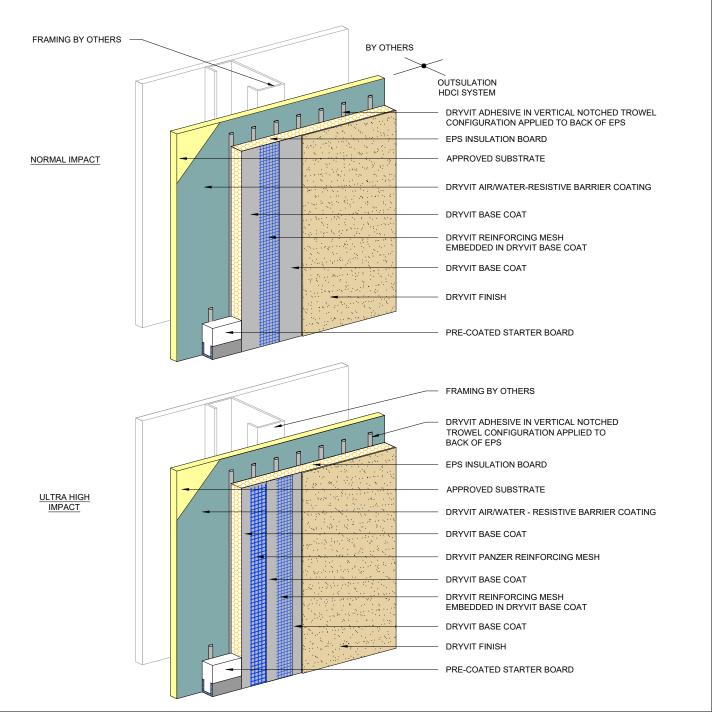


## Outsulation<sup>®</sup> HDCI<sup>™</sup> System

#### NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

### Outsulation HDCI System Starter Board Option



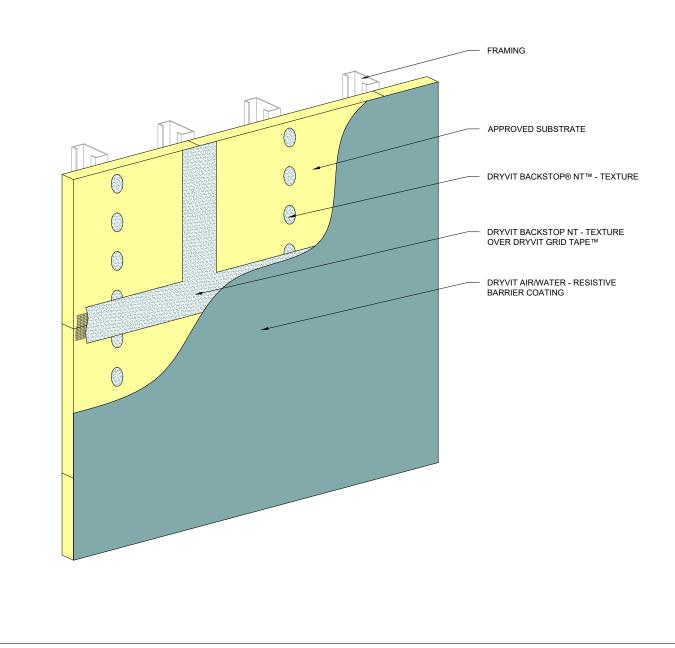


## Outsulation<sup>®</sup> HDCI<sup>™</sup> System

### **AWRB** Application

NOTE: 1. FOR ADDITIONAL AIR/WATER-RESISTIVE BARRIER DETAILS, REFER TO DRYVIT PUBLICATION DS840.



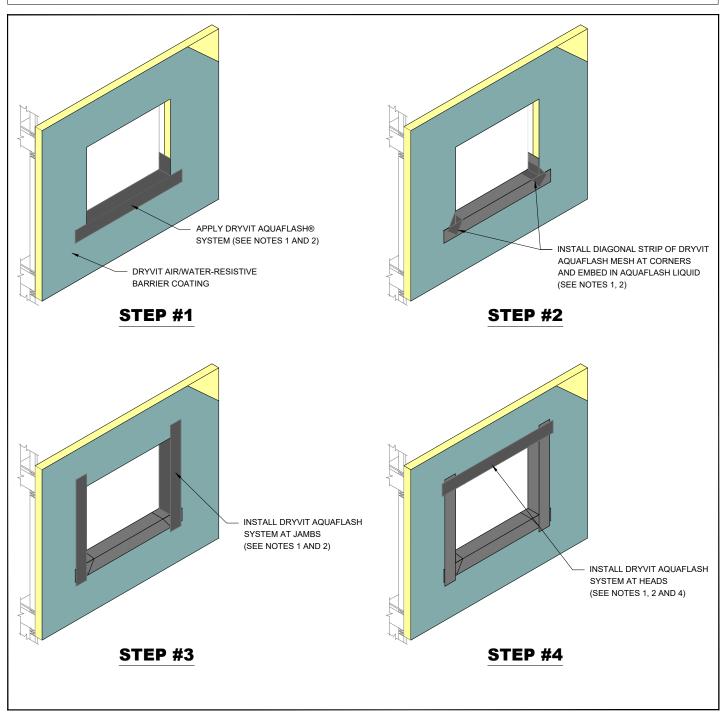

## Outsulation<sup>®</sup> HDCI<sup>™</sup> System

#### NOTE

1. DRYVIT AQUAFLASH SHALL EXTEND TO INTERIOR FACE OF OPENING.

2. REFER TO HEAD, SILL AND JAMB DETAILS FOR FLASHING INTEGRATION.


3. INSTALL WINDOW UNIT AND ASSOCIATED FLASHINGS PER MANUFACTURER'S RECOMMENDATIONS, CODE REQUIREMENTS AND PROJECT DOCUMENTS. 4. AQUAFLASH SYSTEM CONSISTS OF AQUAFLASH MESH AND AQUAFLASH LIQUID.

5. FOR ADDITIONAL AIR/WATER-RESISTIVE BARRIER DETAILS, REFER TO DRYVIT PUBLICATION DS840.

### Opening Preparation -AquaFlash® System<sup>4</sup> Option





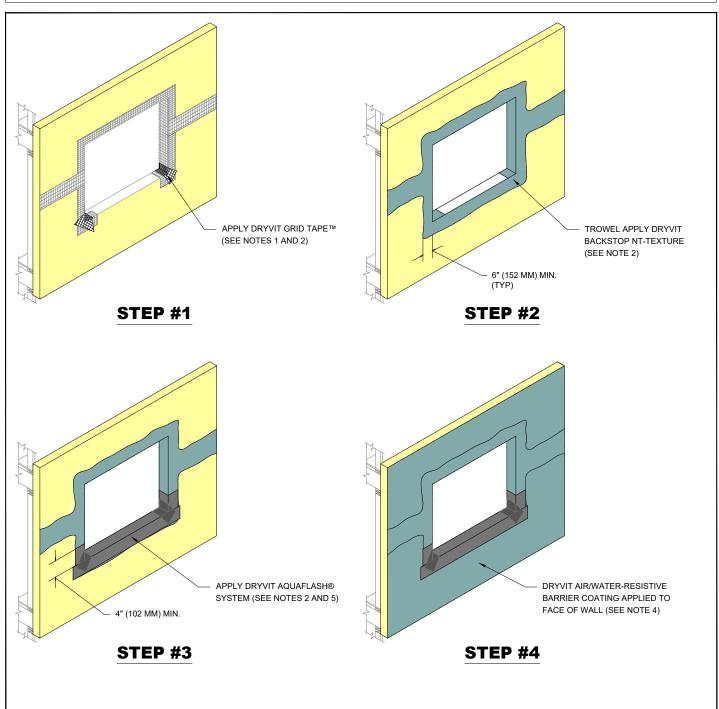

### Outsulation<sup>®</sup> HDCI<sup>™</sup> System

#### NOTE:

1. APPLY DRYVIT GRID TAPE ON HEAD, JAMB, AND CORNERS OF OPENINGS AND SHEATHING JOINTS.

2. TROWEL APPLY DRYVIT BACKSTOP NT-TEXTURE OVER THE DRYVIT GRID TAPE ALL THE WAY TO INSIDE FACE OF OPENING. ALL VOIDS MUST BE FILLED; MULTIPLE PASSES MAY BE REQUIRED. AS AN OPTION, DRYVIT GRID TAPE AND DRYVIT BACKSTOP NT-TEXTURE MAY ALSO BE APPLIED AT THE SILL PRIOR TO DRYVIT AQUAFLASH SYSTEM APPLICATION.


3. INSTALL WINDOW UNIT AND ASSOCIATED FLASHINGS PER MANUFACTURER'S RECOMMENDATIONS, CODE REQUIREMENTS AND PROJECT DOCUMENTS 4. REFER TO HEAD, SILL, AND JAMB DETAILS FOR FLASHING INTEGRATION.

5. FOR ADDITIONAL AIR/WATER-RESISTIVE BARRIER DETAILS, REFER TO DRYVIT PUBLICATION DS840. The architecture, engineering, and design of the project using the Dryvit products is the responsibility of the project's design professional. All systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit specifically disclaims any liability for the use of this detail and for the architecture, design, engineering or workmanship of any project. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. Use of a functionally equivalent detail does not violate Dryvit's warranty. This detail is subject to change without notice. Contact Dryvit to ensure you have the most recent version.

**Opening Preparation -**

Backstop® NT<sup>™</sup> Option



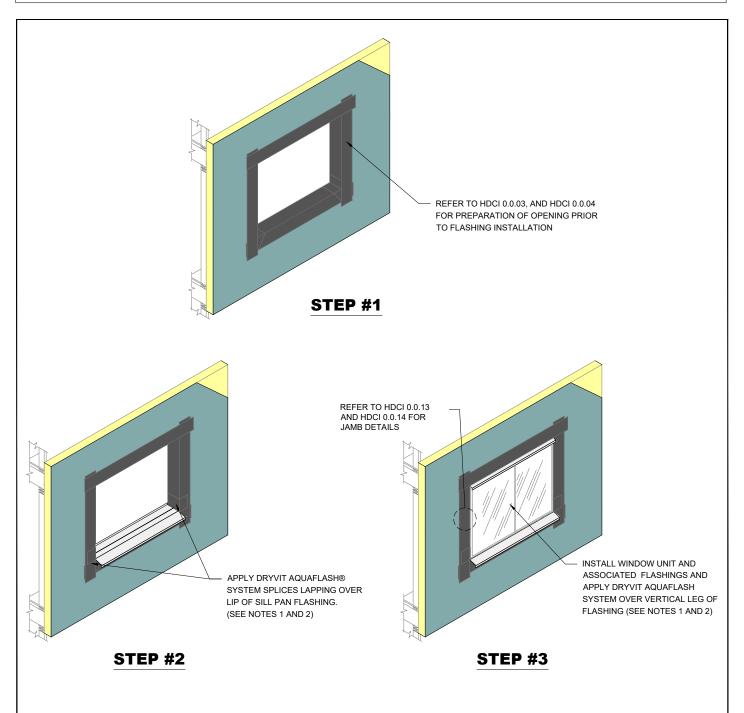


## Outsulation<sup>®</sup> HDCI<sup>™</sup> System

NOTE: 1. REFER TO HDCI 0.0.13 THROUGH HDCI 0.0.16 FOR INTEGRATION OF FLASHING.

2. FOR ADDITIONAL AIR/WATER-RESISTIVE BARRIER DETAILS, REFER TO DRYVIT PUBLICATION DS840.

### **Opening Flashing Integration**




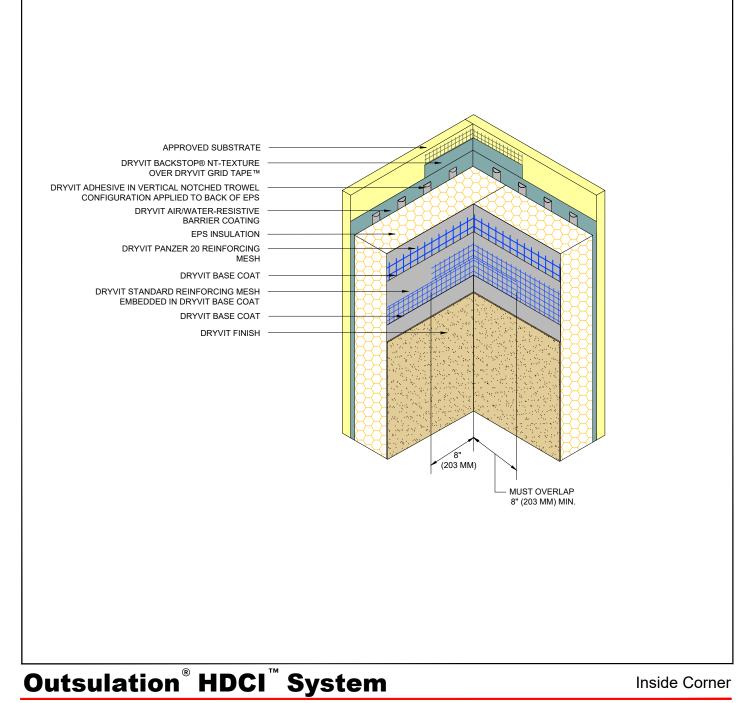

#### NOTE: 1. DOUBLE WRAP CORNERS WITH

REINFORCING MESH OR USE CORNER MESH.



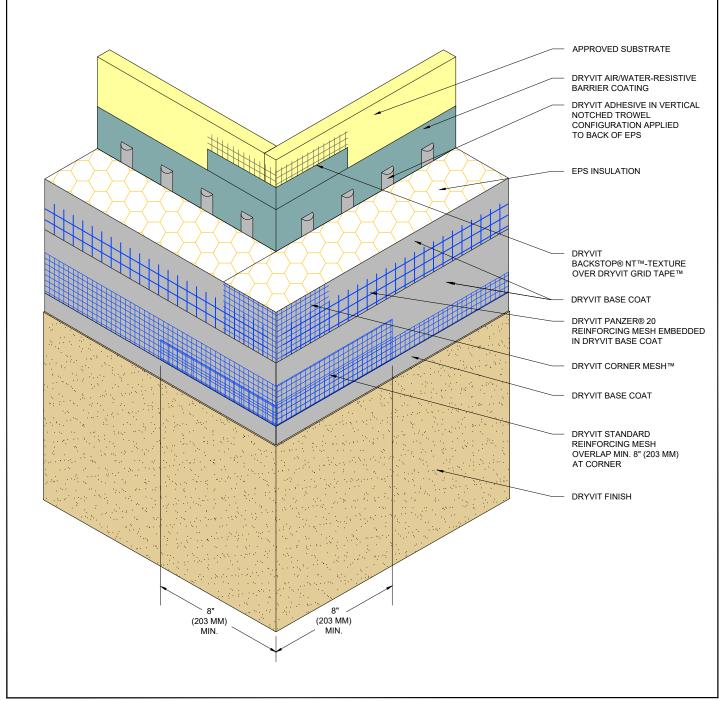


## Outsulation<sup>®</sup> HDCI<sup>™</sup> System

### **Outside Corner**

NOTE: 1. OUTSIDE INSULATION BOARD EDGES SHALL BE OFFSET.



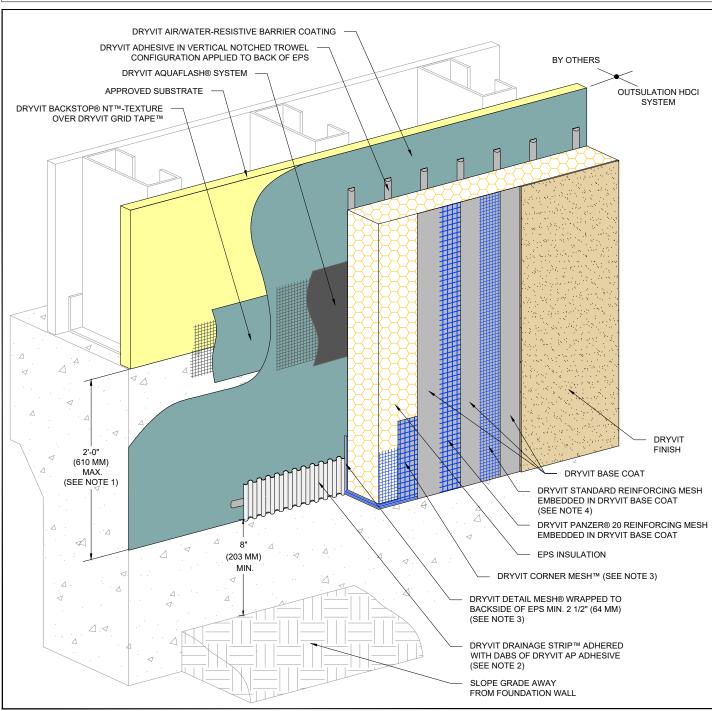

## Outsulation<sup>®</sup> HDCI<sup>™</sup> System

#### NOTE:

1. EXPANSION JOINT IS REQUIRED ALONG TOP OF FOUNDATION IF 2'-0" (610 MM) DIMENSION IS EXCEEDED.

2. ENSURE BOTTOM EDGE OF DRAINAGE STRIP IS LEFT FREE TO DRAIN.


3. DRYVIT CORNER MESH AND DRYVIT DETAIL MESH ARE EMBEDDED IN DRYVIT BASE COAT, NOT SHOWN FOR CLARITY. TRIM CORNER MESH TO FACE OF SUBSTRATE AS REQUIRED.

4. EXTEND DRYVIT STANDARD REINFORCING MESH ONTO EDGE OF EPS.

The architecture, engineering, and design of the project using the Dryvit products is the responsibility of the project's design professional. All systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit specifically disclaims any liability for the use of this detail and for the architecture, design, engineering or workmanship of any project. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. Use of a functionally equivalent detail does not violate Dryvit's warranty. This detail is subject to change without notice. Contact Dryvit to ensure you have the most recent version.

Grade Termination with Drainage Strip



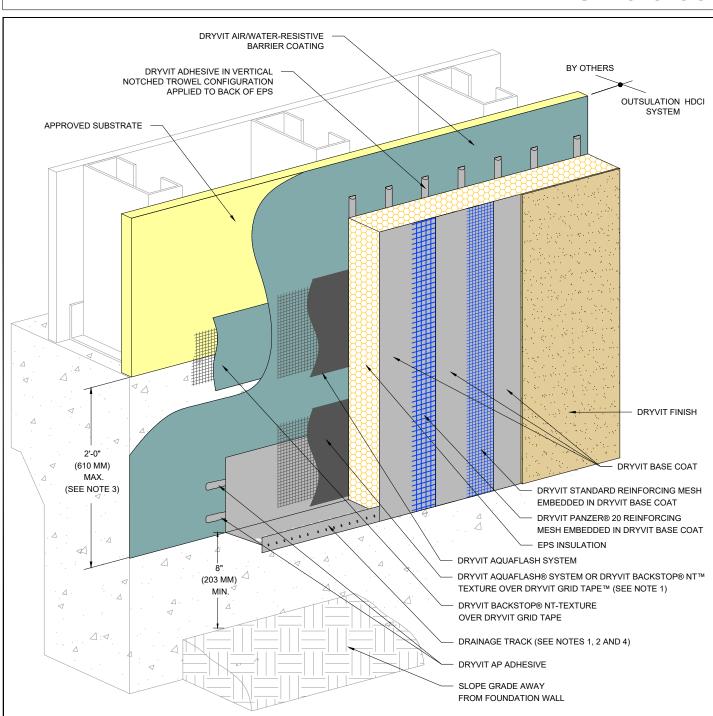

### Outsulation<sup>®</sup> HDCI<sup>™</sup> System

### Grade Termination with Drainage Track

#### NOTE:

1. LIGHTLY SAND SURFACE OF DRAINAGE TRACK TO MAXIMIZE ADHESION.


2. DRYVIT DRAINAGE STRIP MAY BE SUBSTITUTED FOR DRYVIT DRAINAGE TRACK. IF DRYVIT DRAINAGE STRIP IS USED, EPS INSULATION MUST BE BACK WRAPPED WITH DRYVIT REINFORCING MESH AND DRYVIT BASE COAT (SEE HDCI 0.0.08). 3. EXPANSION JOINT IS REQUIRED ALONG TOP OF FOUNDATION IF 2'-0" (610 MM) DIMENSION IS EXCEEDED.

4. DRAINAGE TRACK USAGE IS LIMITED TO THE BASE OF THE SYSTEM AT FINISHED GRADE LEVEL.

The architecture, engineering, and design of the project using the Dryvit products is the responsibility of the project's design professional. All systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit specifically disclaims any liability for the use of this detail

and for the architecture, design, engineering or workmanship of any project. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. Use of a functionally equivalent detail does not violate Dryvit's warranty. This detail is subject to change without notice. Contact Dryvit to ensure you have the most recent version.



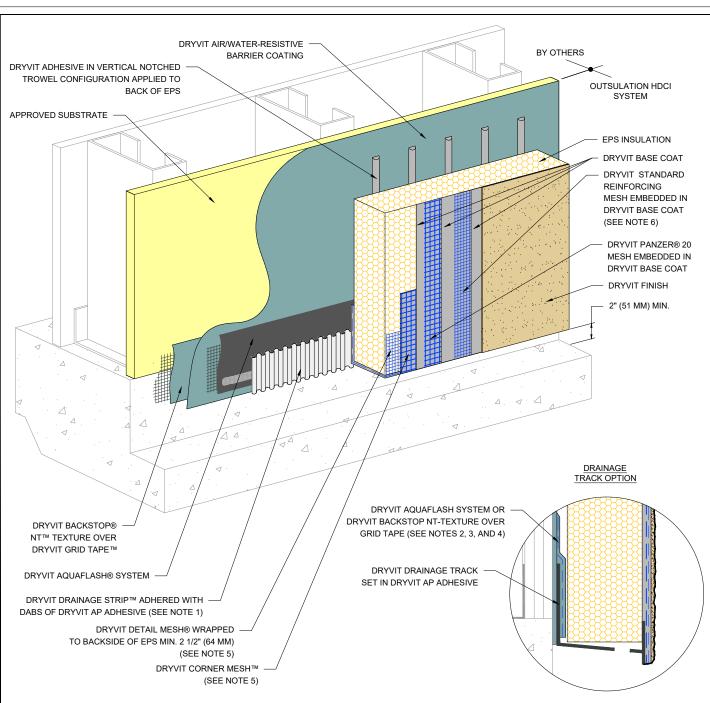

## Outsulation<sup>®</sup> HDCI<sup>™</sup> System

#### NOTE:

1. ENSURE BOTTOM EDGE OF DRAINAGE STRIP IS LEFT FREE TO DRAIN.

2. AS AN OPTION DRYVIT DRAINAGE TRACK CAN BE USED AT SYSTEM TERMINATION AT GRADE. REFER TO HDCI 0.0.09 FOR CONFIGURATION.

3. LIGHTLY SAND SURFACE OF DRAINAGE TRACK TO MAXIMIZE ADHESION.


4. DRYVIT DRAINAGE TRACK SHALL ONLY BE USED AT GRADE LEVEL TERMINATIONS.

5. DRYVIT CORNER MESH AND DRYVIT DETAIL MESH ARE EMBEDDED IN DRYVIT BASE COAT, NOT SHOWN FOR CLARITY.

6. EXTEND DRYVIT STANDARD REINFORCING MESH ONTO EDGE OF EPS.

### Termination At Concrete Curb



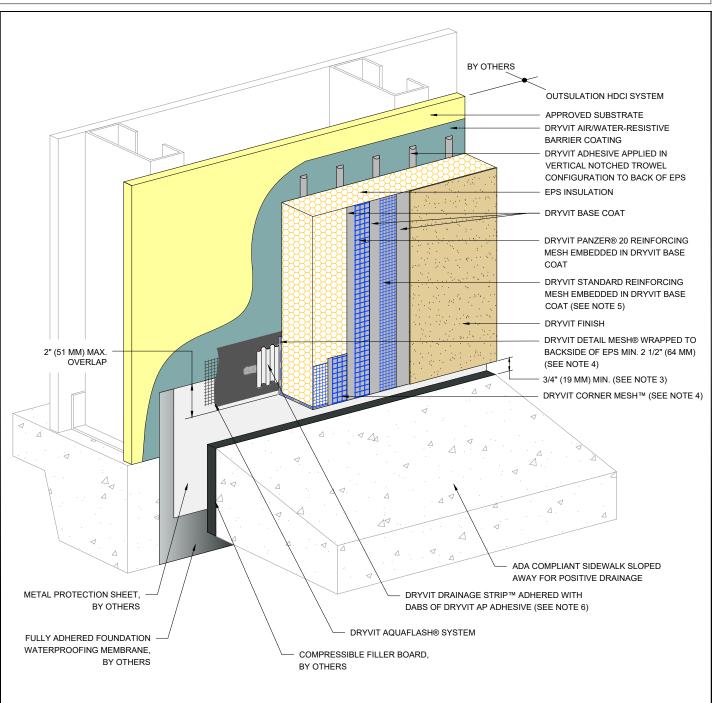

## Outsulation<sup>®</sup> HDCI<sup>™</sup> System

### Termination At ADA Compliant Sidewalk

NOTE:

1. USE OF THIS DETAIL IS LIMITED TO SLAB-ON-GRADE APPLICATIONS.


2. INCORPORATE MEASURES TO PROTECT STRUCTURE FROM MOISTURE INTRUSION, DAMPNESS, AND FROST HEAVE.

3. TO PREVENT DEBRIS ACCUMULATION, IT IS RECOMMENDED TO TERMINATE SYSTEM 2" (51 MM) ABOVE SIDEWALK. 4. DRIVIT CORNER MESH AND DRIVIT DETAIL MESH ARE EMBEDDED IN DRIVIT BASE COAT, NOT SHOWN FOR CLARITY. TRIM CORNER MESH TO FACE OF SUBSTRATE AS REQUIRED.

5. EXTEND DRIVIT STANDARD REINFORCING MESH ONTO EDGE OF EPS.

6. ENSURE BOTTOM EDGE OF DRAINAGE STRIP IS LEFT FREE TO DRAIN.



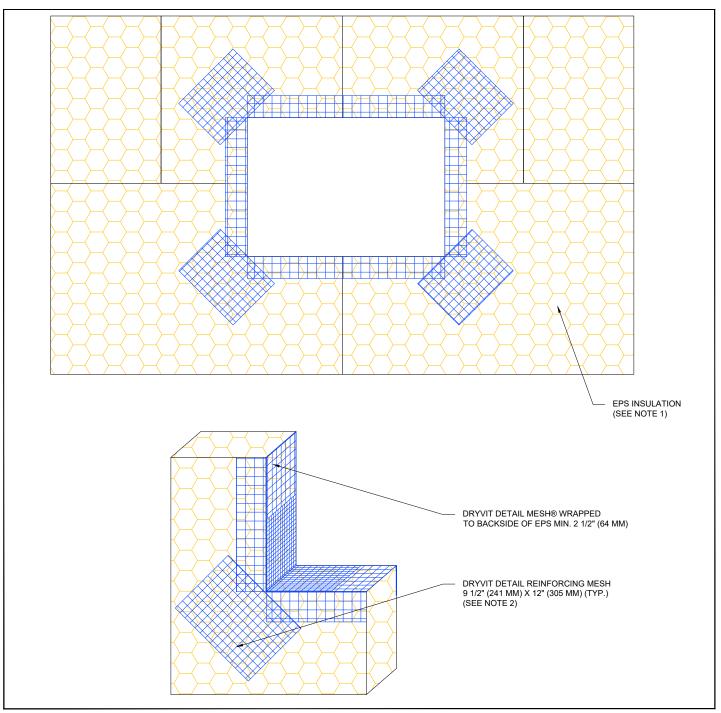

## Outsulation<sup>®</sup> HDCI<sup>™</sup> System


NOTE

1. LOCATE INSULATION BOARDS SUCH THAT BOARD EDGES DO NOT ALIGN WITH CORNERS OF PENETRATION.

2. APPLY A PIECE OF 9 1/2" (241 MM) X 12" (305 MM) DETAIL REINFORCING MESH DIAGONALLY AT EACH CORNER.

**EPS Preparation At Wall Penetrations** 



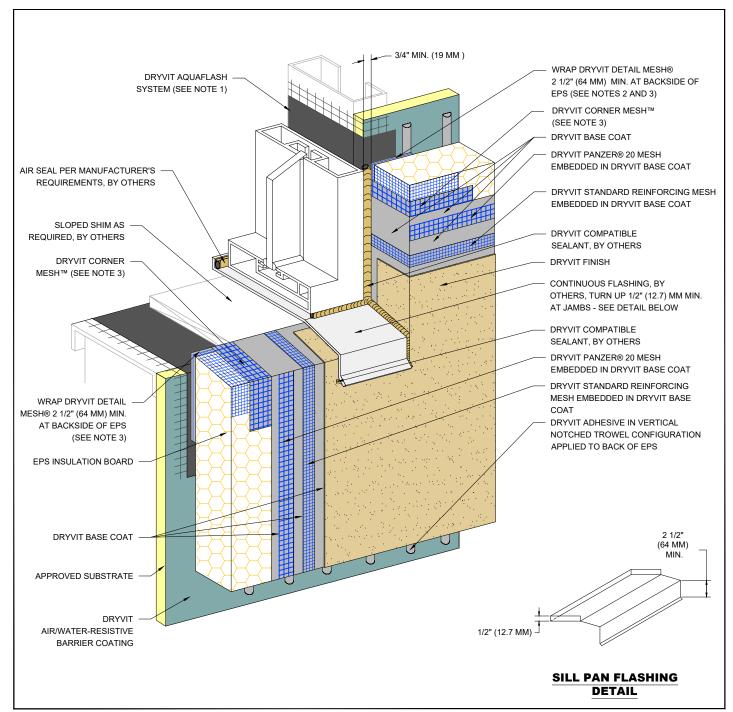

### Outsulation<sup>®</sup> HDCI<sup>™</sup> System


#### NOTE:

1. DRYVIT BACKSTOP® NT™-TEXTURE OVER GRID TAPE™ IS AN ALTERNATIVE OPTION AT JAMB AND HEAD CONDITION PER DETAIL HDCI 0.0.04.

2. EDGE WRAPPING METHOD IS ACCEPTABLE AT SILL AND JAMB IN LIEU OF BACK WRAPPING. DRYIT REINFORCING MESH MUST BE FULLY EMBEDDED IN DRYVIT BASE COAT AT EPS EDGE AND MUST EXTEND ONTO SUBSTRATE 2 1/2" (64 MM) MIN.

3. DRYVIT CORNER MESH AND DRYVIT DETAIL MESH ARE EMBEDDED IN DRYVIT BASE COAT, NOT SHOWN FOR CLARITY. Storefront Window Sill - Jamb




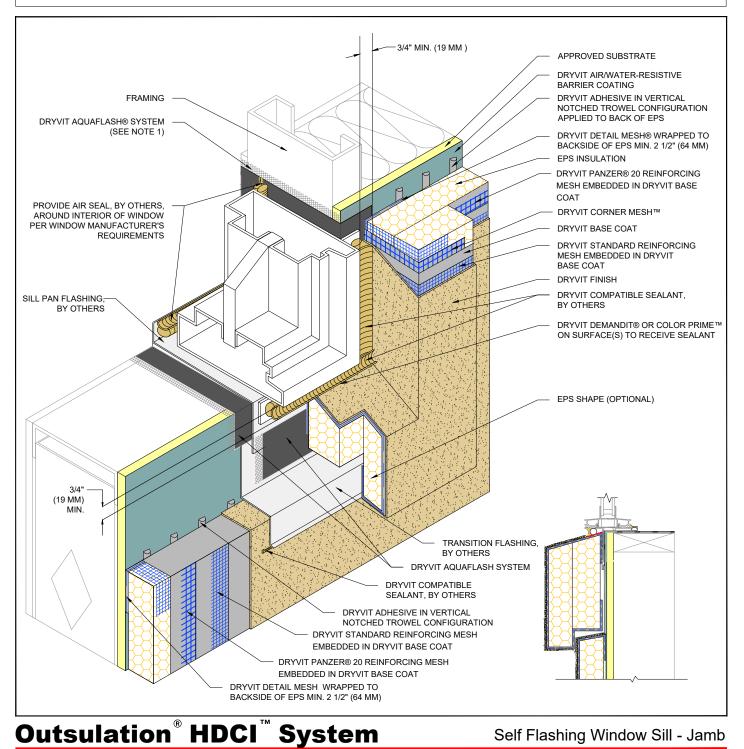

#### 1. DRYVIT BACKSTOP® NT-TEXTURE OVER DRYVIT GRID TAPE™ IS AN ALTERNATIVE OPTION AT JAMB AND HEAD CONDITION PER DETAIL HDCI 0.0.04.

2. DRYVIT CORNER MESH AND DRYVIT DETAIL MESH ARE EMBEDDED IN DRYVIT BASE COAT, NOT SHOWN FOR CLARITY.



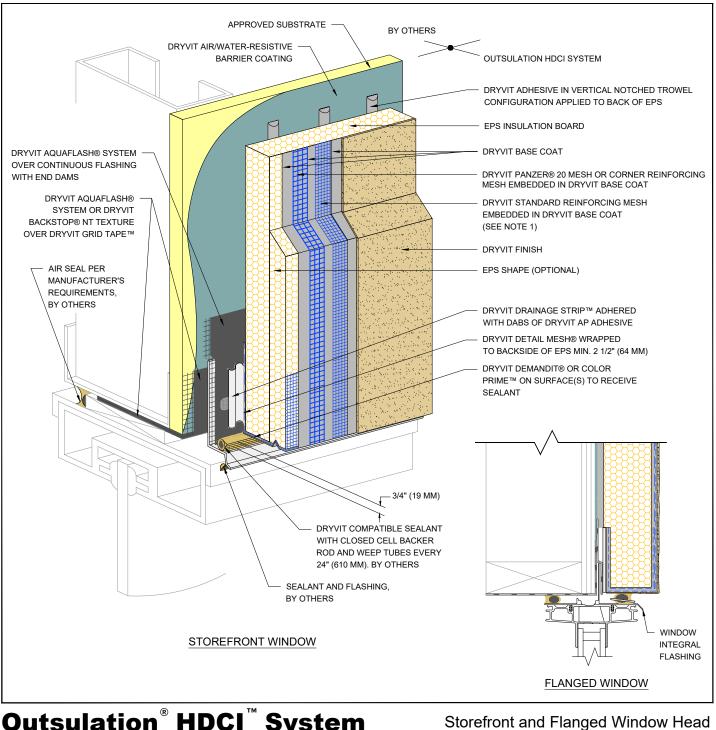


## Outsulation<sup>®</sup> HDCI<sup>™</sup> System

NOTE:

1. EXTEND DRYVIT STANDARD REINFORCING MESH ONTO EDGE OF EPS.



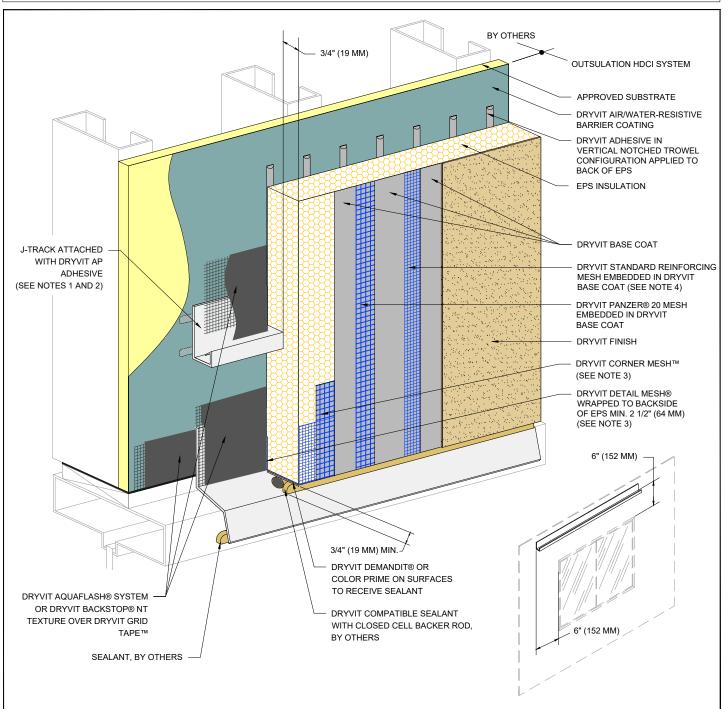

### Outsulation<sup>®</sup> HDCI<sup>™</sup> System

### Head J-Track Option


NOTE: 1. LIGHTLY SAND SURFACE OF J-TRACK TO MAXIMIZE ADHESION.

2. LENGTH OF TRACK NOT TO EXCEED 10 FT (3.0 M).

3. DRYVIT CORNER MESH AND DRYVIT DETAIL MESH ARE EMBEDDED IN DRYVIT BASE COAT, NOT SHOWN FOR CLARITY.

4. EXTEND DRYVIT STANDARD REINFORCING MESH ONTO EDGE OF EPS.



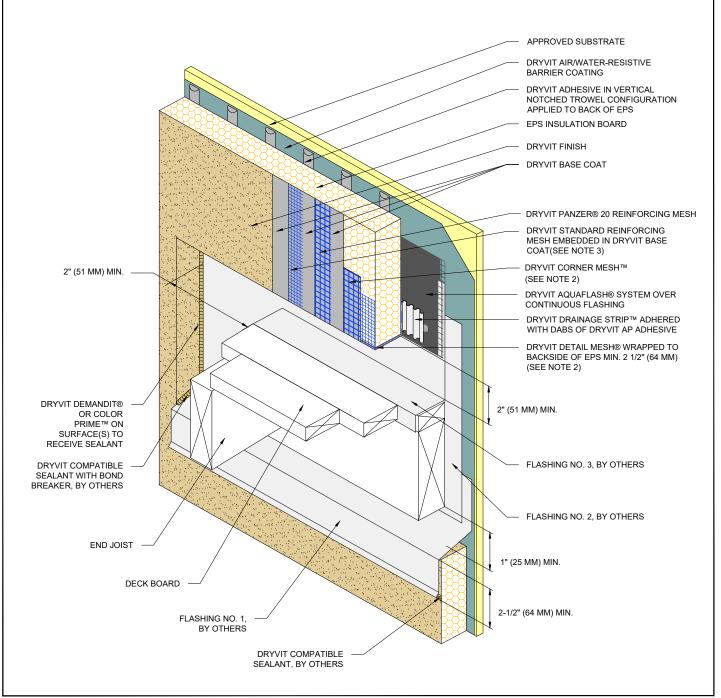

Outsulation<sup>®</sup> HDCI<sup>™</sup> System

#### NOTE:

1. DETAIL DOES NOT APPLY TO CANTILEVERED DECKS. CANTILEVERED DECKS REQUIRE PROJECT SPECIFIC FLASHING DETAILS.


2. DRYVIT CORNER MESH AND DRYVIT DETAIL MESH ARE EMBEDDED IN DRYVIT BASE COAT, NOT SHOWN FOR CLARITY.

3. EXTEND DRYVIT STANDARD REINFORCING MESH ONTO EDGE OF EPS.

### Termination at Wood Framed Deck





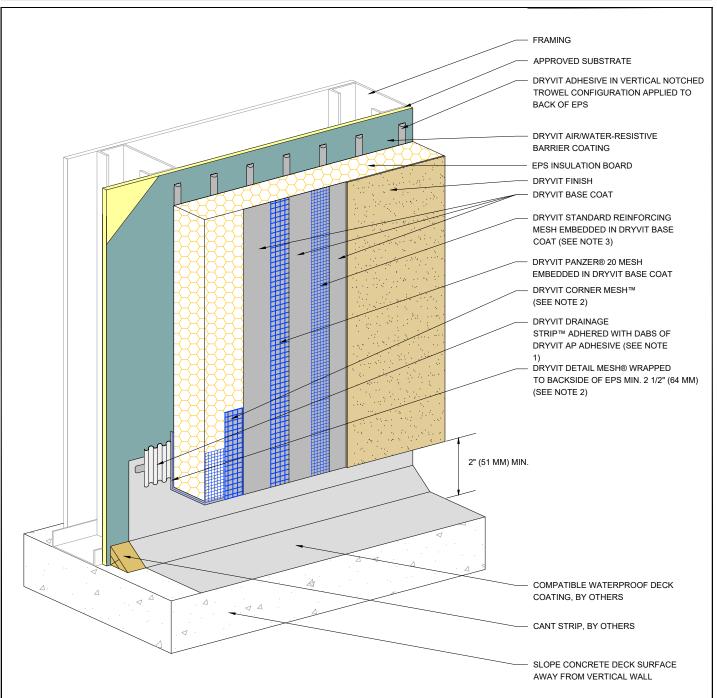

## Outsulation<sup>®</sup> HDCI<sup>™</sup> System

#### NOTE:


 ENSURE BOTTOM EDGE OF DRAINAGE STRIP IS LEFT FREE TO DRAIN.
DRYVIT CORNER MESH AND DRYVIT

DETAIL MESH ARE EMBEDDED IN DRYVIT BASE COAT, NOT SHOWN FOR CLARITY.


3. EXTEND DRYVIT STANDARD REINFORCING MESH INTO EDGE OF EPS

### Termination at Waterproof Deck



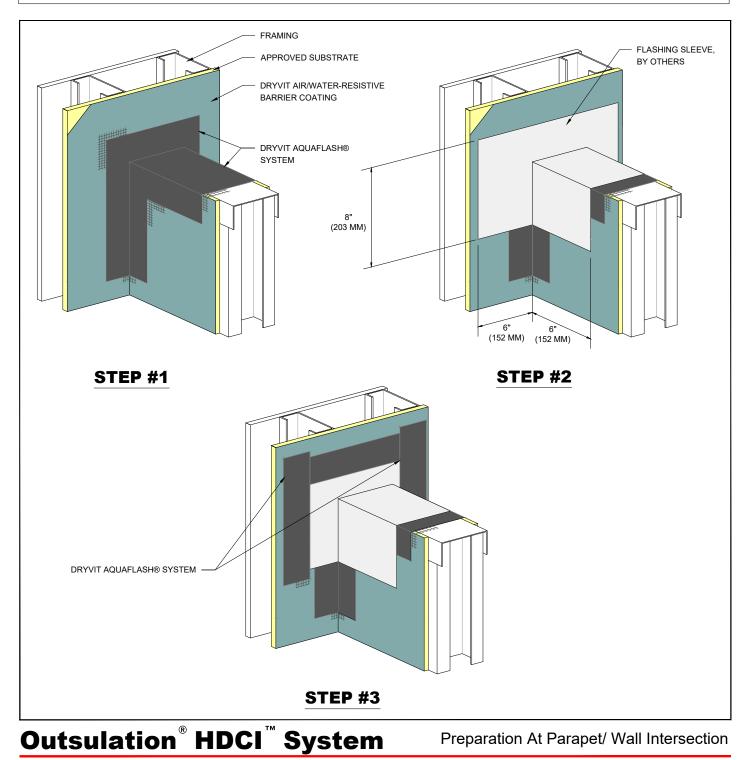



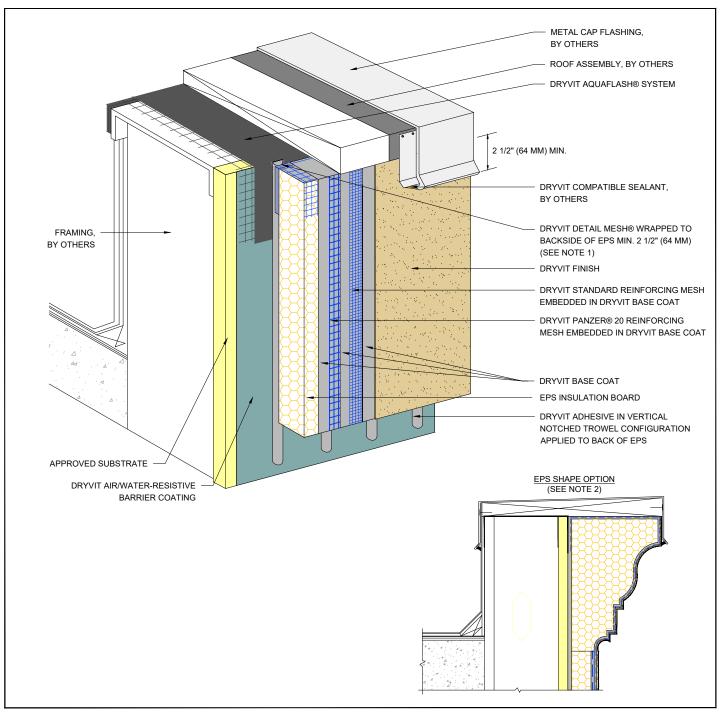

## Outsulation<sup>®</sup> HDCI<sup>™</sup> System


#### NOTE:

AND EXEMPTING IS ACCEPTABLE IN LIEU OF BACK WRAPPING. DRYVIT REINFORCING MESH MUST BE FULLY EMBEDDED IN DRYVIT BASE COAT AT EPS EDGE AND EXTENDED ONTO SUBSTRATE 2 1/2" (64 MM) MIN.

2. MAXIMUM THICKNESS OF EPS BUILT OUT SHAPES SHALL NOT EXCEED 13" (330 MM) AT ANY POINT MEASURED FROM THE SUBSTRATE.

### Termination At Parapet - Cap Flashing



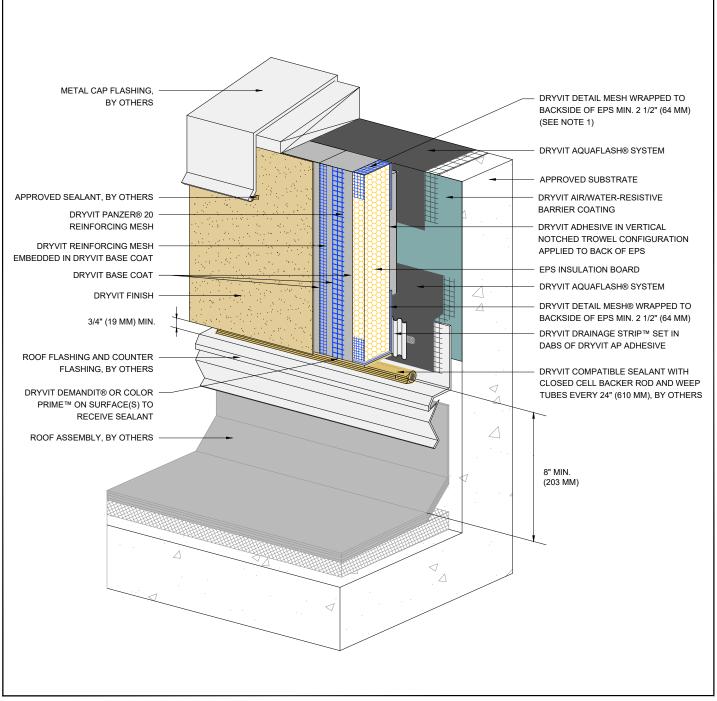


## Outsulation<sup>®</sup> HDCI<sup>™</sup> System

#### NOTE:

1. EDGE WRAPPING METHOD IS ACCEPTABLE IN LIEU OF BACK WRAPPING. DRYVIT REINFORCING MESH MUST BE FULLY EMBEDDED IN DRYVIT BASE COAT AT EPS EDGE AND EXTEND ONTO SUBSTRATE 2 1/2" (64 MM) MIN. **Termination At Roof Membrane** 



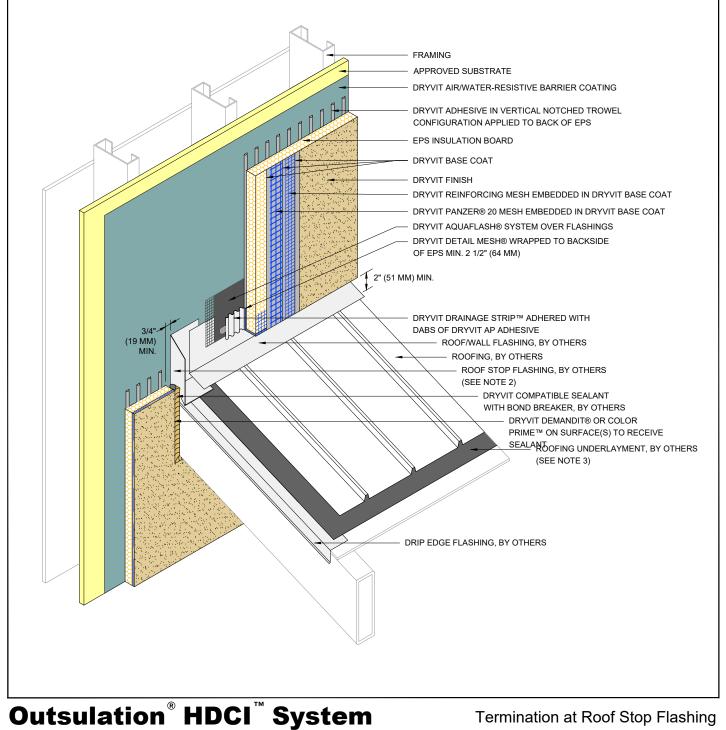

#### NOTE


1. EXTEND ROOF STOP FLASHING 1" (25 MM) MINIMUM BEYOND FACE OF THE SYSTEM.

2. ROOF STOP TO BE MADE FROM CORROSION RESISTANT MATERIAL MIN. 24 GAUGE WITH WATER TIGHT SEAMS.

3. EXTEND ROOFING UNDERLAYMENT 5" (127 MM) UP VERTICAL WALL BEHIND METAL FLASHING.

### Termination at Roof Stop Flashing



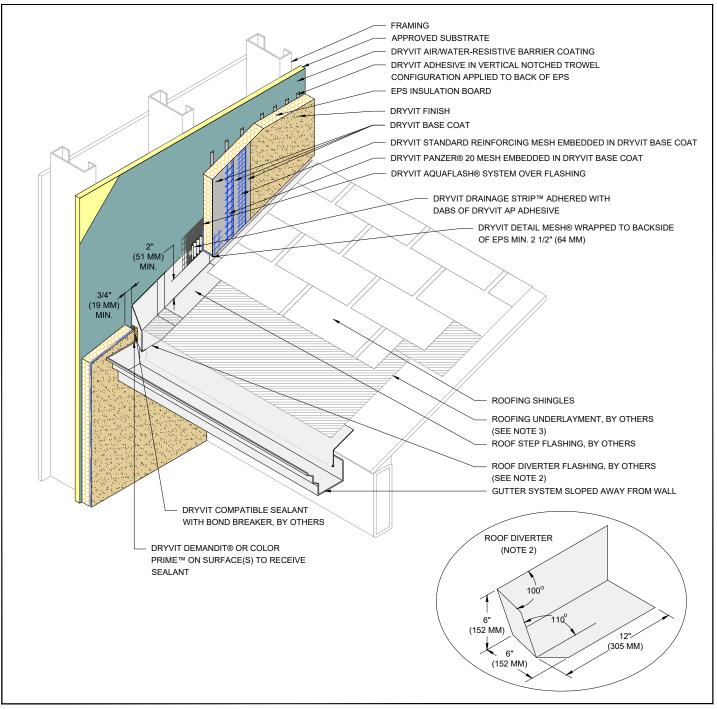

## Outsulation<sup>®</sup> HDCI<sup>™</sup> System

#### NOTE:


1. EXTEND DIVERTER FLASHING (KICKOUT) A MINIMUM OF 1" (25 MM) BEYOND FACE OF THE SYSTEM.

2. ROOF DIVERTER TO BE MADE FROM CORROSION RESISTANT MATERIAL MIN. 24 GAGE WITH WATER TIGHT SEAMS.

3. EXTEND ROOFING UNDERLAYMENT 5" (127 MM) UP VERTICAL WALL BEHIND METAL FLASHING. 4. METAL FLASHINGS ARE 10" (254 MM) X 2" (51 MM) LONGER THAN THE EXPOSED PORTION OF THE ROOFING SHINGLE AND ARE BENT IN HALF TO ALLOW FOR TWO 5" (127 MM) LEGS. ALTHOUGH NOT SHOWN, METAL FLASHINGS ARE STEP FLASHED (INTERWOVEN) WITH ROOFING SHINGLES.

### Termination at Sloped Roof



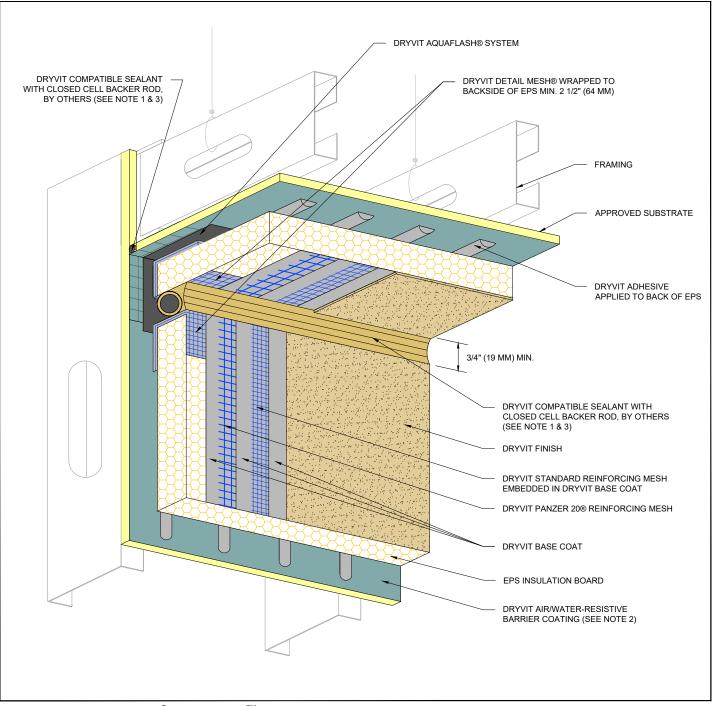

## Outsulation<sup>®</sup> HDCI<sup>™</sup> System

Vertical Wall/ Suspended Soffit Transition


#### NOTE:

1. DRYVIT DEMANDIT® OR COLOR PRIME™ ON SURFACES TO RECEIVE SEALANT.

2. DRYVIT AIR/WATER-RESISTIVE BARRIER IS REQUIRED OVER VERTICAL SUBSTRATES. APPLICATION OVER HORIZONTAL SOFFIT SUBSTRATE IS OPTIONAL UNLESS REQUIRED AS PART OF A CONTINUOUS AIR BARRIER SYSTEM.

3. SEALANT JOINT IS REQUIRED FOR SUSPENDED SOFFITS. OPTIONAL FOR RIGIDLY FRAMED.



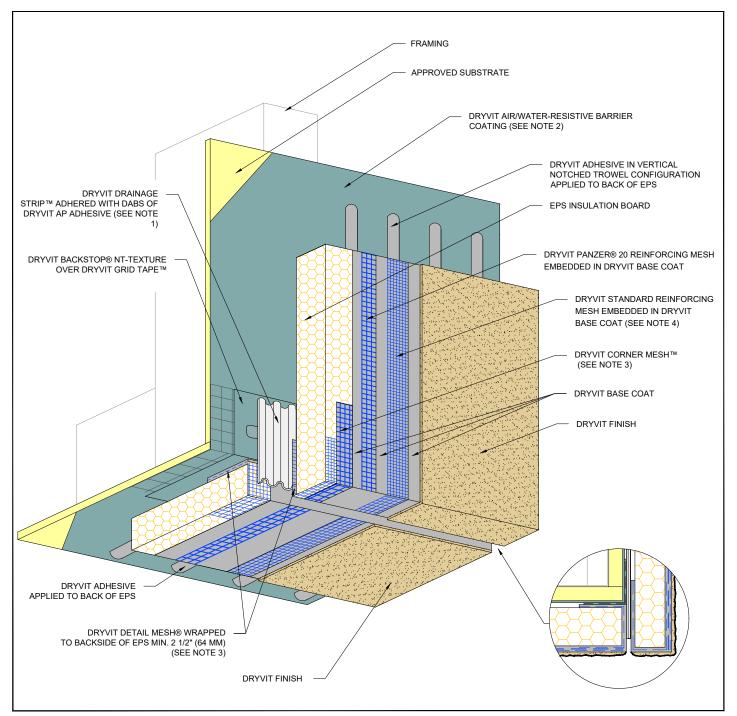

## Outsulation<sup>®</sup> HDCI<sup>™</sup> System

#### NOTE:

1. ENSURE BOTTOM EDGE OF DRAINAGE STRIP IS LEFT FREE TO DRAIN.

2. DRYVIT AIR/WATER-RESISTIVE BARRIER IS REQUIRED OVER VERTICAL SUBSTRATES, APPLICATION OVER HORIZONTAL SOFFIT SUBSTRATE IS OPTIONAL UNLESS REQUIRED AS PART OF A CONTINUOUS AIR BARRIER SYSTEM.


3. DRYVIT CORNER MESH AND DRYVIT DETAIL MESH ARE EMBEDDED IN DRYVIT BASE COAT, NOT SHOWN FOR CLARITY.

4. EXTEND DRYVIT STANDARD REINFORCING MESH ONTO EDGE OF EPS.

©Dryvit Systems, Inc. Issued: 6/2020

### Transition At Soffit/ Fascia Intersection



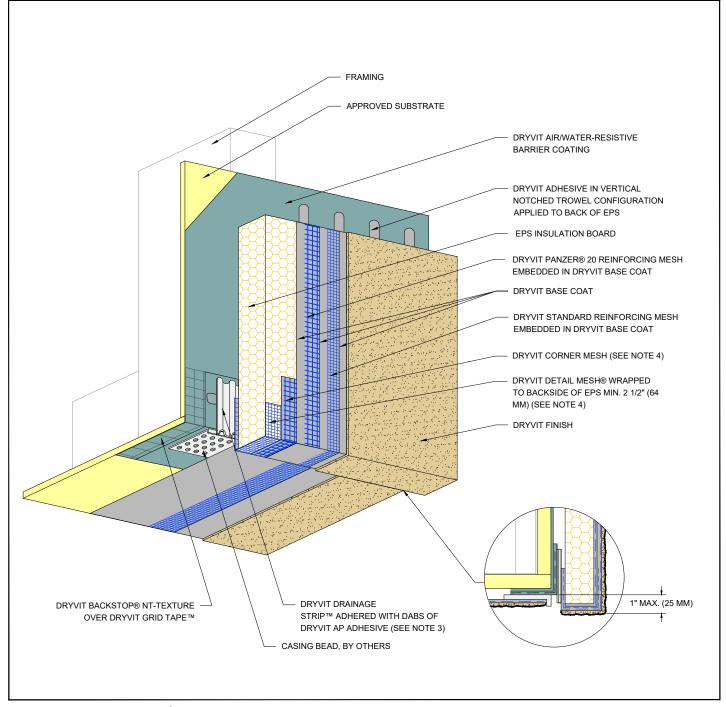

### **Outsulation<sup>®</sup> HDCI System**

#### NOTE

1. SOFFITS WITHOUT EPS INSULATION REQUIRE EXPANSION JOINTS EVERY 20 FT (6.1 M).

2. REFER TO DRYVIT PUBLICATION DS 173 FOR SPECIFIC REQUIREMENTS FOR SOFFIT AREAS.


3. BOTTOM EDGE OF DRYVIT DRAINAGE STRIP SHALL BE MASKED DURING INSTALLATION TO PREVENT CLOGGING OF DRAINAGE CHANNELS.

4. DRYVIT CORNER MESH AND DRYVIT DETAIL MESH ARE EMBEDDED IN DRYVIT BASE COAT, NOT SHOWN FOR CLARITY. Fascia/ Uninsulated Soffit Transition

The architecture, engineering, and design of the project using the Dryvit products is the responsibility of the project's design professional. All systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit specifically disclaims any liability for the use of this detail and for the architecture, design, engineering or workmanship of any project. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. Use of a functionally equivalent detail does not violate Dryvit's warranty. This detail is subject to change without notice. Contact Dryvit to ensure you have the most recent version.



©Dryvit Systems, Inc. Issued: 6/2020

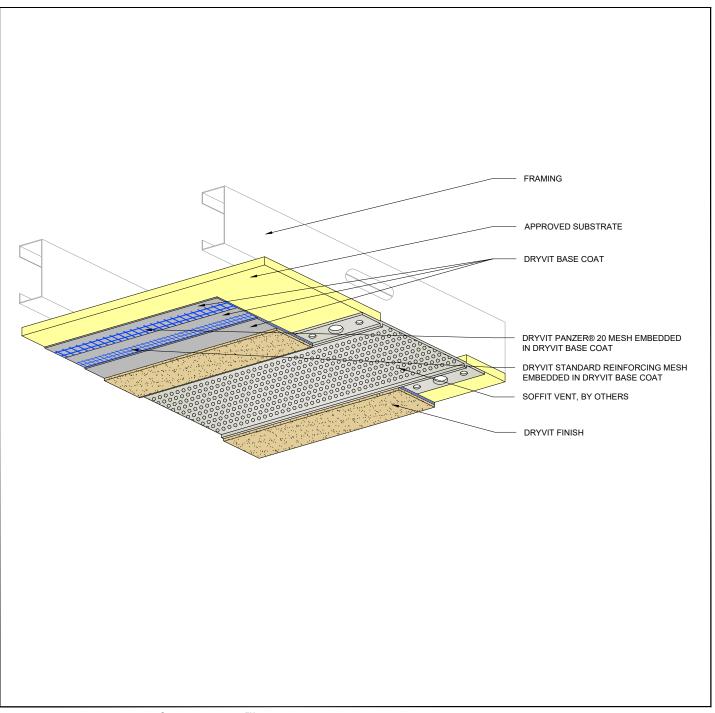

## Outsulation<sup>®</sup> HDCI<sup>™</sup> System

### NOTE:

1. CONTROL JOINTS ARE RECOMMENDED EVERY 20 FT (6.1 M).


2. REFER TO DRYVIT PUBLICATION DS173 FOR SPECIFIC REQUIREMENTS FOR SOFFIT AREAS.

3. SEAL ALL BUTT JOINTS, INTERSECTIONS, AND ENDS OF VENTS WITH COMPATIBLE SEALANT.

4. SEE DRYVIT PUBLICATION DS842 FOR ADDITIONAL DIRECT APPLIED DETAILS.

©Dryvit Systems, Inc. Issued: 6/2020 Termination at Uninsulated Soffit Vent



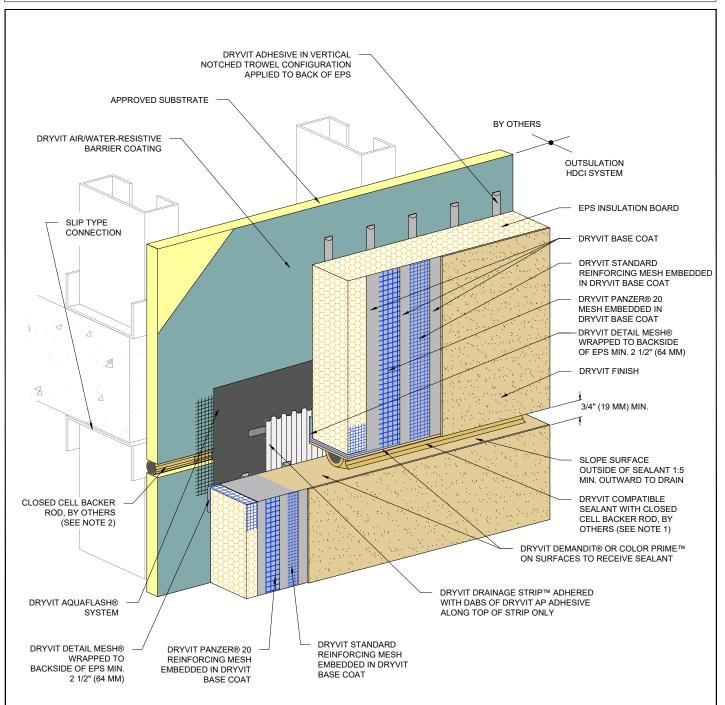

## Outsulation<sup>®</sup> HDCI<sup>™</sup> System


Horizontal Slip Joint without Weeps

NOTE:

1. LOCATE EXTERNAL SEALANT JOINT WITHIN 2" (51 MM) OF BREAK IN SHEATHING.

2. EXPANSION JOINT IN THE OUTSULATION HDCI SYSTEM IS NECESSARY WHERE SIGNIFICANT DIFFERENTIAL MOVEMENT IS EXPECTED AT FLOOR LINES.



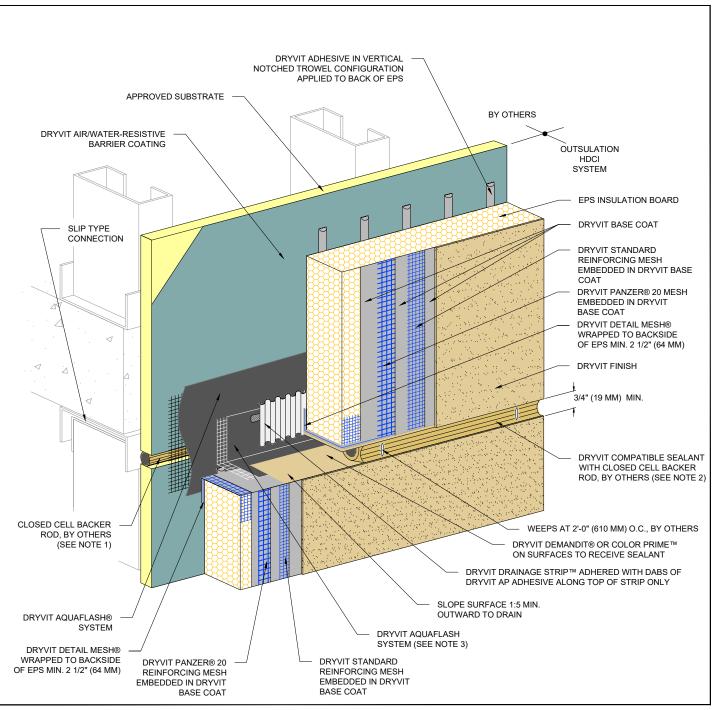

## Outsulation<sup>®</sup> HDCI<sup>™</sup> System

### Horizontal Slip Joint with Weeps


NOTE:

1. EXPANSION JOINT IN THE OUTSULATION HDCI SYSTEM IS NECESSARY WHERE SIGNIFICANT DIFFERENTIAL MOVEMENT IS EXPECTED AT FLOOR LINES.

2. LOCATE EXTERNAL SEALANT JOINT WITHIN 2" (51 MM) OF BREAK IN SHEATHING.

3. STOP AQUAFLASH SHORT OF SEALANT BOND LINE.




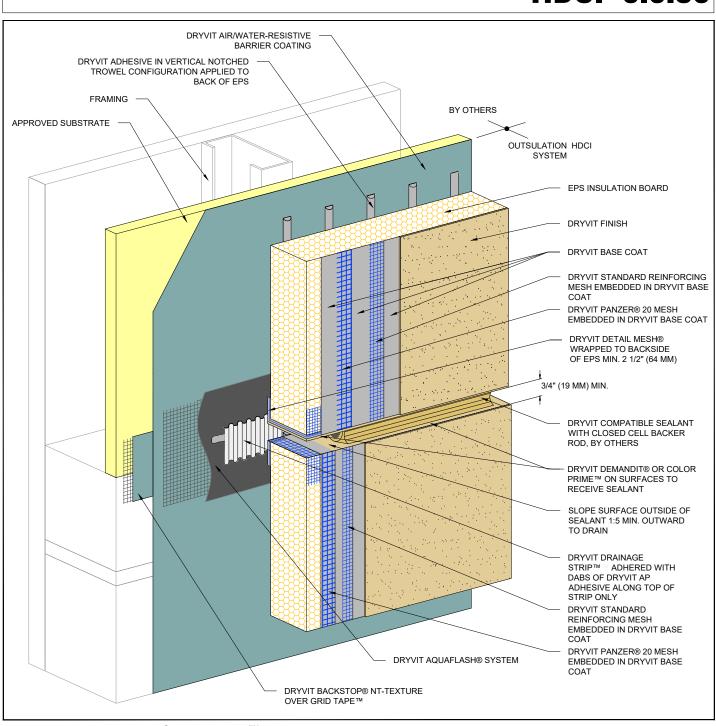

Outsulation<sup>®</sup> HDCI<sup>™</sup> System

Horizontal Joint - Substrate Change



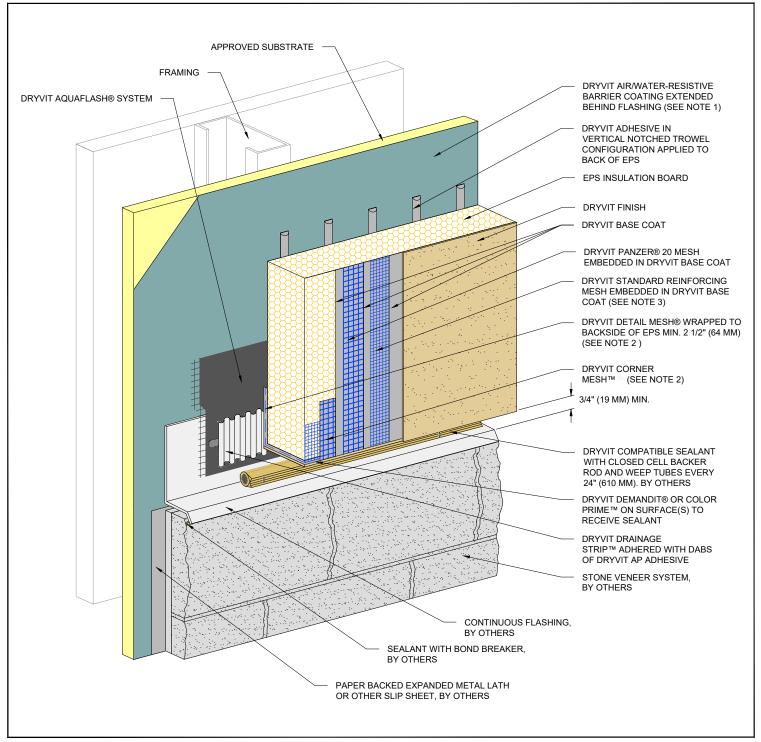

## Outsulation<sup>®</sup> HDCI<sup>™</sup> System

Horizontal Termination at Stone Veneer


NOTE:

1. FOR INSTALLATION OF DRYVIT AIRWATER-RESISTIVE BARRIER COATING BENEATH CLADDINGS OTHER THAN DRYVIT EIFS, REFER TO DRYVIT PUBLICATION DS840.

2. DRYVIT CORNER MESH AND DRYVIT DETAIL MESH ARE EMBEDDED IN A DRYVIT BASE COAT, NOT SHOWN FOR CLARITY.

3. EXTEND DRYVIT STANDARD REINFORCING MESH ONTO EDGE OF EPS.



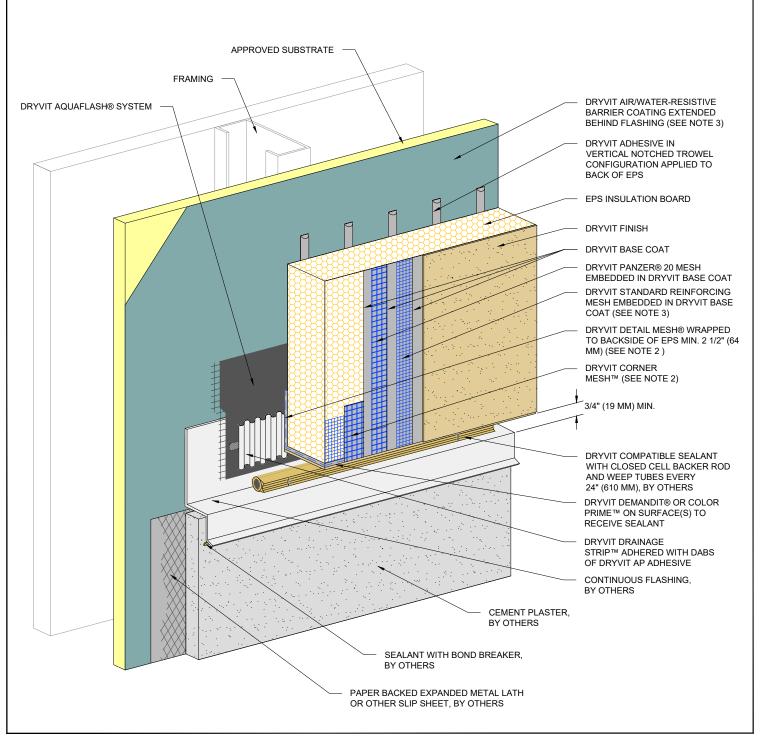

## Outsulation<sup>®</sup> HDCI MD System

### Horizontal Termination at Stucco


#### NOTE:

1. FOR INSTALLATION OF DRYVIT AIR/WATER-RESISTIVE BARRIER COATING BENEATH CLADDINGS OTHER THAN DRYVIT EIFS, REFER TO DRYVIT PUBLICATION DS840

2. DRYVIT CORNER MESH AND DRYVIT DETAIL MESH ARE EMBEDDED IN DRYVIT BASE COAT, NOT SHOWN FOR CLARITY.

3. EXTEND DRYVIT STANDARD REINFORCING MESH ONTO EDGE OF EPS.



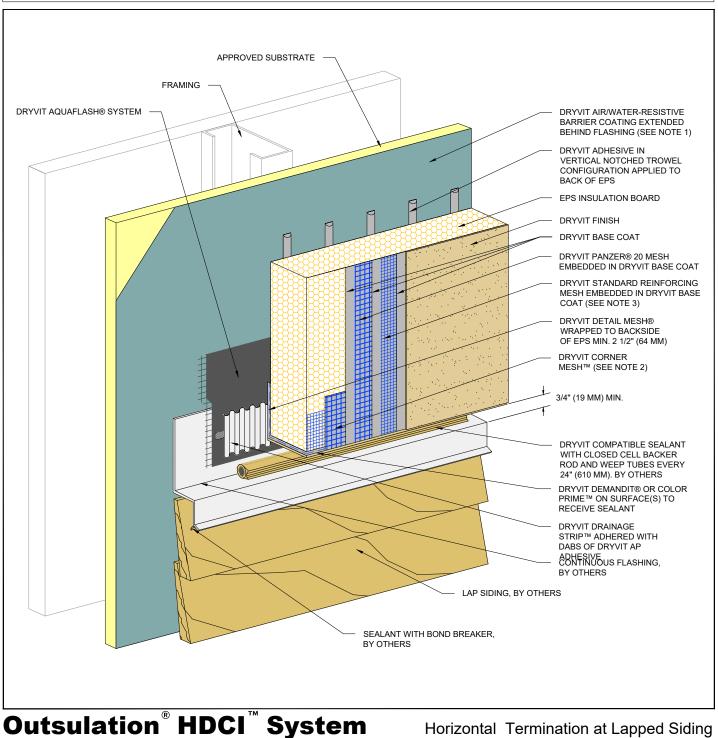


1. FOR INSTALLATION OF DRYVIT AIR/WATER-RESISTIVE BARRIER COATING BENEATH CLADDINGS OTHER THAN DRYVIT EIFS, REFER TO DRYVIT PUBLICATION DS840

2. DRYVIT CORNER MESH AND DRYVIT DETAIL MESH ARE EMBEDDED IN DRYVIT BASE COAT, NOT SHOWN FOR CLARITY.

3. EXTEND DRYVIT STANDARD REINFORCING MESH ONTO EDGE OF EPS.

Horizontal Termination at Lapped Siding




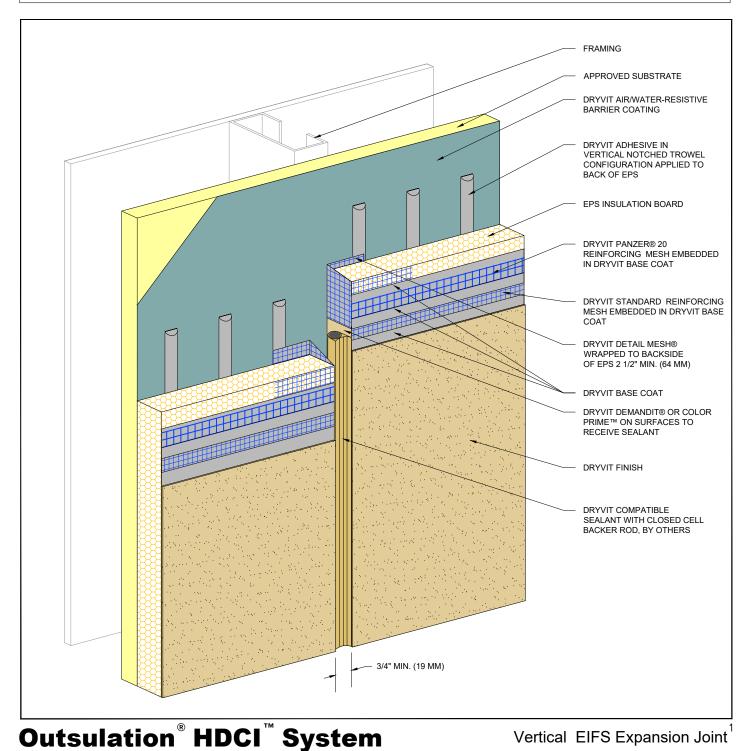

#### NOTE:

1. EIFS EXPANSION JOINTS ARE REQUIRED IN CONTINUOUS ELEVATIONS AT INTERVALS NOT EXCEEDING 75 FT (51 MM).



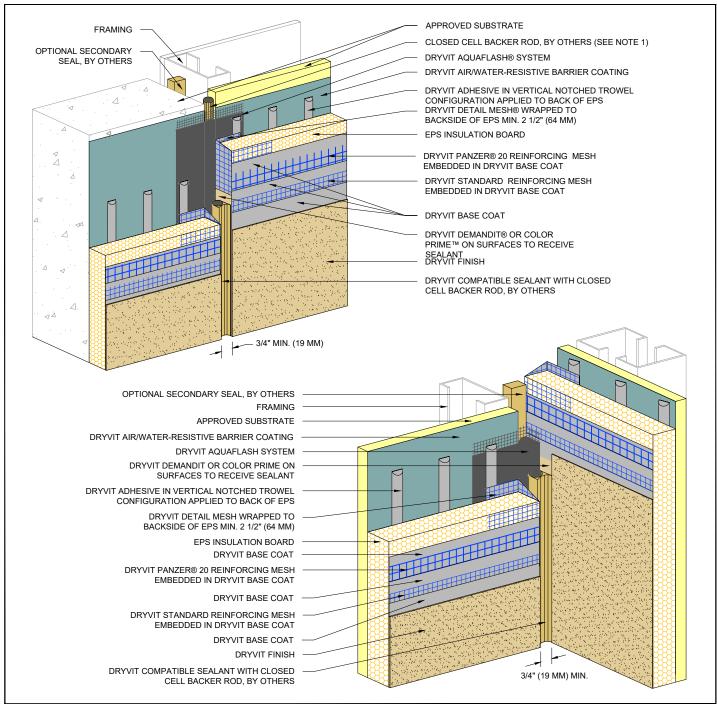

### **Through-Wall Expansion Joint**


The architecture, engineering, and design of the project using the Dryvit products is the responsibility of the project's design professional. All systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit specifically disclaims any liability for the use of this detail and for the architecture, design, engineering or workmanship of any project. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. Use of a functionally equivalent detail does not violate Dryvit's warranty. This detail is subject to change without notice. Contact Dryvit to ensure you have the most recent version.




### Outsulation<sup>®</sup> HDCI<sup>™</sup> System

NOTE:

1. LOCATE EXTERNAL SEALANT JOINT WITHIN 2" (51 MM) OF SUBSTRATE JOINT.

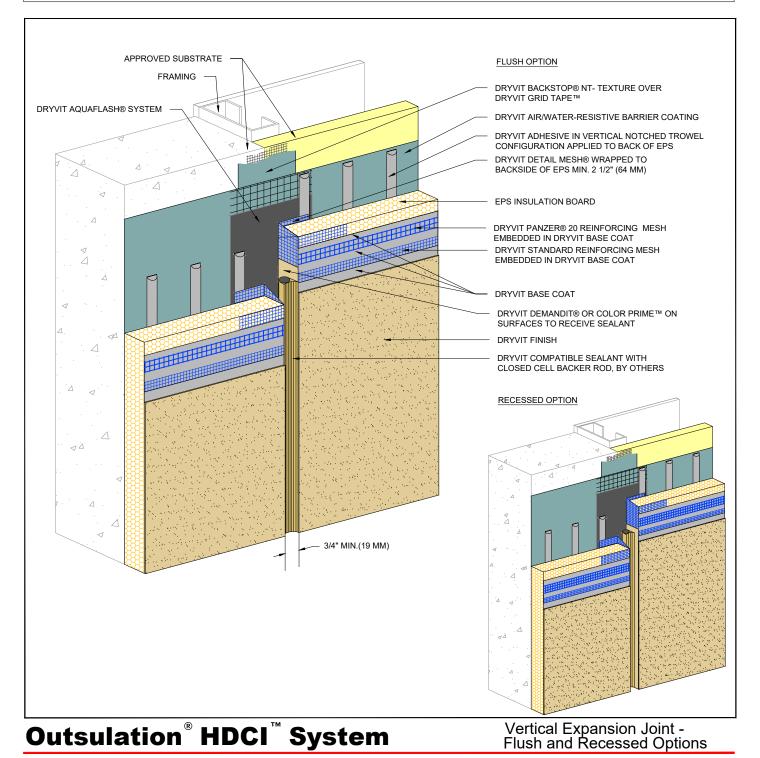




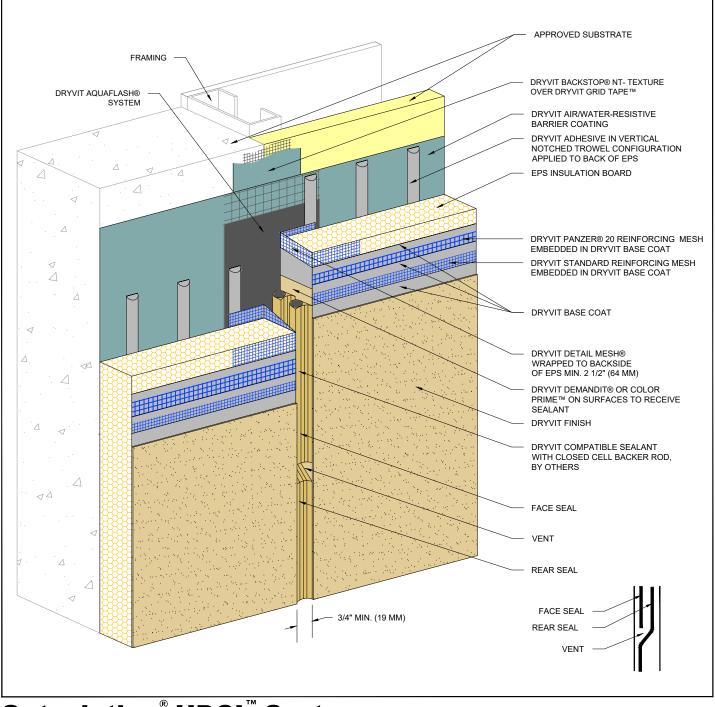

Outsulation<sup>®</sup> HDCI<sup>™</sup> System

Vertical Expansion Joint - Double Seal Option



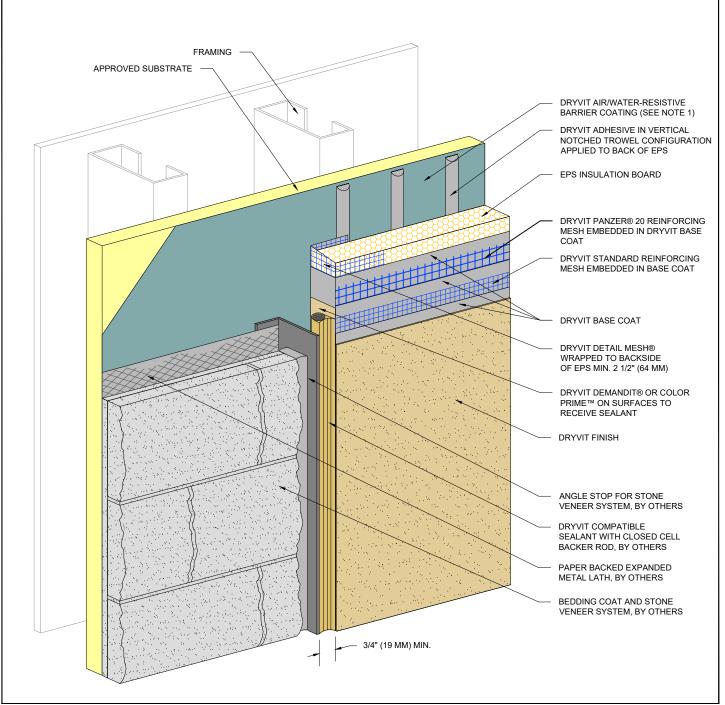


## Outsulation<sup>®</sup> HDCI<sup>™</sup> System

NOTE:

1. FOR INSTALLATION OF DRYVIT AIRWATER-RESISTIVE BARRIER COATING BENEATH CLADDINGS OTHER THAN DRYVIT EIFS, REFER TO DRYVIT PUBLICATION DS840.

### Vertical Termination At Stone Veneer




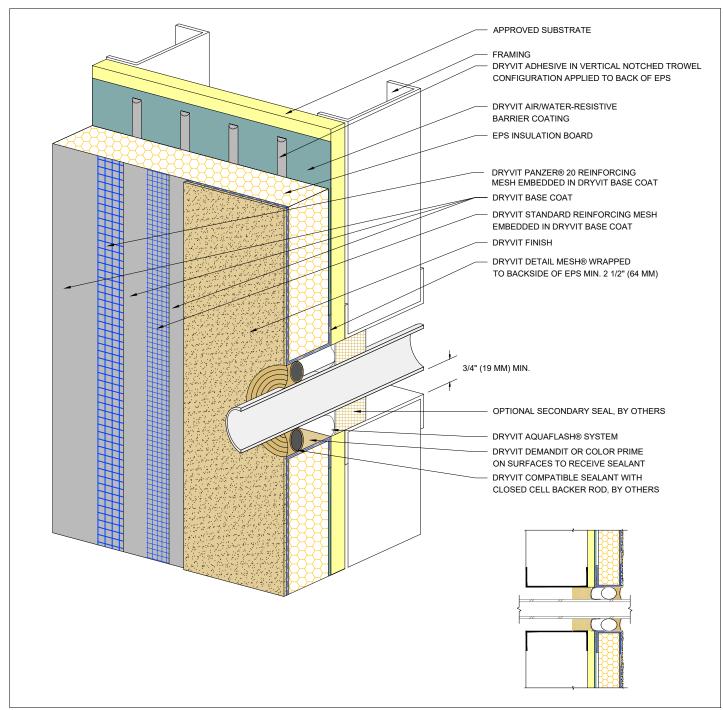

## Outsulation<sup>®</sup> HDCI<sup>™</sup> System

### Penetrations




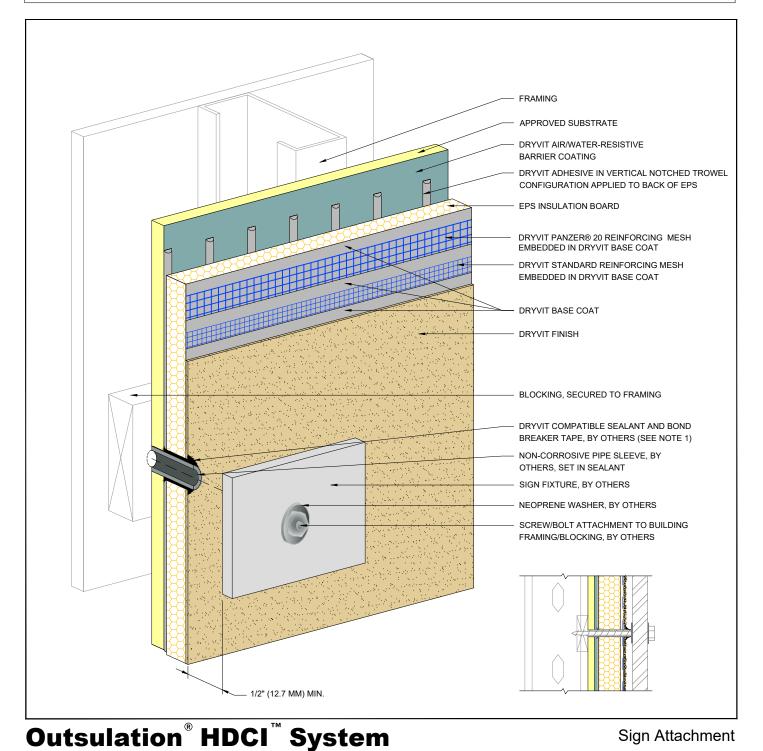

### NOTE:

1. PERIMETER OF PIPE SLEEVE IS CAULKED TO PREVENT WATER ENTRY INTO WALL.



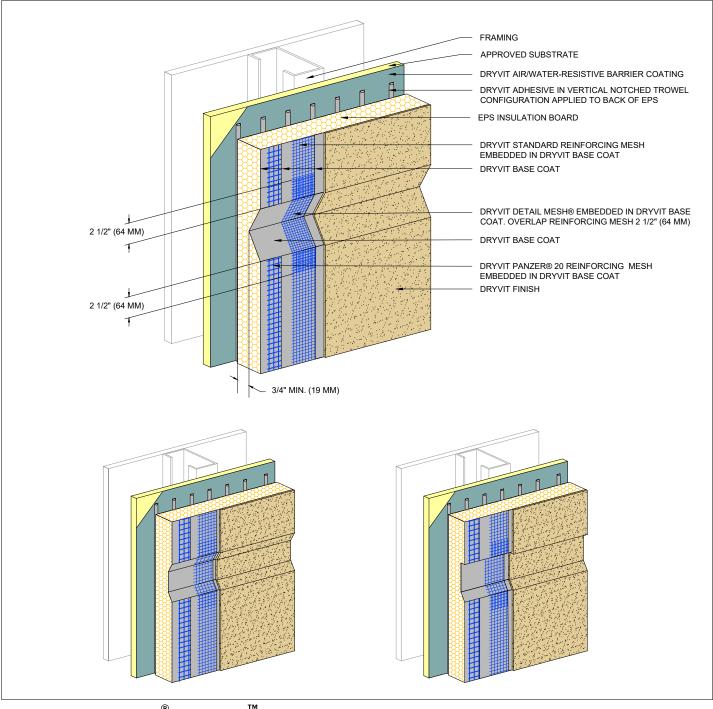


## Outsulation<sup>®</sup> HDCI<sup>™</sup> System

### Aesthetic Reveals


NOTE: 1. SLOPE BOTTOM EDGE OF REVEAL FOR POSITIVE DRAINAGE.



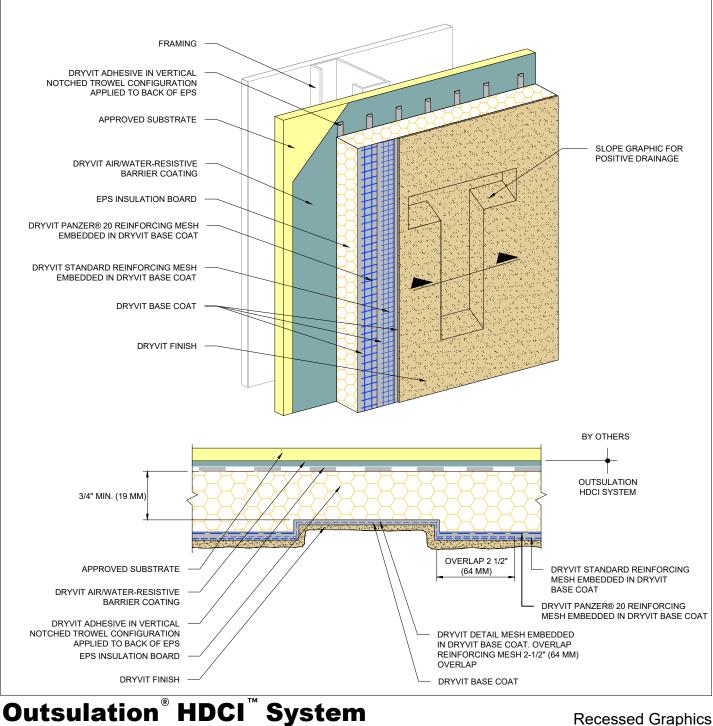

### **Recessed Graphics**



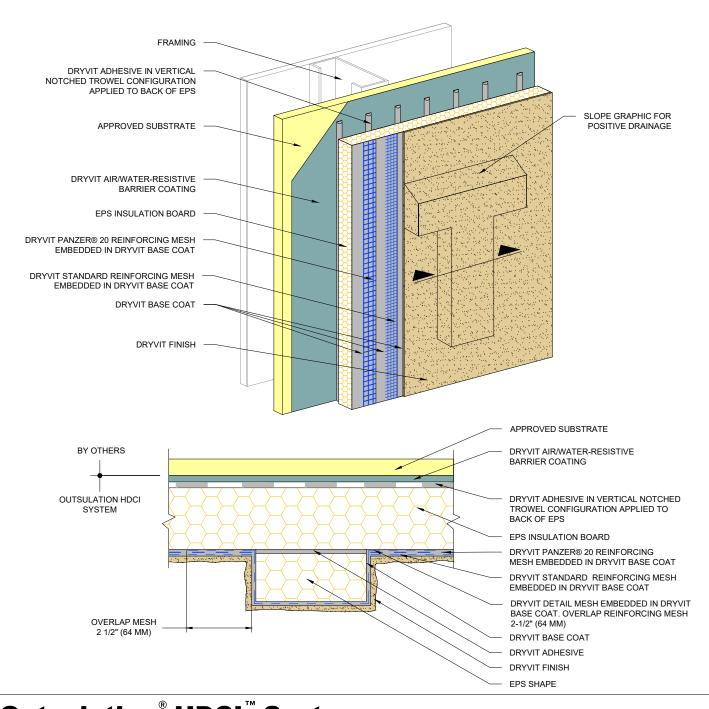


## Outsulation<sup>®</sup> HDCI<sup>™</sup> System

#### NOTE:

1. MAXIMUM THICKNESS OF EPS BUILT OUT SHAPES SHALL NOT EXCEED 13 INCHES (330 MM) AT ANY POINT MEASURED FROM THE SUBSTRATE. **Projecting Graphics** 



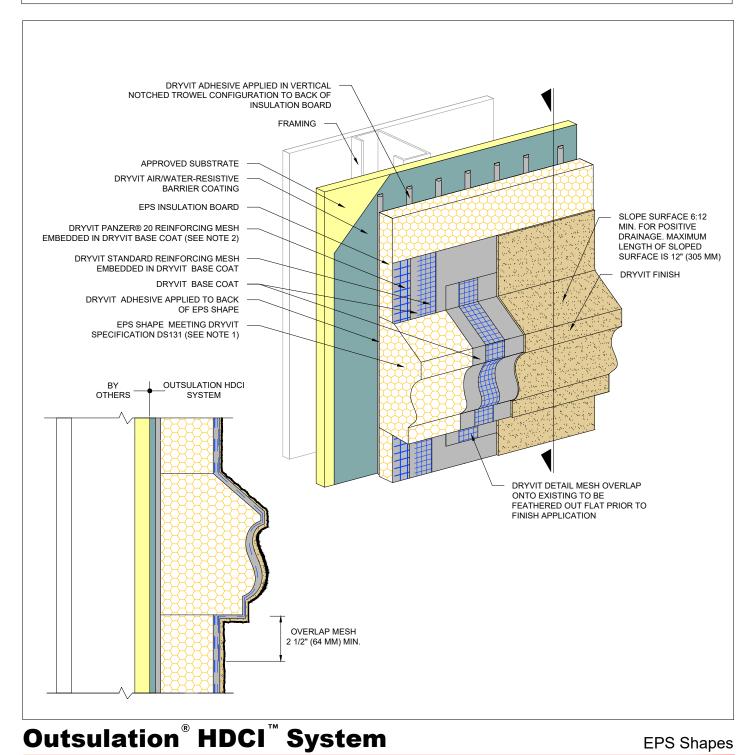

#### NOTES

1. MAXIMUM THICKNESS OF EPS BUILT OUT SHAPES SHALL NOT EXCEED 13" (330 MM) AT ANY POINT MEASURED FROM THE SUBSTRATE.

2. CONTINUE PANZER MESH OVER FLAT FACES OF EPS SHAPE WHERE FEASIBLE.

